

**SAN ANTONIO WATER SYSTEM
WATER SYSTEM CONSTRUCTION**

Addendum No. 1

To Specifications For

2016 Annual Water Distribution Leak Repairs Contract – Package 6

SAWS Job Nos. 16-0113 (O&M) and 16-1401 (CIP)

Solicitation No. B-16-007-JG

To Bidder of Record:

This addendum, applicable to the work associated with the above referenced Contract, is an amendment to the bidding documents and as such shall be a part of and included in the Contract. The original contract documents and any prior addenda remain in full force except as modified by the following, which shall take precedence over any contrary provisions in prior documents. Acknowledge receipt of this addendum by entering the addendum number and issue date in the space provided in submitted copies of the proposal.

Questions and Answers:

No written questions, regarding this solicitation, technical questions or additional information, were asked prior to the deadline of 4:00 p.m. (CT) on April 29, 2016.

Supplemental Condition:

For emphasis, bidders shall be aware of the Supplemental Condition as it relates to Article VII, Section 7.2 of the General Conditions regarding retainage.

Special Conditions:

Section SC-1.0 SCOPE OF WORK:

In addition to the general explanation regarding the estimated quantity of work, the enclosed maps offer a perspective of the SAWS water distribution system workload on a given day. Much of this work is completed by in-house crews with some portion intended to be completed through this contract.


Section SC-2.4 PERFORMANCE TIME:

The requirements of Section SC-2.4 PERFORMANCE TIME do not apply to work orders that involve leak repairs on water main pipe greater than 16 inches in diameter or work orders that involve replacing existing valves larger than 16 inches. The performance time requirements for work orders involving these larger assets will be negotiated separately at the time the work order is issued.

Invitation to Bidders:

Remove Paragraph Four (4) from Invitation to Bidders, Page IV-1 and Replace with the Following:

For questions regarding this solicitation, technical questions or additional information, please contact Jessica GoForth, Contract Administration Specialist, in writing via email to: Jessica.GoForth@saws.org or by fax to (210) 233-4466 until 4:00 PM (CT) on April 29, 2016. Answers to the questions will be posted to the web site by 4:00 PM (CT) on May 3, 2016 as a separate document or included as part of an addendum.



Jerome A. Iltis 5/2/16 *Jerome A. Iltis*
Jerome A. Iltis, P.E.

END OF ADDENDUM 1

Unassigned Work Orders





GIS CITY GIS: A result of a partnership of your City and your Department
April 08, 2010 0:00
Copyright 2010 by the City of Charlotte, NC. This information is provided as a service to the public. It is not intended to be used for any other purpose. The City of Charlotte is not responsible for any errors or omissions in this information. The City of Charlotte is not responsible for any damages or losses resulting from the use of this information. The City of Charlotte is not responsible for any actions taken based on this information. The City of Charlotte is not responsible for any actions taken based on this information.



- Unassigned Work Orders
- Water Hydrant
- Water Meter
- Water Service Line
- Water Valve

Open Work Orders and Assignment Status

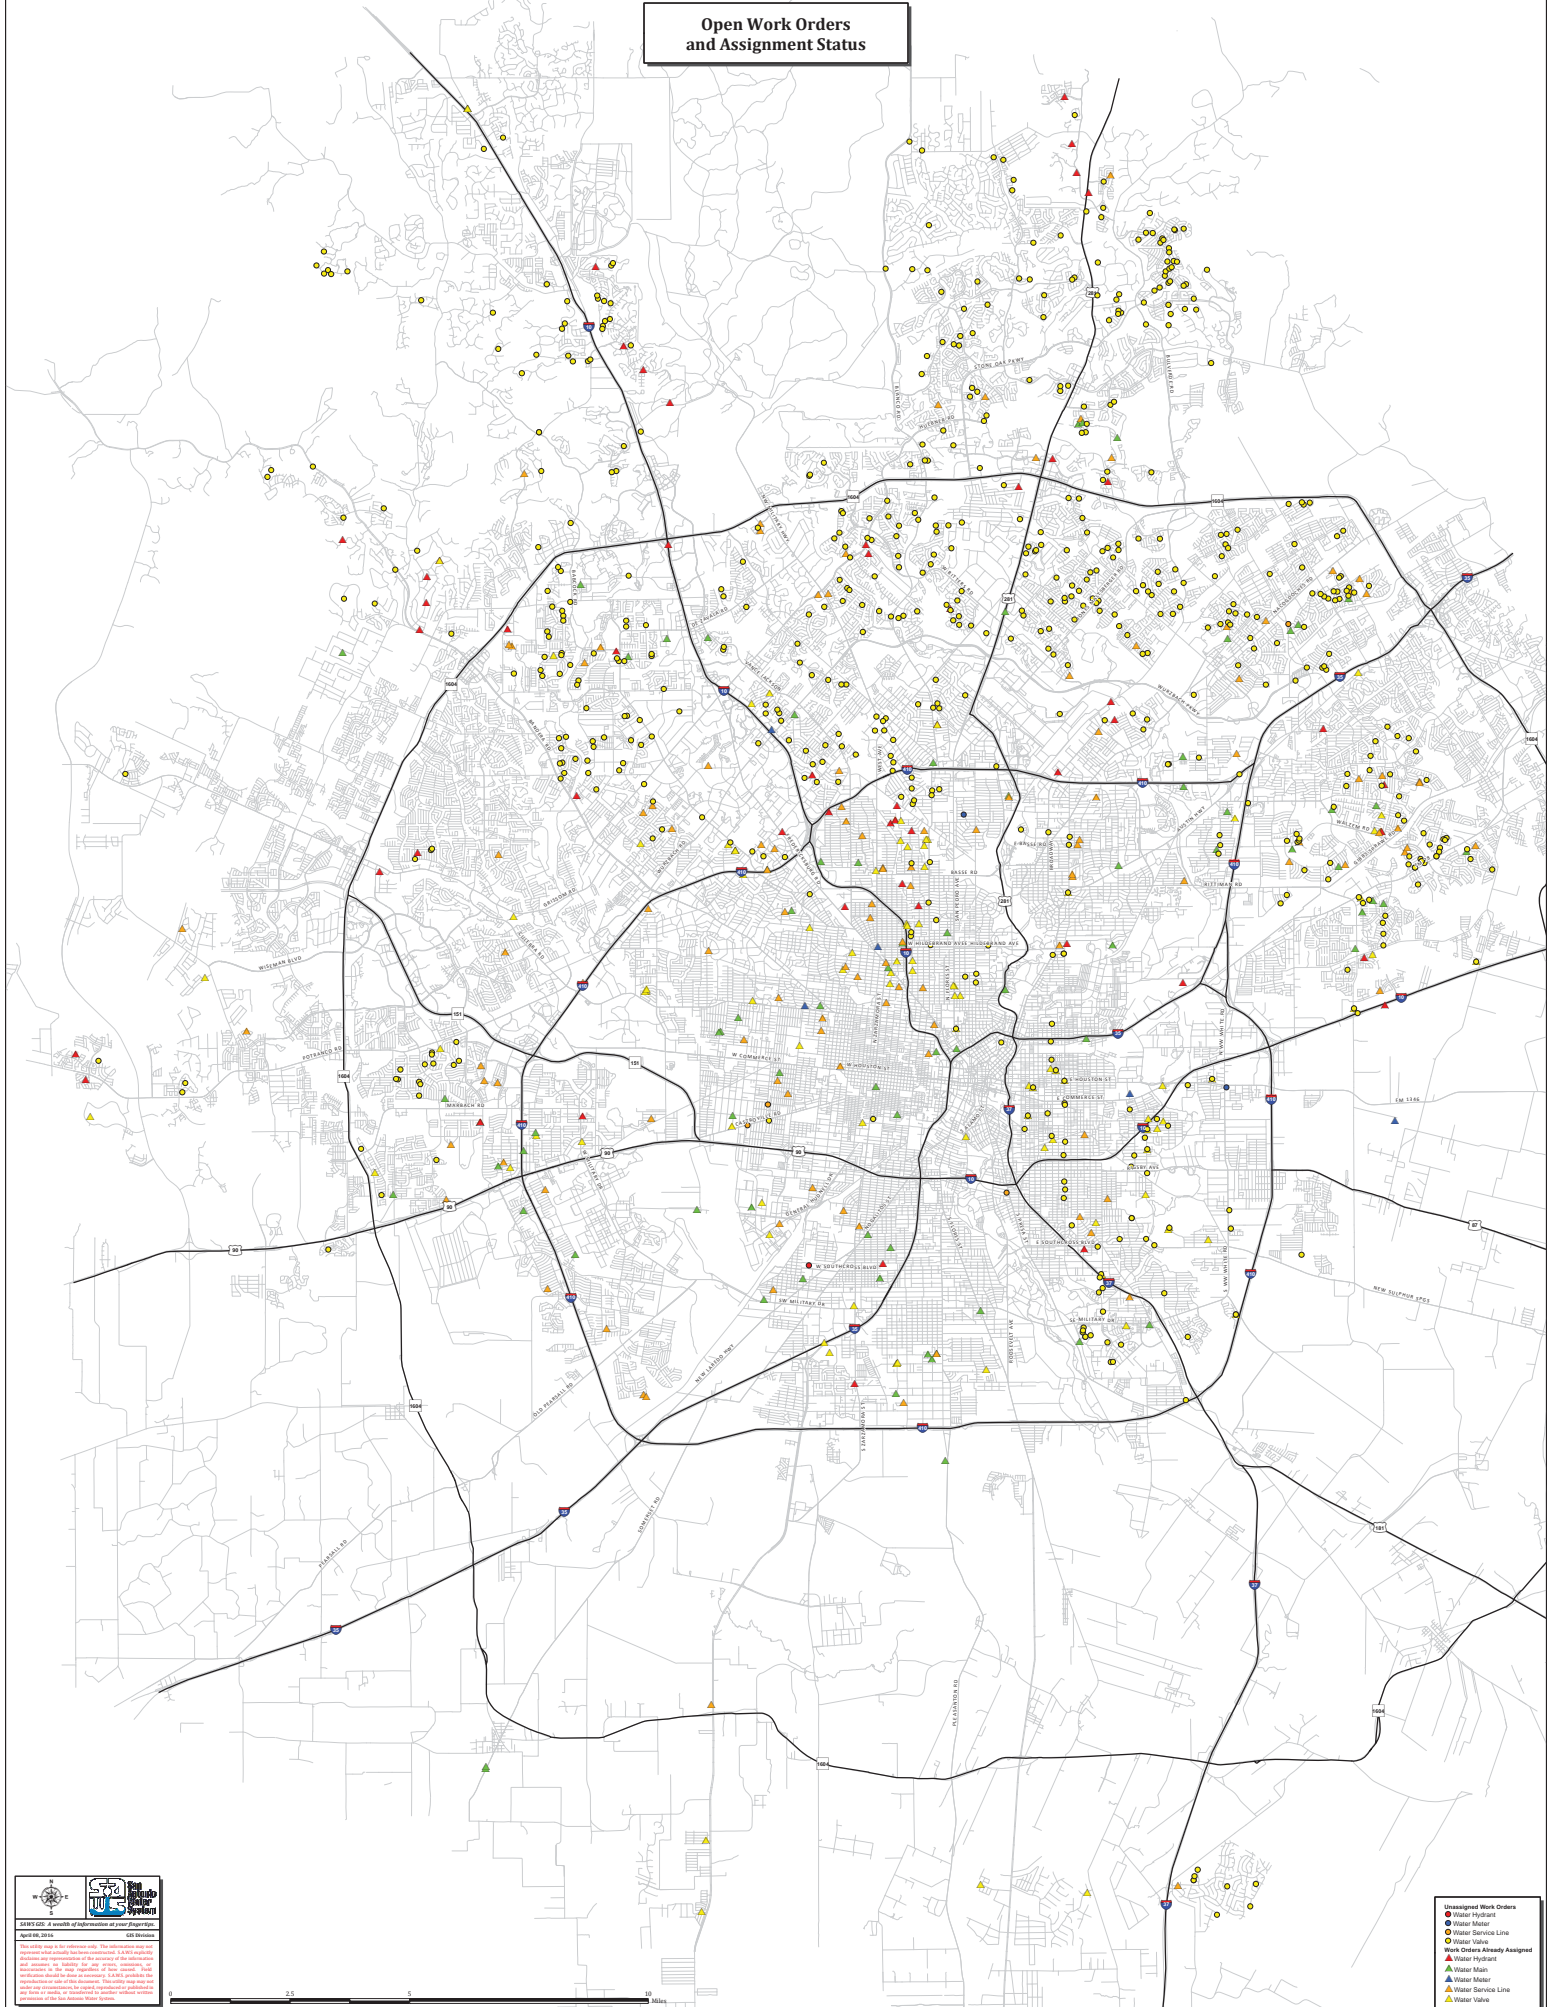



 CITY OF COLUMBUS
 Columbus Water Works
 April 08, 2016
 GIS Division

This information is provided for informational purposes only. The information is not intended to be used as a substitute for professional engineering or other services. The City of Columbus and Columbus Water Works are not responsible for any errors or omissions in this information. The City of Columbus and Columbus Water Works are not responsible for any damages or losses resulting from the use of this information. The City of Columbus and Columbus Water Works are not responsible for any work orders that are not shown on this map. The City of Columbus and Columbus Water Works are not responsible for any work orders that are shown on this map but are not in the field. The City of Columbus and Columbus Water Works are not responsible for any work orders that are shown on this map but are not in the field.



- Unassigned Work Orders
- Water Main
- Water Service Line
- Water Valve
- Work Orders Already Assigned
- ▲ Water Main
- ▲ Water Meter
- ▲ Water Service Line
- ▲ Water Valve