



2019 Dead End Water Main Elimination Project
Solicitation Number: CO-00326-SM
Job No.: 19-4004

ADDENDUM 1
Date: 07/24/2020

To Bidder of Record:

This addendum, applicable to work referenced above, is an amendment to the bid proposal, plans and specifications and as such will be a part of and included in the Contract Documents. Acknowledge receipt of this addendum by entering the Addendum number and issue date on the space provided in submitted copies of the bid proposal.

RESPONSES TO QUESTIONS

1. **Question:** Is the HDPE Pipe for this job to be DIPS or IPS?
Response: The contractor shall use DIPS HDPE Pipe for this job.

CHANGES TO THE SPECIFICATIONS

1. Instructions to Bidders Sections 1, 2, and 4 are hereby deleted in their entirety and replaced with the following:

“1. Bids will be submitted in accordance with the following:

- a. **Electronic bids will be received by Contract Administration in the SAWS secured File Transfer Protocol (FTP) site. Personal/hand delivered** sealed bids will be received by Contract Administration **via a drop box located on the left wall when walking through the first set of double glass doors of the main Tower II entry on the north side of the building** at San Antonio Water System, 2800 U.S. Hwy 281 North, Customer Center Building, Suite 141, San Antonio, Texas 78212. **All bids will be received until the time specified in the Invitation to Bidders.**
- b. If the submittal of a **hardcopy** sealed bid is by any means other than personal/hand delivery, then it is the bidder's sole responsibility to ensure the bid is delivered to San Antonio Water System, 2800 U.S. Hwy 281 North, San Antonio, Texas 78212, no later than the exact time specified in the Invitation to Bidders.
- c. All bids errantly submitted or delivered to a location other than the exact locations stated above will be returned/ deleted and unopened.
- d. All bids received after the exact time set for the bid opening in the Invitation to Bidders will be returned/ deleted and unopened.
- e. The San Antonio Water System Contracting Office may, at its sole discretion, without waiver of rights or authority, in equity or at law, return or delete any unopened bids not meeting the exact requirements as stated above.

2. Bids will be opened in accordance with the following:

- a. Bids will be opened **in a public WebEx meeting** and read aloud by a Contract Administration representative. Instruction on how to participate in this public WebEx meeting can be found in the

Electronic Bid Opening Instructions.

- b. The lowest bid received at the time of the bid opening shall be designated as the “apparent low bid,” whether announced in that manner or not, and shall not represent an acceptance of an offer.
 - c. All bid results are unofficial, tentative and subject to verification on the day of the bid opening.
 - d. No bid may be withdrawn after the scheduled bid opening time without the written consent of a Contract Administration representative.
 - e. The “official” bid results will be tallied on a “bid tabulation sheet” and posted within 10 business days of the bid opening on the San Antonio Water System’s website.
4. **Electronic** bids submitted on the original bid form attached herein must be titled with the solicitation number, date and time of the bid opening, and the project name. **Hardcopy** bids submitted on the original bid form attached herein must be sealed in an envelope plainly marked on the outside with solicitation number, the date and time of the bid opening, and project name.

All other sections of the Instructions to Bidders shall remain the same.

CHANGES TO THE PLANS

1. **Sheet No. 11 of 27 (San Fernando Street Site):** Replace Sheet 11 in its entirety with attached Sheet 11. During a SUE pothole survey at the site, an existing gas line was found near Station 4+14.96. The gas main has no impact to the proposed work at the site. The sheet is revised to caution the contractor of the presence of the gas service near the proposed work.
2. **Sheet No. 12 of 27 (San Fernando Street Site):** Replace Sheet 12 in its entirety with attached Sheet 12. During a SUE pothole survey at the site, an existing gas line was found near Station 4+14.96. The gas main has no impact to the proposed work at the site. The sheet is revised to caution the contractor of the presence of the gas service near the proposed work.

CLARIFICATIONS

1. DIPS HDPE pipe shall be used for this job.
2. To minimize travel and the need for Bidders to hand deliver bids during the COVID19 Emergency, SAWS has provided the option to Bidders to submit bids electronically. See the Electronic Bid Opening Instructions attached to this Addendum. Bidders may still hand deliver bids if they wish and as provided for in this Addendum but shall only submit the items as indicated on the revised Bid Proposal Checklist in the initial bid packet. Reference the revised Bid Proposal Checklist attached to this Addendum.
3. The public Bid Opening will be conducted on video via a WebEx meeting. See the Electronic Bid Opening Instructions attached to this Addendum.

END OF ADDENDUM

This Addendum is six (6) page(s) in its entirety.

Attachments:

1. Electronic Bid Opening Instructions
2. Revised Sheet 11 of 27 (San Fernando Street)
3. Revised Sheet 12 of 27 (San Fernando Street)



K. W. Chan, P.E.
Unitech Consulting Engineer, Inc.



7/24/2020

**2019 Dead End Water Main Elimination Project
Solicitation Number: CO-00326**

**ELECTRONIC BID OPENING INSTRUCTIONS
August 6, 2020 at 11:00 AM CDT)**

FTP BID PROPOSAL UPLOAD

In order to receive electronic bids for this project, SAWS will utilize a SAWS secured File Transfer Protocol (FTP) site. Only Bidders bidding as Prime Contractors will need to submit their request prior to August 5, 2020 AND 12:00 PM to receive access to the FTP site via email to Stella.Manzello@saws.org. Bidder's email shall provide the legal name of the Bidder's company and the intended recipient's email address and phone number. No requests for FTP site access will be accepted after **August 5, 2020 AND 12:00 PM (CDT)**. Once a Bidder is approved for access, an email with a hyperlink to the FTP site and a unique password for the Bidder will be provided to the Bidder's email recipient.

Once access is received, Bidders may upload the required documents per the Bid Proposal checklist any time before **August 6, 2020 AND 11:00 AM (CDT)**. Please ensure to allow sufficient time should Bidder's experience technical difficulties in uploading the required documents. No changes to the Bid nor bid price can be made once the Bid has been submitted.

Bidders shall comply with the following:

- 1) Limit files to one (1) pdf file that includes all requested documents, per the Bid Packet Checklist. **ONLY ONE SUBMITTAL WILL BE ACCEPTED PER REQUEST.** Do not upload any zip files.
- 2) Ensure that the itemized List of Bid Items is (are) the first page(s) of your file.
- 3) Bidders may protect the document from editing by adding a password. However, the document must be accessible for viewing by SAWS without requiring a password.
- 4) File shall be named: **CO-00326 – 2019 Dead End Water Main Elimination Project**
- 5) **DO NOT SHARE ACCESS AND/OR PASSWORD WITH OTHER PARTIES OUTSIDE YOUR COMPANY.**
- 6) **ENSURE THE BID IS SENT NO LATER THAN THE DUE DATE AND TIME. BIDS SUBMITTED AFTER THE BID OPENING DEADLINE WILL NOT BE ACCEPTED.**

If the Bidder is in need of help, they may contact the SAWS Contract Administrator, **Stella Manzello**, at **210-233-3854** or view troubleshooting tips at <http://www.Serv-U.com/sharefiles>

WEBEX BID OPENING MEETING

The WebEx meeting details are below if you would like to view the public opening of the bids.

When it's time, start or join the WebEx meeting from [here](#).

Access Information

Meeting Number: **146 718 5474**

Meeting Password: dUSHdRQ3c87

Audio Connection: 210-233-2090 (SAWS WebEx)

If you have any questions or concerns, please feel free to contact me.

Thank you,


Stella Manzello

Contract Administrator

2800 U.S. Highway 281 North, Ste. 171 | San Antonio, TX 78212



Office | 210-233-3854

Email | Stella.Manzello@saws.org

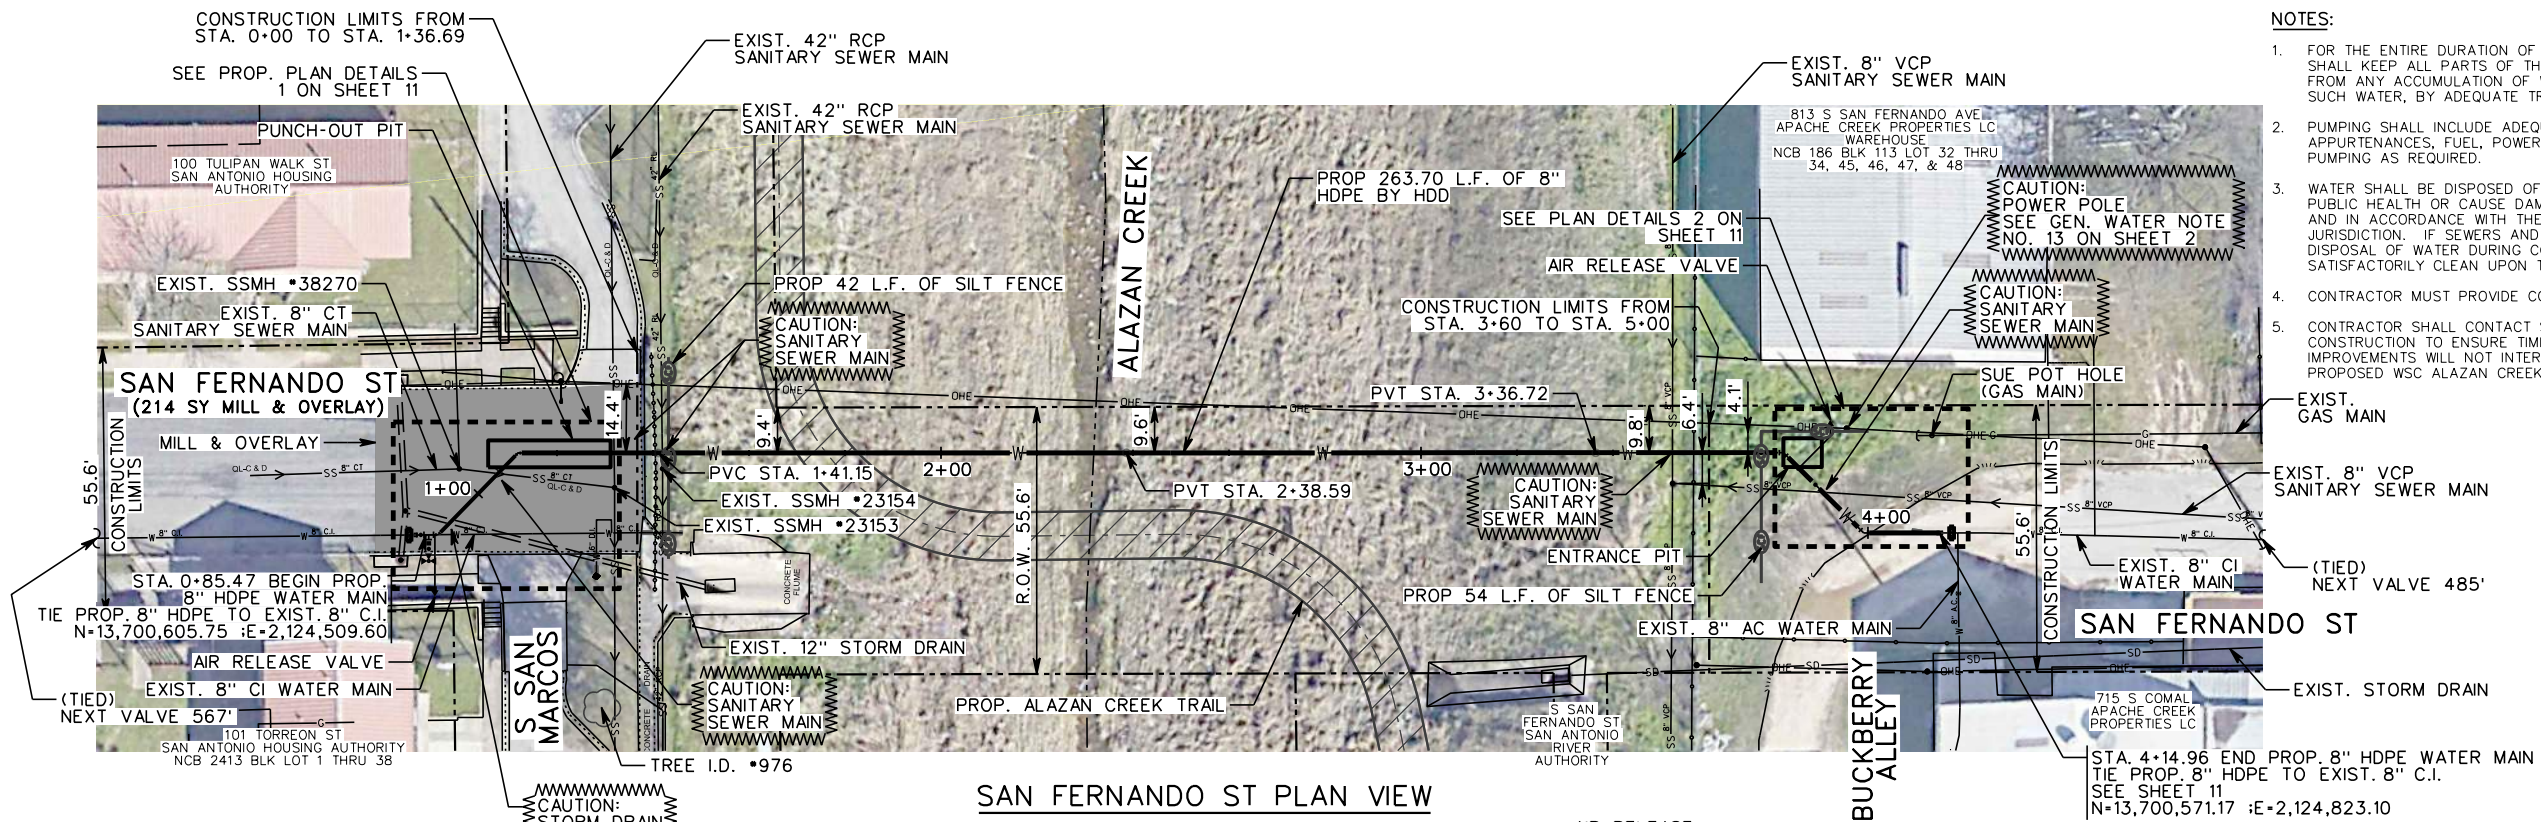

- NOTES:**
- FOR THE ENTIRE DURATION OF THE CONTRACT, AT THE CONTRACTORS EXPENSE, SHALL KEEP ALL PARTS OF THE PROJECT SITE, INCLUDING EXCAVATIONS, FREE FROM ANY ACCUMULATION OF WATER, REGARDLESS OF THE SOURCE OR CAUSE OF SUCH WATER, BY ADEQUATE TRENCHING AND PUMPING AS REQUIRED.
 - PUMPING SHALL INCLUDE ADEQUATE PUMPS, HOSE STRAINERS, AND OTHER APPURTENANCES, FUEL, POWER, TRENCHING, EROSION CONTROL FACILITIES, AND PUMPING AS REQUIRED.
 - WATER SHALL BE DISPOSED OF IN SUCH A MANNER AS WILL NOT ENDANGER PUBLIC HEALTH OR CAUSE DAMAGE OR EXPENSE TO PUBLIC OR PRIVATE PROPERTY, AND IN ACCORDANCE WITH THE REQUIREMENTS OF ANY PUBLIC AGENCIES HAVING JURISDICTION. IF SEWERS AND STREETS ARE USED FOR DRAINAGE OR THE DISPOSAL OF WATER DURING CONSTRUCTION, THEY SHALL BE MAINTAINED AND LEFT SATISFACTORILY CLEAN UPON THE COMPLETION OF THE WORK.
 - CONTRACTOR MUST PROVIDE CONTINUOUS ACCESS TO RESIDENTS.
 - CONTRACTOR SHALL CONTACT SAN ANTONIO RIVER AUTHORITY PRIOR TO CONSTRUCTION TO ENSURE TIMING OF INSTALLATION OF PROPOSED WATER IMPROVEMENTS WILL NOT INTERFERE OR CONFLICT WITH CONSTRUCTION OF THE PROPOSED WSC ALAZAN CREEK TRAIL.

SAN FERNANDO ST PLAN VIEW

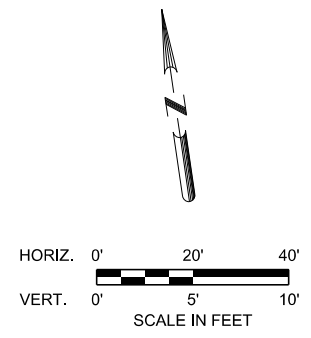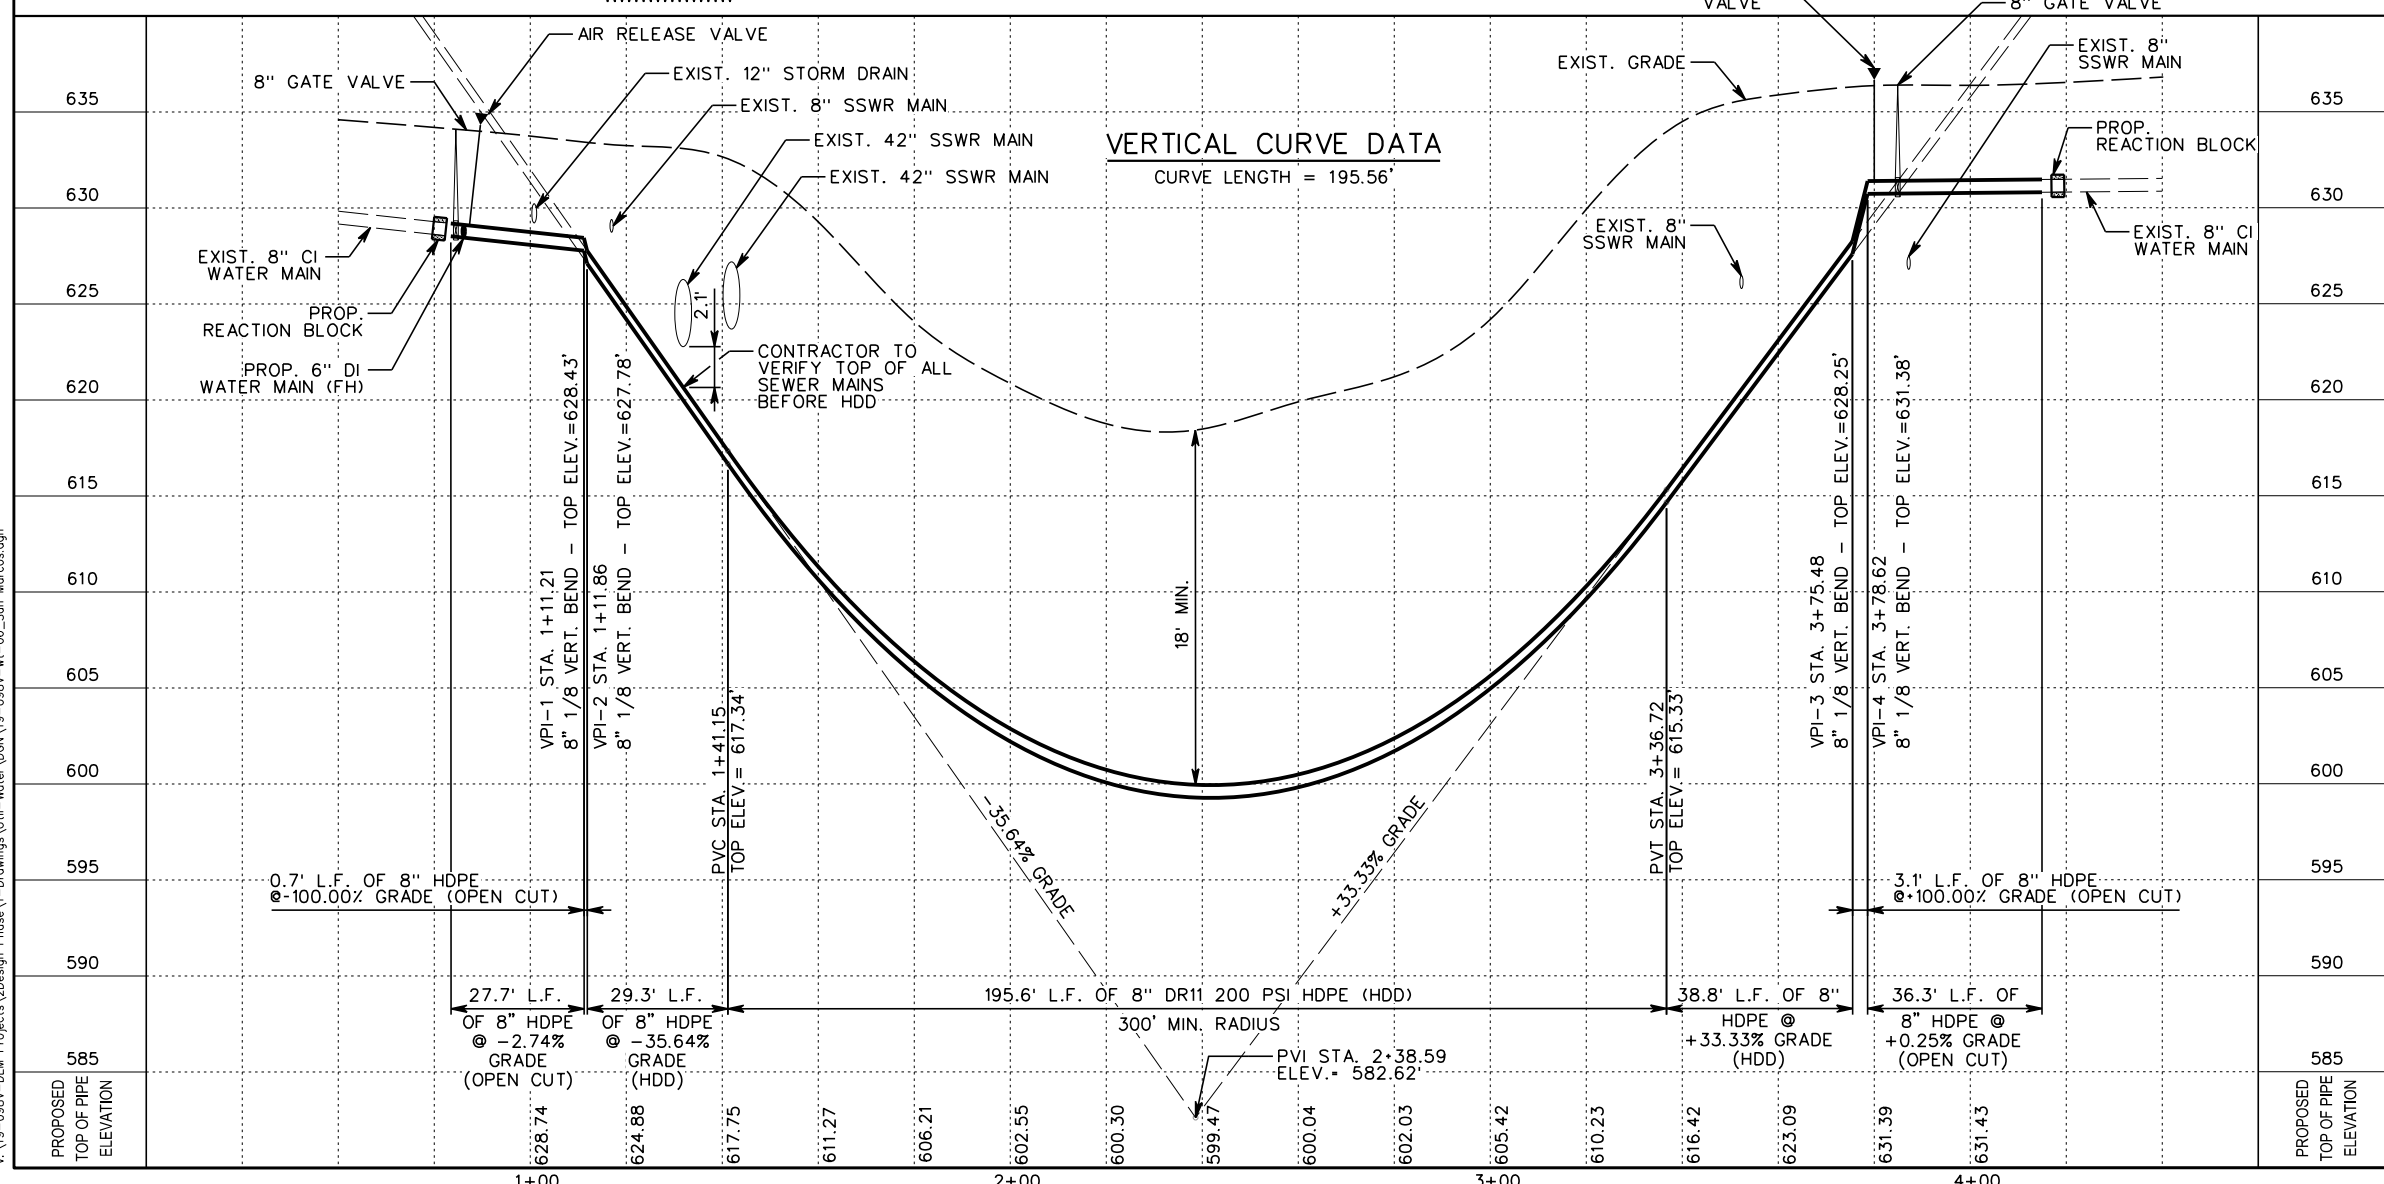

LEGEND

- PROP. WATER MAIN
- EXIST. WATER MAIN
- CAS MAIN
- SANITARY SEWER
- STORM SEWER
- UTILITY POLE LINE
- ELECTRIC CABLE
- TELEPHONE CABLE
- DUAL BRANCH SERV.
- NEW UNMETERED SERVICE:
- 3/4" SINGLE
- 1" DUAL
- SERVICE RECONNECT:
- 3/4"
- 1" OR LARGER
- SERVICE RELAY:
- 3/4"
- 1" OR LARGER
- SERVICE RELOCATE:
- 3/4"
- 1" OR LARGER
- RELOCATE METER
- NEW SERVICE:
- 3/4"
- 1" OR LARGER

NO.	DATE	REVISION	APP.


UNINTECH CONSULTING ENGINEERS, INC.
 2431 E. Evans Road
 San Antonio, Texas 78259
 Phone: (210) 641-6003
 TBPCE Reg. No. F-5499
 Fax: (210) 641-8279
 www.unintech.com

2019 DEAD END WATER MAIN ELIMINATION PROJECT
 SAWS WATER WORK
 SAN FERNANDO ST
 PLAN AND PROFILE
 UNIT ID# 323019


DEVELOPER: _____ CONT.
 SUBMITTED: _____
 APPROVED: _____

MAP No. _____ BUDGET PROJ. 33
 100% SUBMITTAL PROJECT NO. 19-4004 DATE: 7/23/2020
 DRAWN: CT DESIGN: MP CHECK: KWC SHEET NO.: 11 OF 27

7/23/2020 10:31:08 AM c:\projects\19-098V-DEM\Drawings\19-098V-DEM\San_Marcos.dgn
 V:\19-098V-DEM\Drawings\19-098V-DEM\San_Marcos.dgn

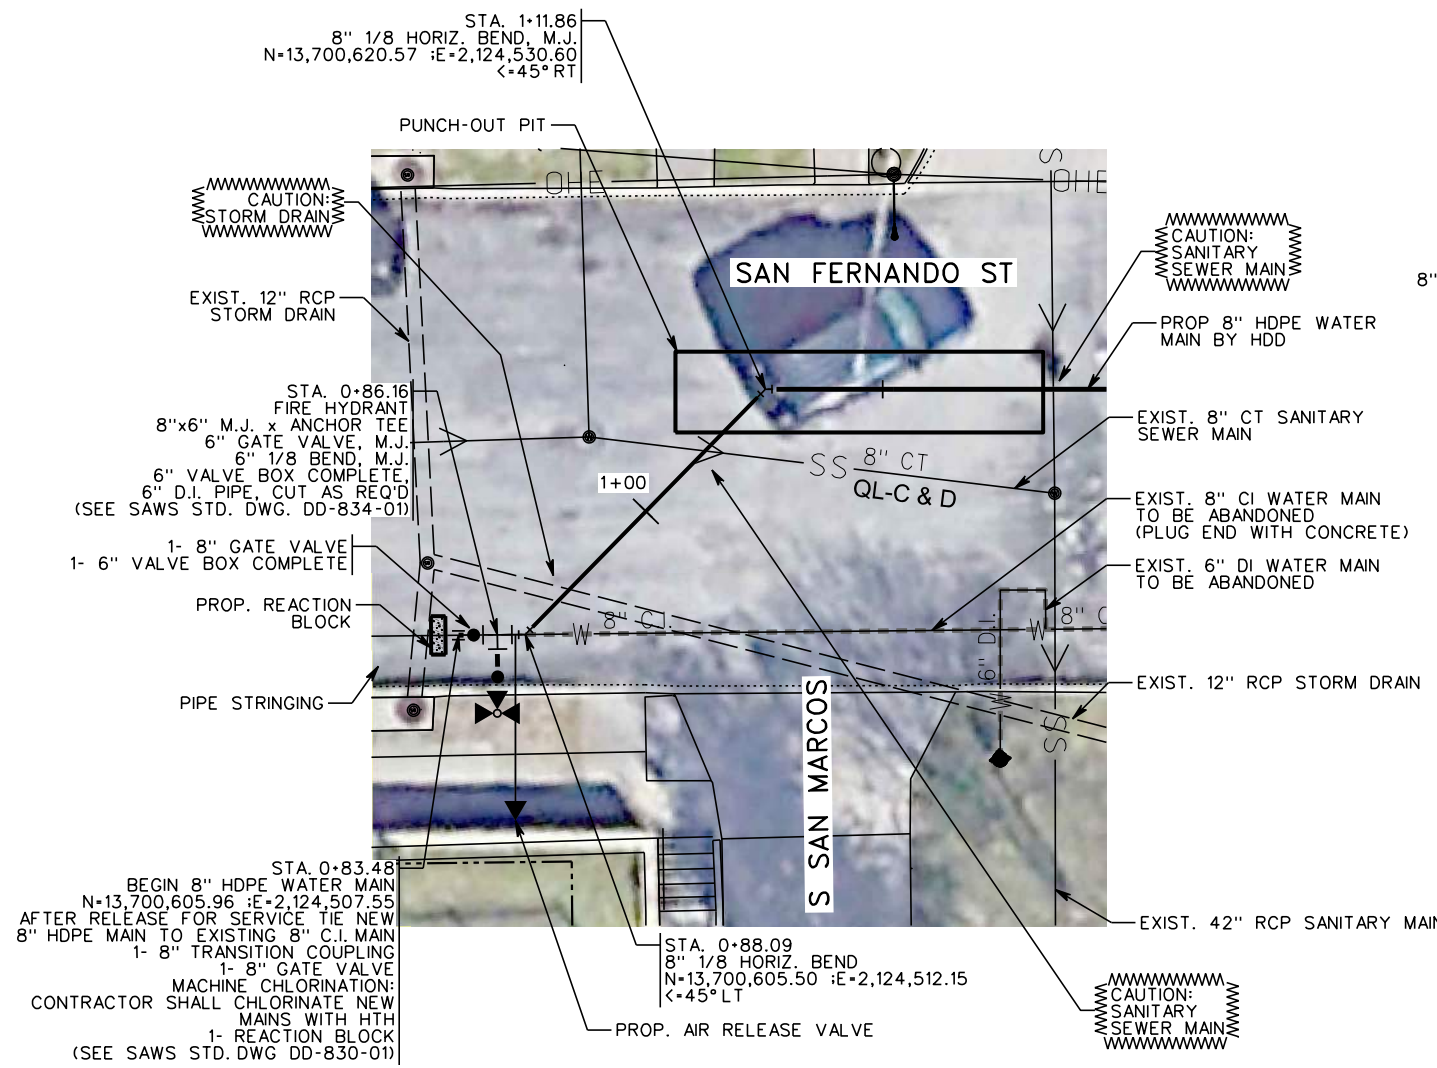

SAN FERNANDO ST - DETAIL 1
N.T.S.

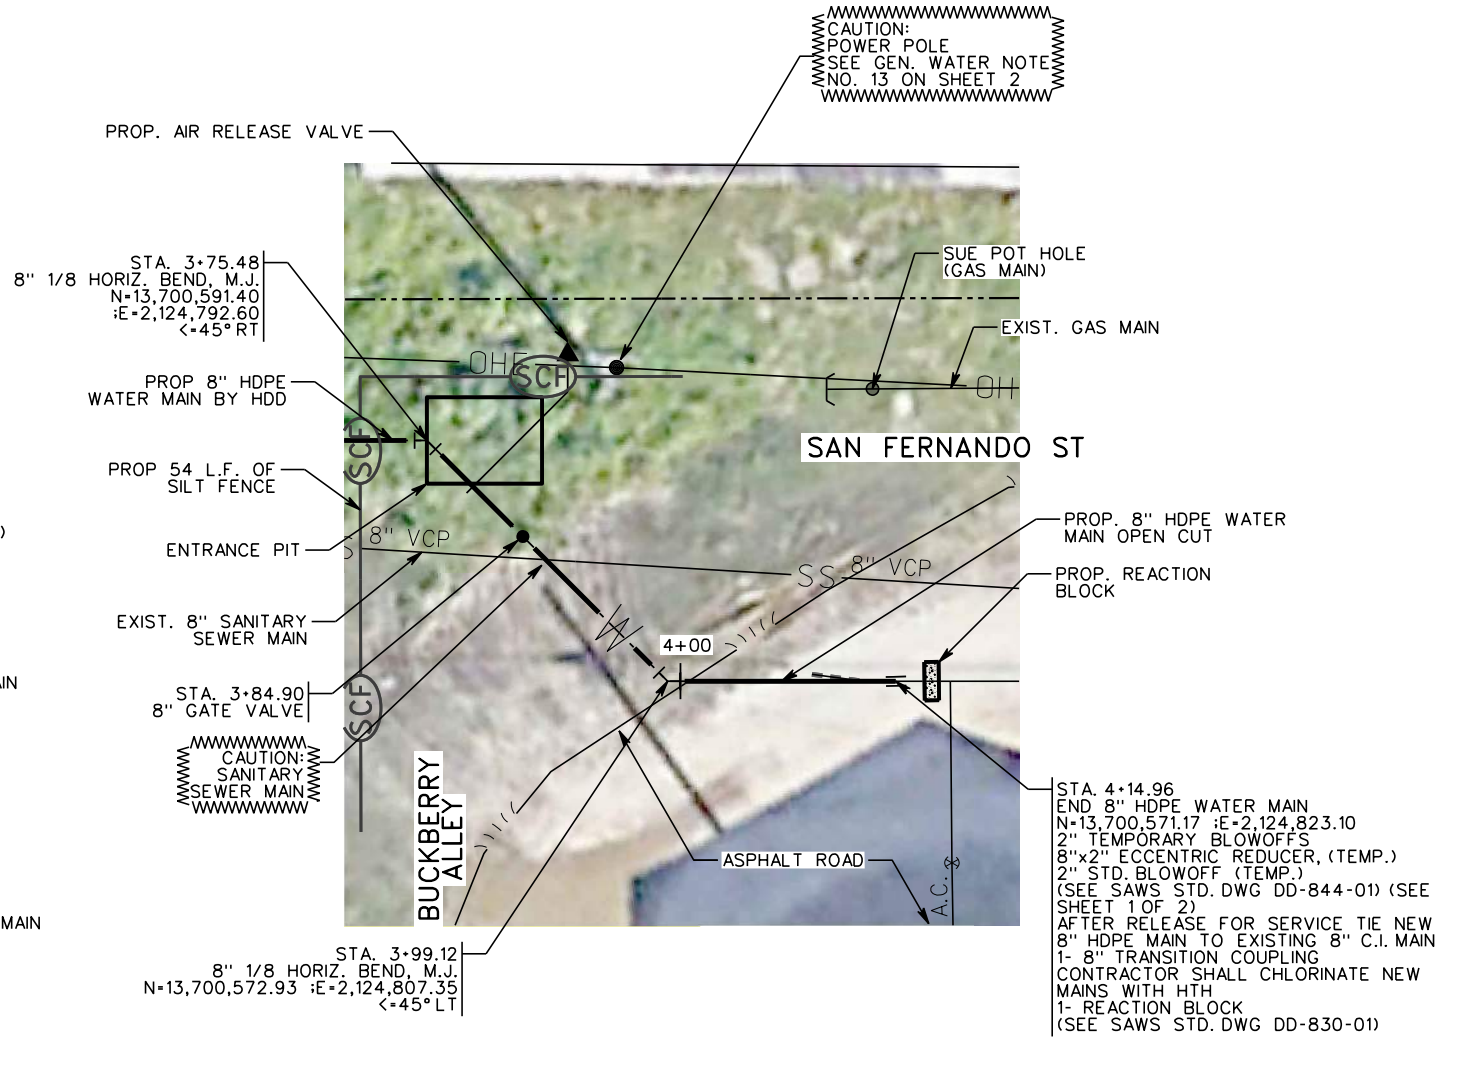

SAN FERNANDO ST - DETAIL 2
N.T.S.

ESTIMATED QUANTITIES

ITEM ID	ITEM No.	DESCRIPTION	UNIT	QUANTITIES
1	103.3	REMOVE CONCRETE SIDEWALKS & DRIVEWAYS	SF	30
3	205.2	HOT MIX ASPHALTIC PAVEMENT, TYPE B (10" COMP. DEPT)	SY	23
4	205.4	HOT MIX ASPHALTIC PAVEMENT, TYPE D (2" COMP. DEPTH)	SY	214
5	208.1	SALVAGING, HAULING & STOCKPILING RECLAIMABLE ASPH	SY	214
8	502.1	CONCRETE SIDEWALKS	SY	56
12	515.1	TOPSOIL	CY	8
14	520.1	HYDROMULCHING (RESIDENTIAL OR COMMERCIAL)	SY	67
19	540.9	TEMPORART SEDIMENT CONTROL FENCE	LF	96
20	550.0	TRENCH EXCAVATION SAFETY PROTECTION	LF	68
23	815.0	8" HDPE WATERLINE (OPEN CUT) (DR11) (200 PSI)	LF	68
29	828.0	8" GATE VALVES	EA.	1
33	834.1	FIRE HYDRANT	EA.	1
34	836.0	PIPE FITTINGS, ALL SIZES AND TYPES	TON	0.50
37	840.0	8" WATER TIE-INS	EA.	2
39	841.0	HYDROSTATIC TESTING	EA.	1
40	844.0	2" BLOWOFF, TEMPORARY	EA.	2
41	846.0	1" COMBINATION AIR AND VACUUM RELEASE VALVE	EA.	2
46	3010.0	8" HDPE WATERLINE (HDD) (DR11) (200 PSI)	LF	264



LEGEND

- PROP. WATER MAIN
- EXIST. WATER MAIN
- GAS MAIN
- SANITARY SEWER
- STORM SEWER
- UTILITY POLE LINE
- ELECTRIC CABLE
- TELEPHONE CABLE
- DUAL BRANCH SERV.
- NEW UNMETERED SERVICE:
- 3/4" SINGLE
- 1" DUAL
- SERVICE RECONNECT:
- 3/4"
- 1" OR LARGER
- SERVICE RELAY:
- 3/4"
- 1" OR LARGER
- SERVICE RELOCATE:
- 3/4"
- 1" OR LARGER
- RELOCATE METER
- NEW SERVICE:
- 3/4"
- 1" OR LARGER

UNINTECH CONSULTING ENGINEERS, INC.
2431 E. Evans Road, San Antonio, Texas 78259
Phone: (210) 641-6003

2019 DEAD END WATER MAIN ELIMINATION PROJECT
SAWS WATER WORK
SAN FERNANDO ST
PLAN DETAILS
UNIT ID# 323019

DEVELOPER: _____ CONT. _____

SUBMITTED: _____

APPROVED: _____

MAP No. _____ BUDGET PROJ. 33

100% SUBMITTAL PROJECT NO. 19-4004 DATE: 7/23/2020

DRAWN: CT DESIGN: MP CHECK: KWC SHEET NO. : 12 OF 27

7/23/2020 10:35:58 AM V:\19-098V-DEM Projects\2Design Phase\Drawings\Util-Water\19-098V-w-06_San_Marcos_P2.dgn