



**2022 Water Distribution Civil Support Work Order Contract
Solicitation Number: CO-00498**

**ADDENDUM 1
12/28/2021**

To Bidder of Record:

This addendum, applicable to work referenced above, is an amendment to the specifications and as such will be a part of and included in the Contract Documents.

Acknowledge receipt of this addendum by entering the addendum number and issue date on the space provided in submitted copies of the bid proposal.

CHANGES TO THE SOLICITATION

1. PDF Pages 142 and 143: Attachment A Tapping Detail.

Replace the referenced pages with the attached documents.


All other items shall remain unchanged.

END OF ADDENDUM

This Addendum is three (3) pages with attachments in its entirety.




Marvin E. Jones Digitally signed
by Marvin E.
Jones
Date:
2021.12.28
08:07:51 -06'00'

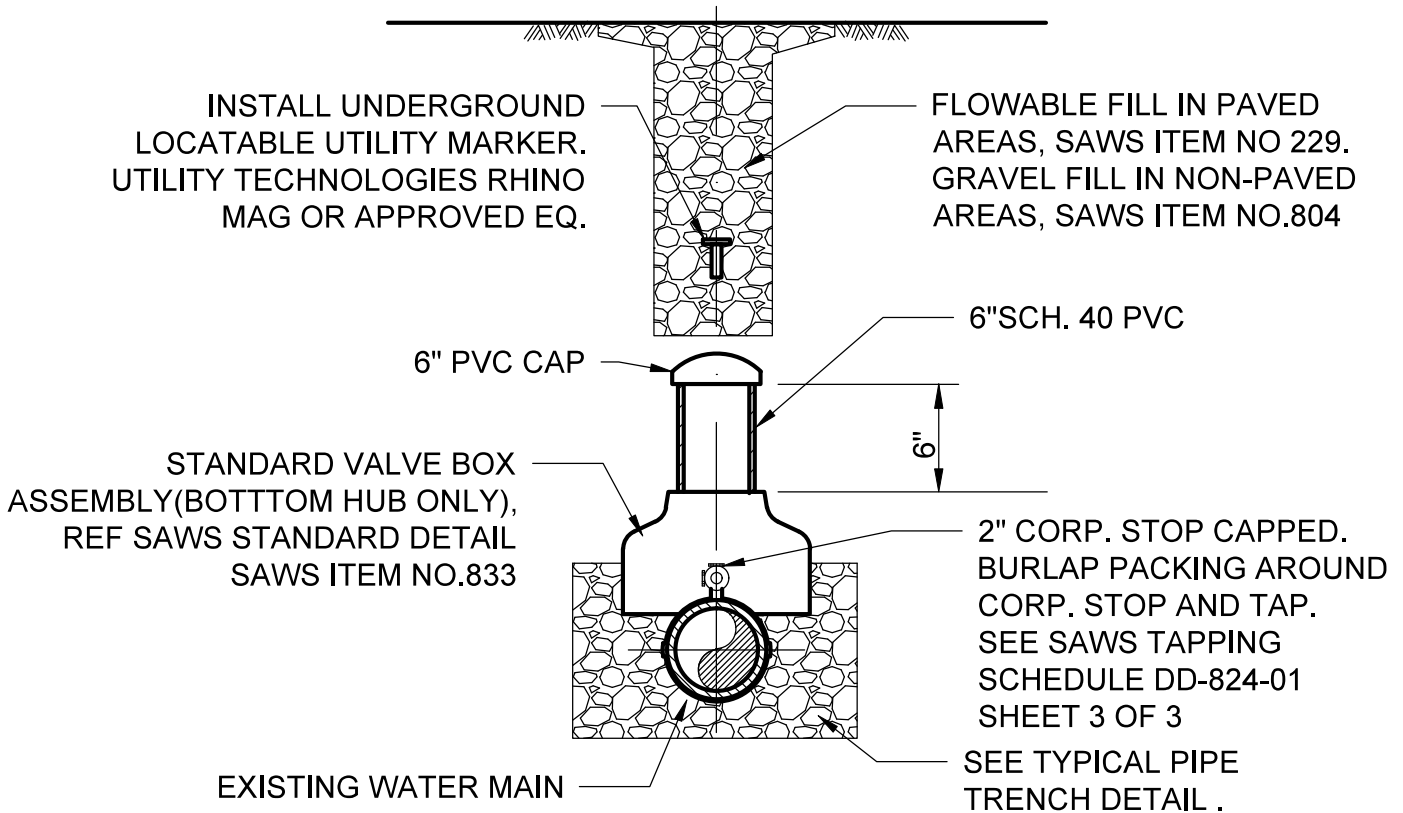

NOTES:

1. METHOD OF CONNECTION TO EXISTING WATER MAIN TO BE COMPLETED BY UTILIZING TAPPING SLEEVE (JCM OR EQUAL) AS DESIGNED BY CONTRACTOR AND SUBMITTED FOR APPROVAL, IN ACCORDANCE WITH SAWS MATERIAL SPECIFICATION NO. 100-35. .
2. FINAL CONFIGURATION OF ALL COMPONENTS SHALL BE SUBMITTED FOR APPROVAL.
3. IF ACTUAL CONDITIONS DIFFER FROM THE DESIGN ASSUMPTIONS PROVIDED HEREIN, CONTRACTOR TO PREPARE REVISED DESIGN TO BE SIGNED AND SEALED BY TX PE.

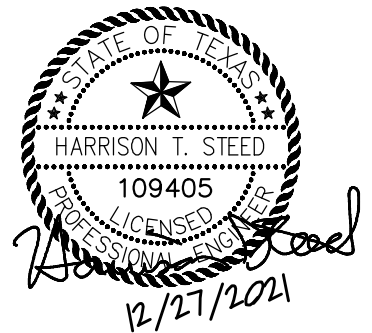


FOR CONDITION ASSESSMENT - ONLY

PROPERTY OF SAN ANTONIO WATER SYSTEM SAN ANTONIO, TEXAS	WATER DISTRIBUTION PIPELINE 2" CORPORATION STOP ASSESS DETAIL	SCALE: N.T.S.	DESIGN
			12/23/2021
		#### WATER DISTRIBUTION CIVIL SUPPORT WORK ORDER CONTRACT	SHEET 1 OF 1


TOP SLAB 12' DIA. TRAFFIC RATED
CONCRETE MAMHOLE SUPPORT.
STEEL REINFORCED WITH #5 @
12" O.C.

MANHOLE RING AND COVER
SAWS ITEM NO. 852 30" CLEAR
OPENING

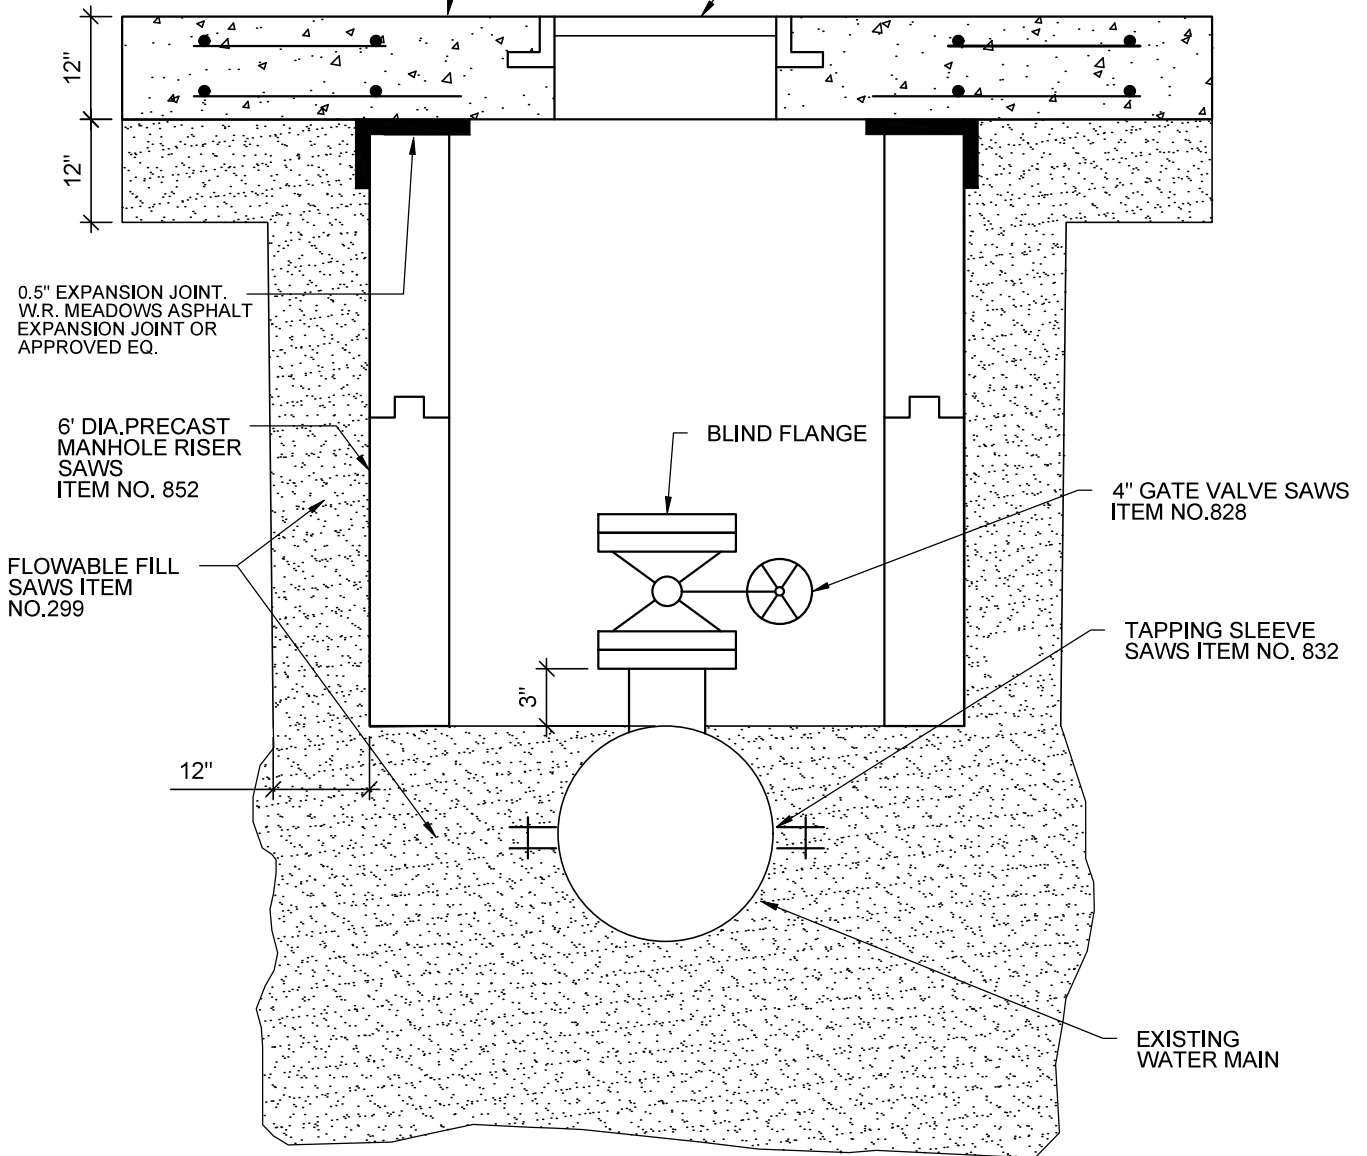

NOTES:

1. METHOD OF CONNECTION TO EXISTING WATER MAIN TO BE COMPLETED BY UTILIZING TAPPING SLEEVE (JCM OR EQUAL) AS DESIGNED BY CONTRACTOR AND SUBMITTED. FOR APPROVAL, IN ACCORDANCE WITH SAWS MATERIAL SPECIFICATION NO. 100-35.
2. CONCRETE WORK IN ACCORDANCE WITH SAWS ITEM NO. 307
3. CUT BOTTOM RISER ON EITHER END UP A FEW INCHES ABOVE THE PIPE DIAMETER, SUFFICIENT TO NOT BEAR ON THE FLOWABLE FILL. FILL GAP WITH NON-LOADING BEARING FROM MATERIAL.

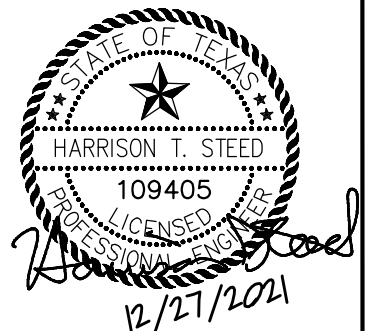

FOR CONDITION ASSESSMENT - ONLY

PROPERTY OF SAN ANTONIO WATER SYSTEM SAN ANTONIO, TEXAS	4" TEST VALVE ACCESS MANHOLE FOR PAVED INSTALLATIONS	SCALE: N.T.S.	DESIGN
			12/23/2021
		WATER DISTRIBUTION CIVIL SUPPORT WORK ORDER CONTRACT	SHEET 1 OF 1