

Specht Road CIP 16" Water Main – Phase 1 Improvements Solicitation Number: CO-00522 Job No.: 20-1082

ADDENDUM 1 February 9, 2021

To Bidder of Record:

This addendum, applicable to work referenced above, is an amendment to the bid proposal, plans and specifications and as such will be a part of and included in the Contract Documents. Acknowledge receipt of this addendum by entering the Addendum number and issue date on the space provided in submitted copies of the bid proposal.

QUESTIONS

1. Question: Is there a Geotech report available?

Response: There is not a Geotech report available. Pavement replacement sections are identified in the details on the plan set.

2. Question: Will the appropriate bid item be added for barricading and traffic control?

Response: Line item 21 has been added to the attached, revised Bid Form for traffic control. This line item shall include barricades.

3. Question: Due to the volume of work involved and the current problem with material delivery, will SAWS increase the number of days to 210 calendar days?

Response: The number of calendar work days for the project has been increased to 180. Please see revised Bid Proposal Certification Page included with this addendum.

4. Question: Will all payments be paid by SAWS or the Developer?

Response: All payments to the contractor will be made by SAWS.

5. Question: Is a TxDOT permit required for this work? If yes, can it become part of the bid package so the contractor will be aware of their requirements prior to submitting a bid?

Response: A TxDOT permit is not required as Blanco Rd., Specht Rd., Old Blanco Rd. and Borgfeld Rd. are all Bexar County roads.

6. Question: Will a bid item be added for topsoil?

Response: Line item 20, Revegetation, shall include topsoil.

7. Question: Will bid item 23 be increased to 10% which is SAWS' normal percentage for mobilization?

Response: Line item 24 (formerly item 23), Mobilization, has been increased to a maximum of 10%.

8. Question: Will all water required for testing, flushing, and watering hydro mulch be furnished at no charge to the contractor?

Response: Yes, a meter for temporary water for construction purposes will need to be obtained but the contractor will not be charged for the water used as part of the construction.

9. Question: Will a bid item be added for silt fencing and rock berms?

Response: Line item 22, SWPPP, shall include any silt fencing and rock berm.

SAN ANTONIO WATER SYSTEM 1 of 22

- 10. Question: Our supplier has told us 32" steel casing is not made. Will SAWS accept 30" or 36" in lieu of 32"? Response: 30" casing is acceptable. Line item 6, 30" Split Steel Casing (Open Cut Installation), has been updated to reflect this size.
- 11. Question: Since there is a lot of rock in this area and rock trenching will be required, we do not feel there is enough days to complete this project. Can you please change the calendar days to 160 or let us know how you came out with only 120 contract days?

Response: The number of calendar work days for the project has been increased to 180. Please see revised Bid Proposal Certification Page included with this addendum.

12. Question: Bid quantities for steel casing do not match plan quantities.

Response: The quantity for Line item 6, 30" Split Steel Casing (Open Cut Installation), has been revised to match the quantity on the plans.

13. Question: May 16" PC250 ductile iron pipe be considered as an equal to the 16" DR18 235 psi PVC pie? If allowed will zinc coatings be required on ductile iron pipe?

Response: This pipe is an allowable alternate material.

- 14. Question: May 16" DR11 HDPE DIPS 200 psi pipe be considered as an equal to the 16" DR18 235 psi PVC pipe? Response: This pipe is an allowable alternate material.
- 15. Question: Will pipe be required to be restrained? If so, please provide a restraint chart for both 16" DR18 C905 235 psi PVC pipe and 16" PC250 ductile iron pipe.

Response: Yes, pipes will need to be retrained. Table is provided on sheet C13. Detail DD-839-05.

CHANGES TO THE SPECIFICATIONS

- 1. Remove and replace entire "Bid Proposal" with the attached updated Bid Proposal. A line item has been added for traffic control, line item 6 has been revised, and the project calendar day duration has been revised to 180 days. Bidders shall use the revised bid proposal when submitting a bid for this project. Failure to use the revised version may result in the bid being found non-responsive.
- 2. Remove and replace entire "Proposal Certification" with the attached updated Proposal Certification. The project calendar day duration has been revised to 180 days.

CHANGES TO THE PLANS

- 1. Remove sheets C5, C6, and C10. Replace with new sheets C5, C6, and C10 included with this
- 2. Add sheets C13 through C24, included with this addendum, to the plan set.

END OF ADDENDUM

This Addendum, including these two (2) pages, is twenty two (22) pages with attachments in its entirety.

Attachments: Bid Proposal (3 Pages) Proposal Certification (1 Page)

Sheets C5, C6, C10, and C13 - C24

David Cupit, P.E.

Cude Engineers

Specht Road CIP 16" Water Main – Phase 1 Improvements Solicitation No. :CO-00522

Job No: 20-1082

ВΙ	D	PΕ	₹О	P	Э	S٨	۱L

PF	OPOSAL OF, a corporation
аp	partnership consisting of
an	individual doing business as
Pu as	IE SAN ANTONIO WATER SYSTEM: rsuant to Instructions and Invitation to Bidders, the undersigned proposes to furnish all labor and materials specified and perform the work required for the project as specified, in accordance with the Plans and ecifications for the following prices in the bid proposal to wit:
PL	EASE SEE ATTACHED LIST OF BID ITEMS.
	BIDDER'S SIGNATURE & TITLE
	FIRM'S NAME (TYPE OR PRINT)
	FIRM'S ADDRESS
	FIRM'S PHONE NO. /FAX NO.
	FIRM'S EMAIL ADDRESS
The	Contractor herein acknowledges receipt of the following: Addendum No(s).
OW	NER RESERVES THE RIGHT TO ACCEPT THE OVERALL MOST RESPONSIBLE BID.
and Pro	bidder offers to construct the Project in accordance with the Contract Documents for the contract price, to complete the Project within <u>180</u> calendar days after the start date, as set forth in the Authorization to ceed. The bidder understands and accepts the provisions of the contract Documents relating to idated damages of the project if not completed on time.
Com	plete the additional requirements of the Bid Proposal which are included on the following pages.
Sta	tement on President's Executive Orders
	your firm previously performed work subject to the President's Executive Orders Numbers 11246 and 11375 or any eding similar executive orders (Numbers 10925 and 11114)? Yes No
Tex	as Government Code Chapter 2274 Verifications
(1)	Are you, Contractor, held or controlled by individuals who are citizens of China, Iran, North Korea, Russia or a country designated by the Governor of the State of Texas pursuant to Texas Government Code Chapter 2274? Yes No
(2)	Are you, Contractor, held or controlled by a company or other entity, including a governmental entity, that is owned or controlled by citizens of or directly controlled by the government of China, Iran, North Korea, Russia or a country designated by the Governor of the State of Texas pursuant to Texas Government Code Chapter 2274? Yes \(\bigcap \) No \(\bigcap \)
(3)	Are you, Contractor, headquartered in China, Iran, North Korea, Russia or a country designated by the Governor of the State of Texas pursuant to Texas Government Code Chapter 2274? Yes \(\bigcap \) No \(\bigcap \)

Rev. 091021

		Line Items				
Line No.	Item No.	Item Description	Unit	Quantity	Unit Price	Total
1	828	6" Gate Valve	EA	4		
2	828	12" Gate Valve	EA	3		
3	828	16" Gate Valve	EA	17		
4	812	12" Water Main - C900 Class 235 DR 18	LF	15		
5	812	16" Water Main - C900 Class 235 DR 18	LF	11,650		
6	856	30" Split Steel Casing (Open Cut Installation)	LF	222		
7	858	Concrete Encasement	CY	37		
8	834.1	Fire Hydrant Assembly, Complete	EA	13		
9	844	2" Blowoff, Temporary	EA	1		
10	844	4" Blowoff, Temporary	EA	1		
11	846	2" Air Release Assemblies	EA	2		
12		PRV Vault, Complete	EA	1		
13		Remove and Replace Tree Wall	EA	1		
14	836	Pipe Fittings, All	TN	16.11		
15	841	Hydrostatic Testing	LS	1		
16	505.1	Cut/Replace Sidewalk	SY	25		
17	511		SY	152		
		Cut/Replace Pavement				
18	505.1	Cut/Replace Concrete Riprap	SY LS	46		
19 20	802.2 520.1	Tree Protection Fencing Revegetation	SY	23,712		
21	320.1	Traffic Control	LS	1		
	540	SWPPP	LS			
22	540 550.1	Trench Excavation Safety Protection	LF	1 11,665		
SUBTOTA			LI	11,000		
	,	Mobilization				
24	100	Maximum 10% of line items 1-23	LS	10% Max		
25	100A	Intermediate Mobilization and Demobilization - This item shall include project move-in and move-out of personnel and equipment, for all work including furnishing all labor, materials, tools, equipment, and incidentals required to mobilize, demobilize, bond and insure the Work for the project in accordance with the Contract Documents, complete in place.	EA	2		
20	100A	the Contract Documents, complete in place. Preparation of Right-of-Way - This item shall include preparing the right-of-way for construction operations be removing and disposing all obstructions from the right-of-way and from designated easements where removal of such obstructions is not otherwise povided for in the contract documents.				
26	101	Maximum 5% of line items 1-23	LS	5% Max		


Specht Road CIP 16" Water Main - Phase 1 Improvements Solicitation No. CO-00522 SAWS Job # 20-1082


MOBILIZATION AND PREP OF ROW SHALL BE LIMITED TO THE MAXIMUM PERCENTAGE SHOWN. IF THE PERCENTAGE WRITTEN EXCEEDS THE ALLOWABLE MAXIMUM STATED FOR MOBILIZATION AND OR PREPARATION OF ROW, SAWS RESERVES THE RIGHT TO CAP THE AMOUNT AT THE PERCENTAGES SHOWN AND ADJUST THE EXTENSIONS OF THE BID ITEMS ACCORDINGLY.


TOTAL BID PRICE (TO INCLUDE LINE ITEMS 1-25)		


PROPOSAL CERTIFICATION


C	tified or Cashier's Check payable to the Order of the San dollars (\$	`
which amount represents five percent (5%) of the the proposal is accepted and the bidder fails to ex Contract, in which case the check shall become the as payment for damages due to delay and other is	total bid price. Said bond or check is to be returned to the ecute and file a contract within 10 calendar days after the property of said San Antonio Water System, and shall nonveniences suffered by said San Antonio Water System Antonio Water System reserves the right to reject an	he award of the ll be considered stem due to the
and award of the contract to the undersigned by the System Contract Documents and make Performation calendar days after the award of the Contract to set to insure and guarantee the work until final contract to set.	oposal within <u>60</u> calendar days after the bid opening. Uthe Owner, the undersigned shall execute standard Sannce and Payment Bonds for the full amount of the conecure proper compliance with the terms and provisions in mpletion and acceptance, and the guarantee period stierformed and materials furnished in the fulfillment of the	Antonio Water ntract within 10 of the contract pulated, and to
It is anticipated that the Owner will provide wr contract.	itten Authorization to Proceed within 30 days after th	ne award of the
	ace on the date indicated in the SAWS written Authorization to the date provided for in the SAWS and in full within 180 consecutive calendar days.	
	ce with "Wage and Labor Standard Provisions" of this on the of equipment rental rates whether owned or leased during the control of the contr	
	al the undersigned certifies that bidder's practices and n, sex or national origin and that the bidder will affirmates.	
Signed:		
	Company Representative	
	Company Name	
	Address	
Please return bidder's check to:	Company Name	
	Address	

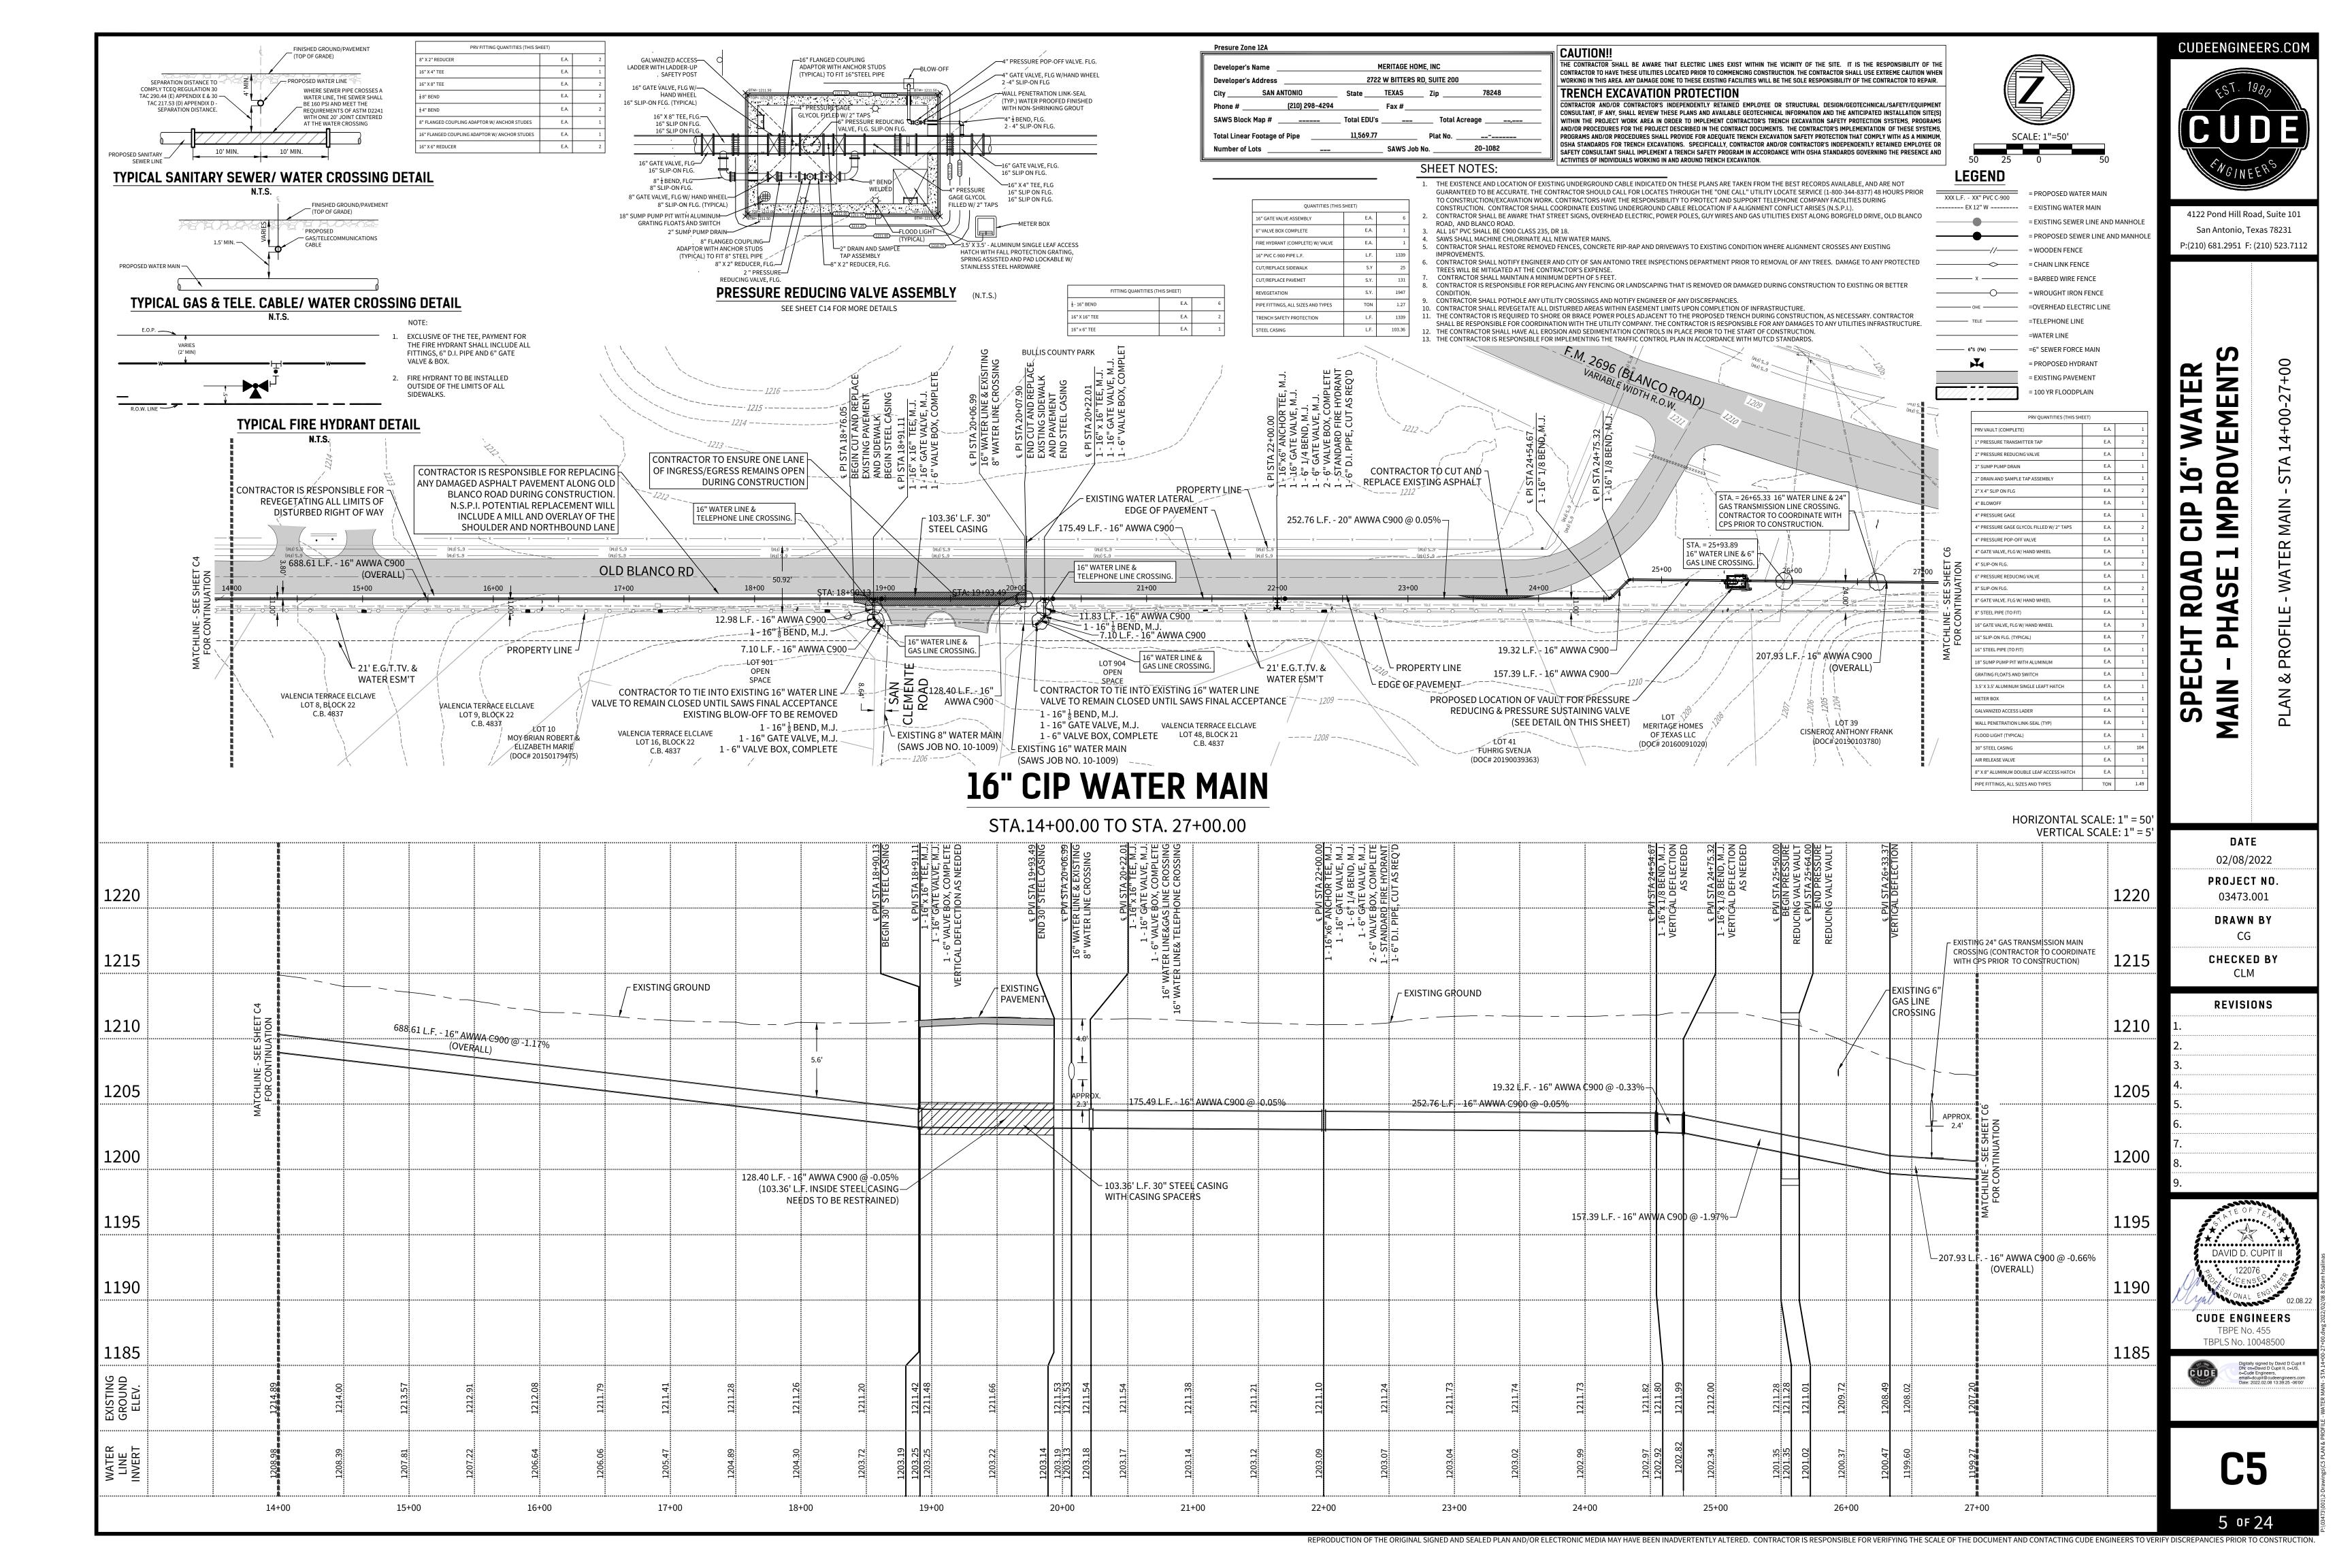


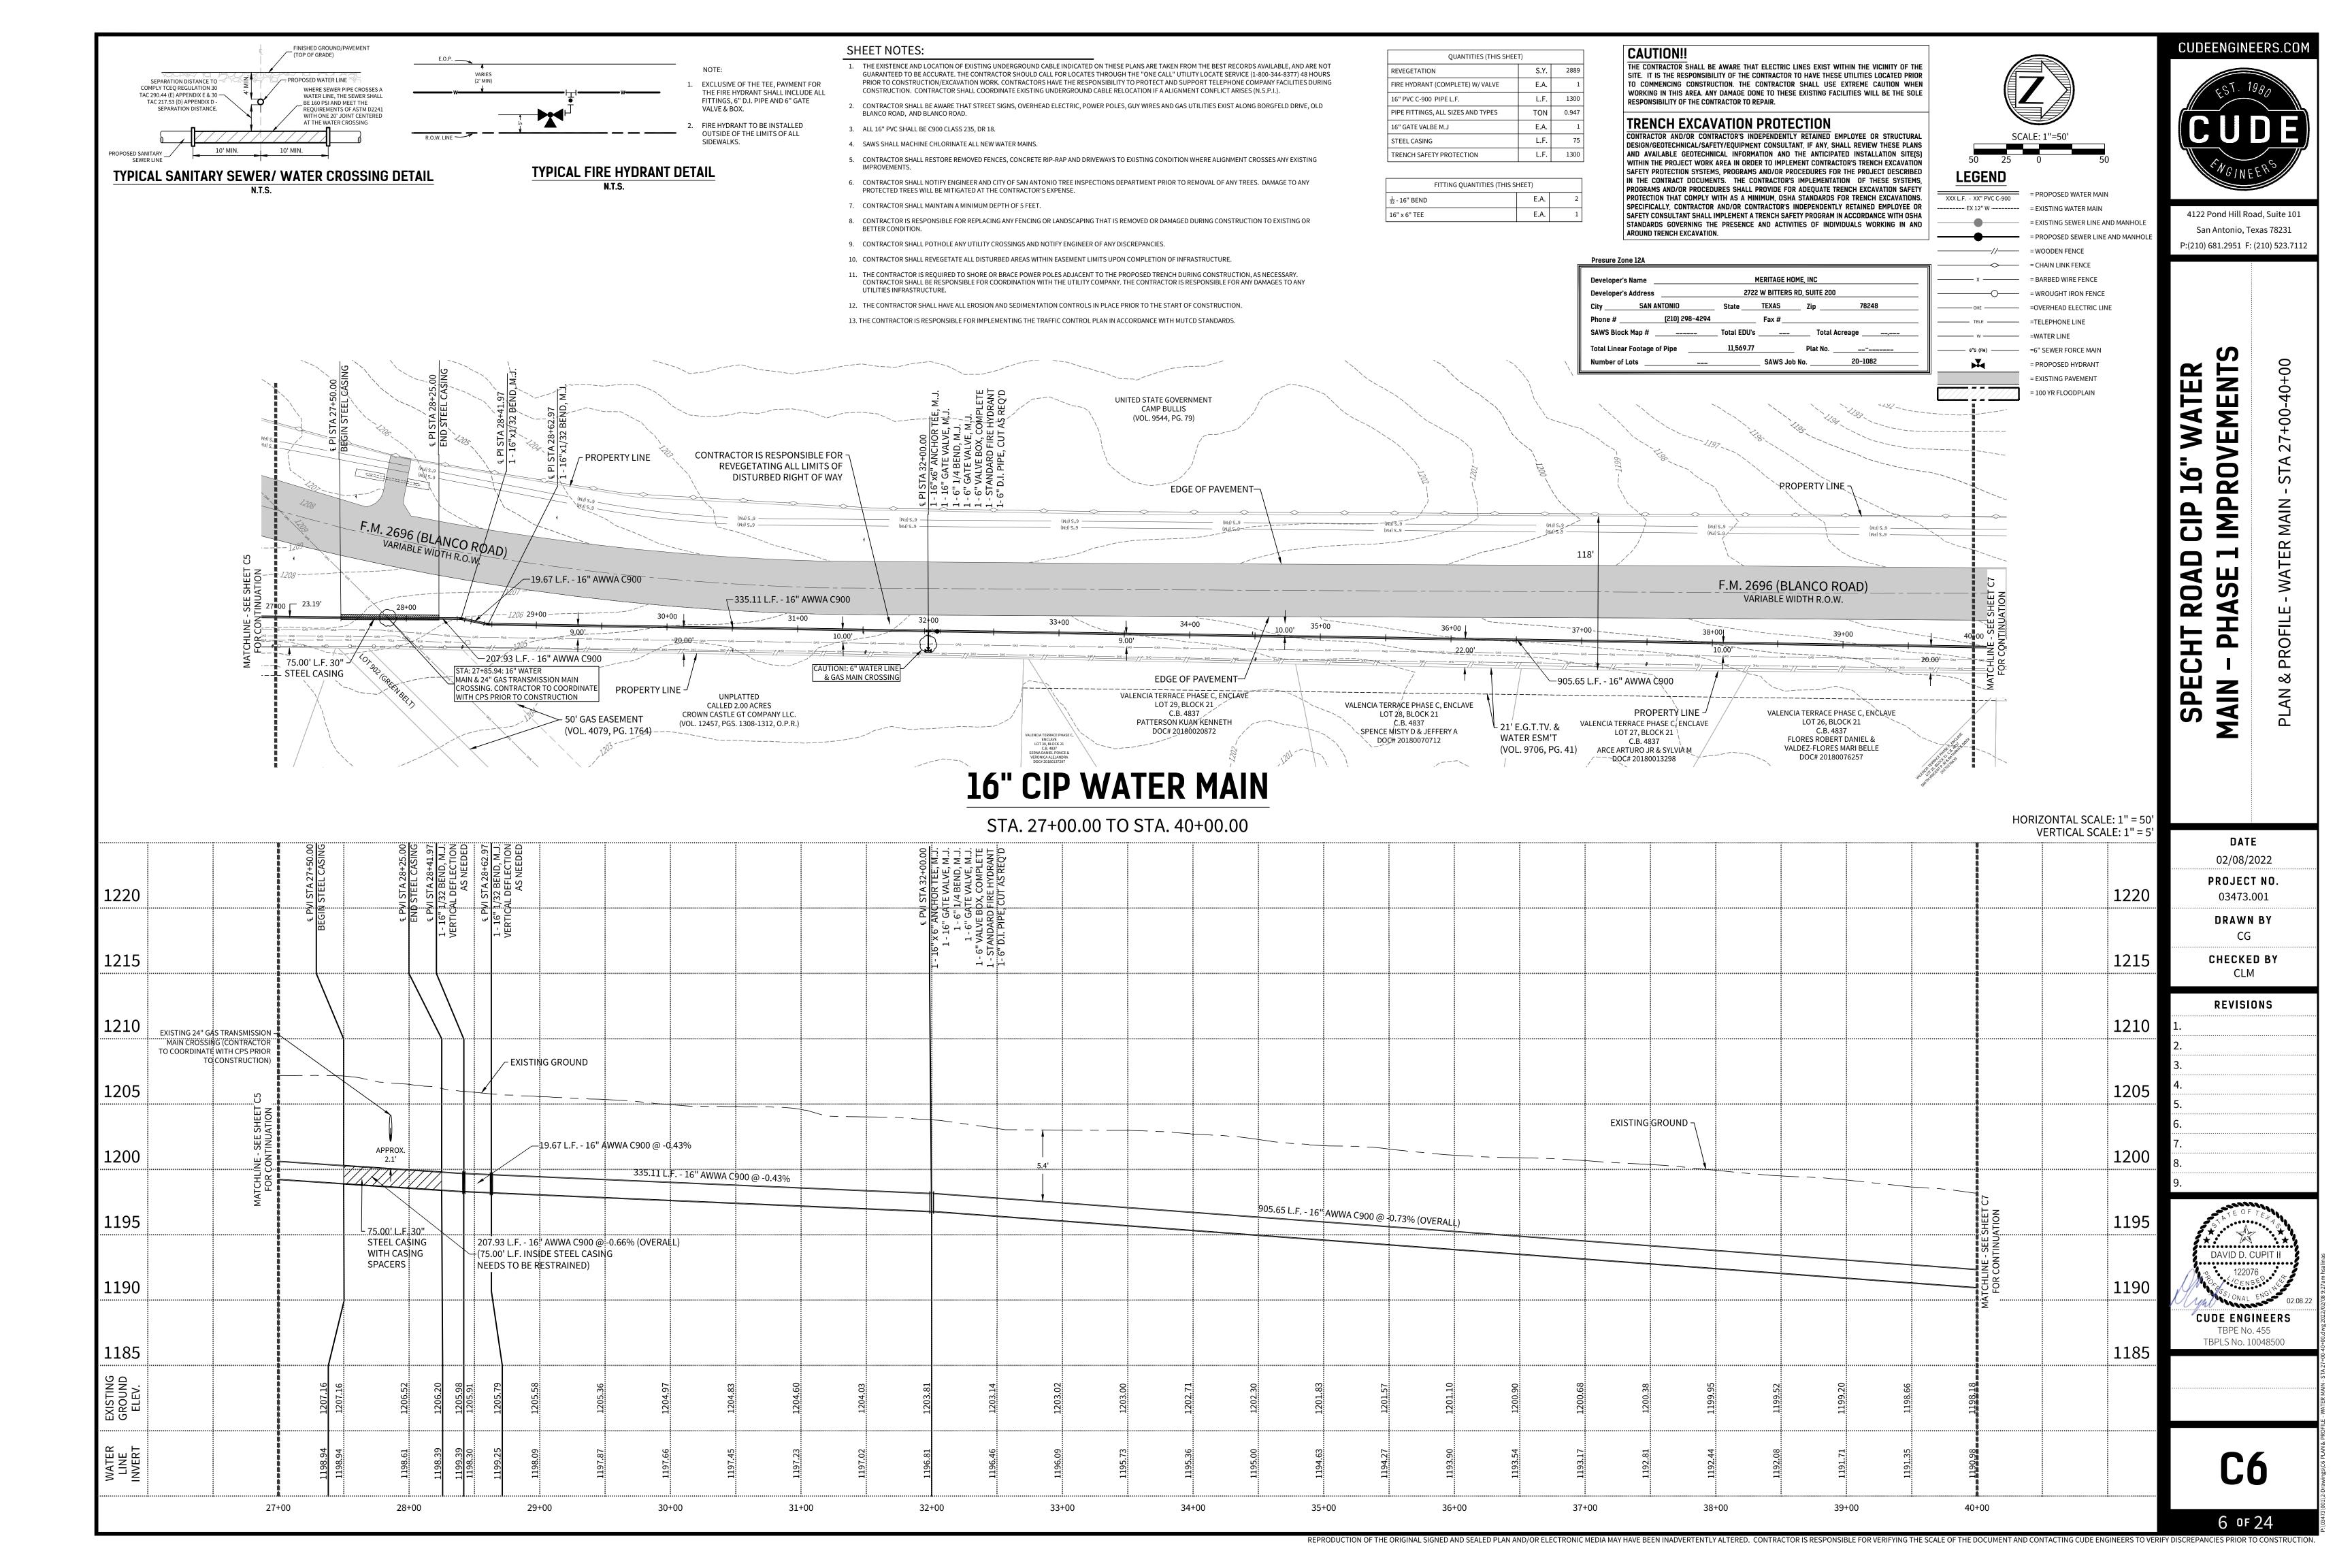


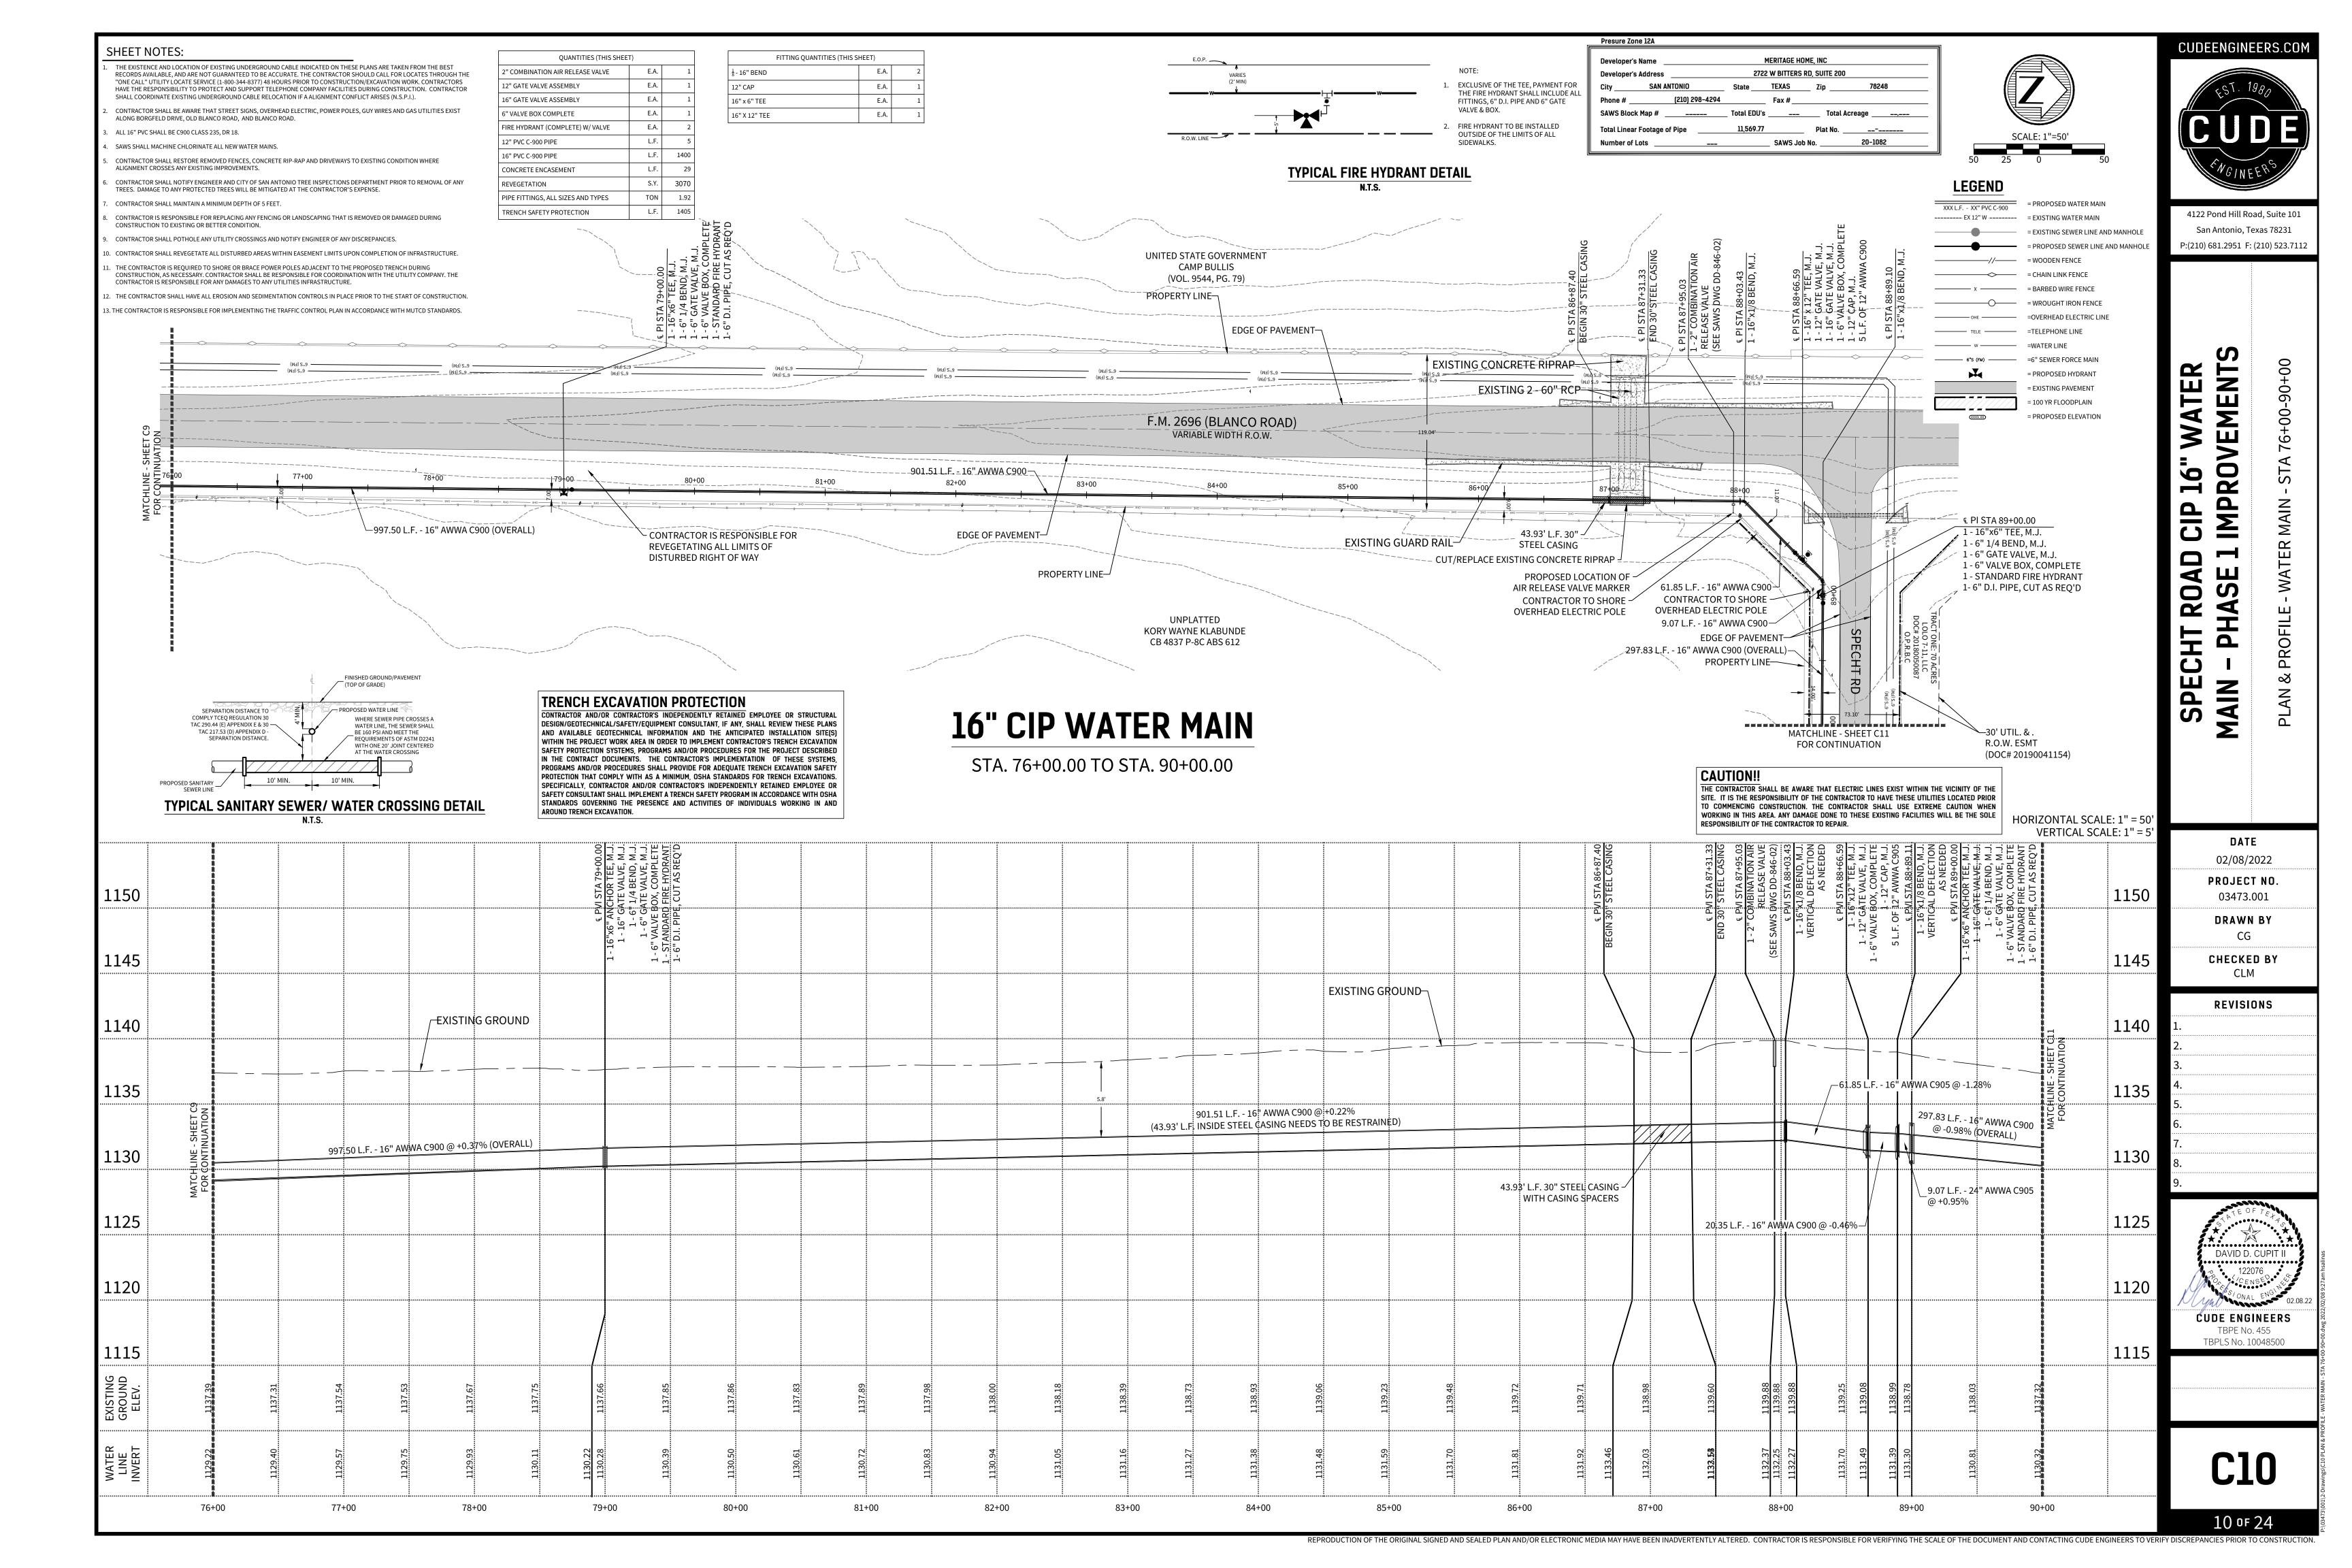


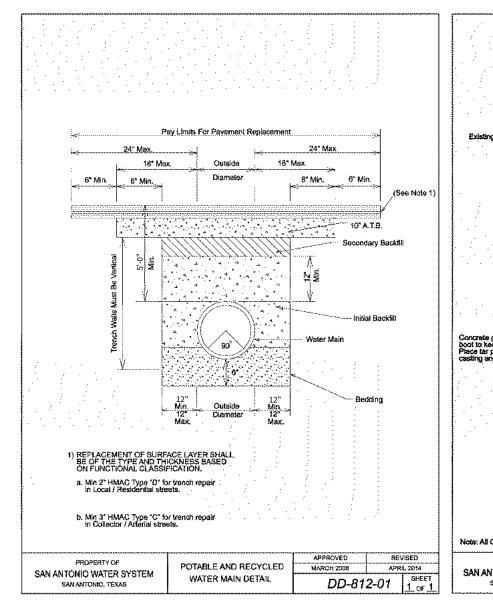


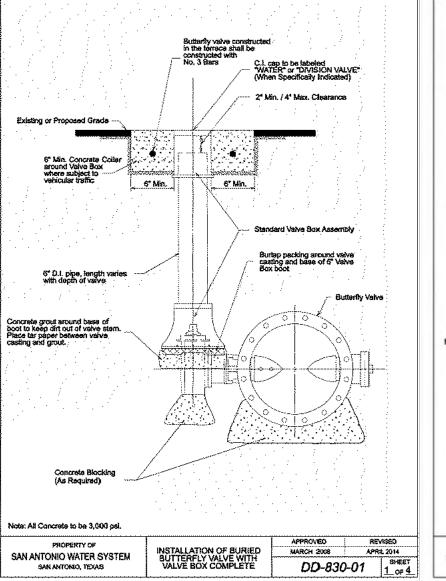


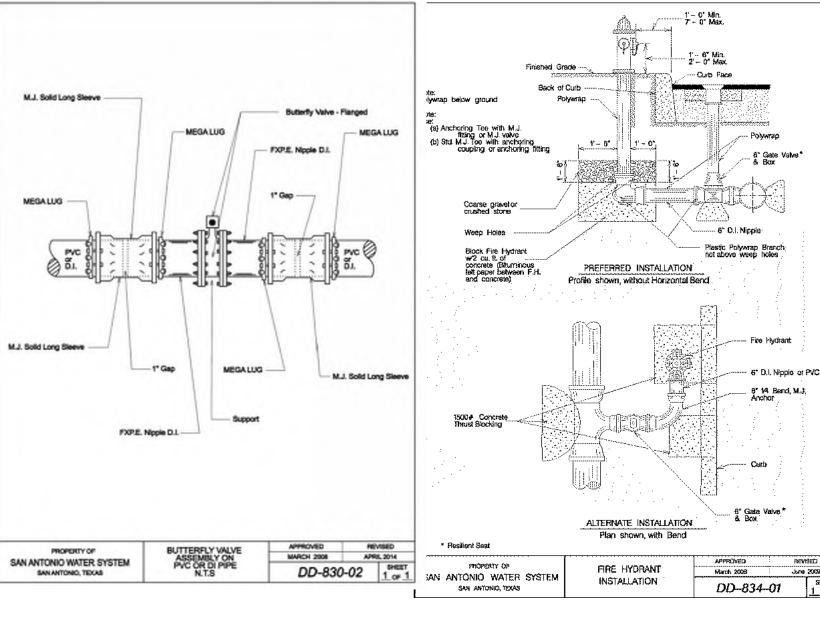


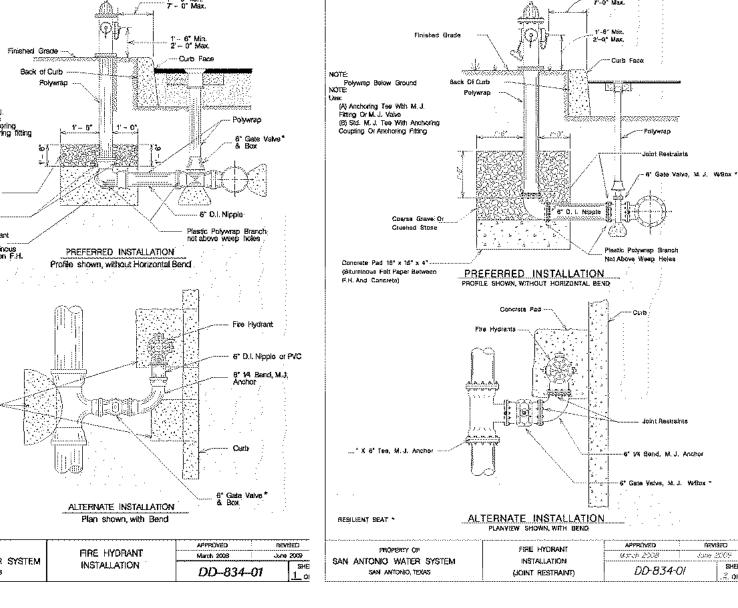


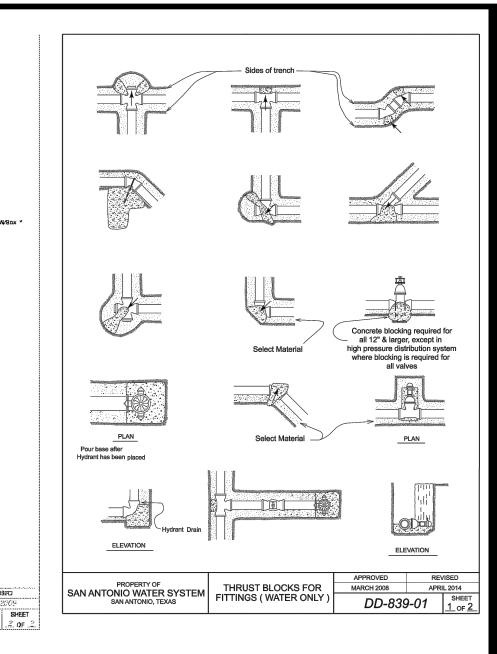


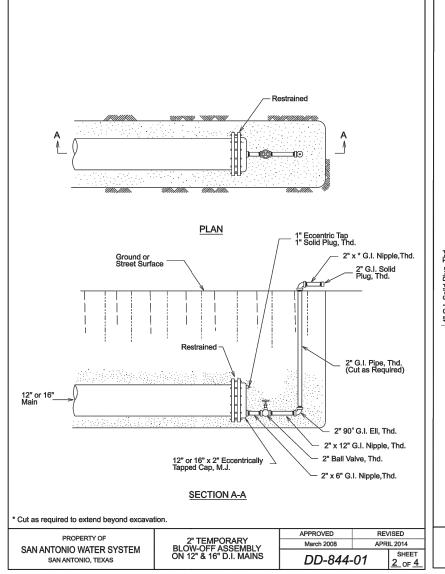


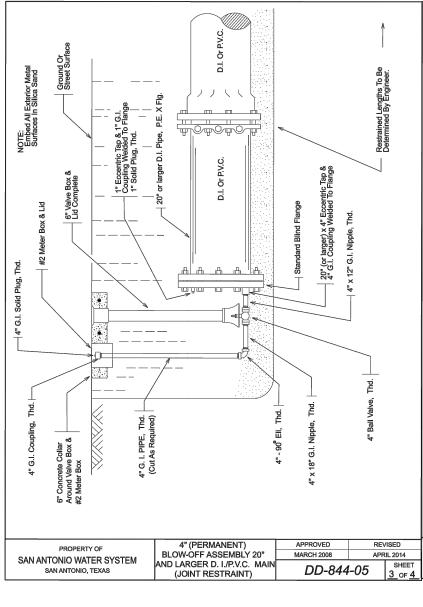


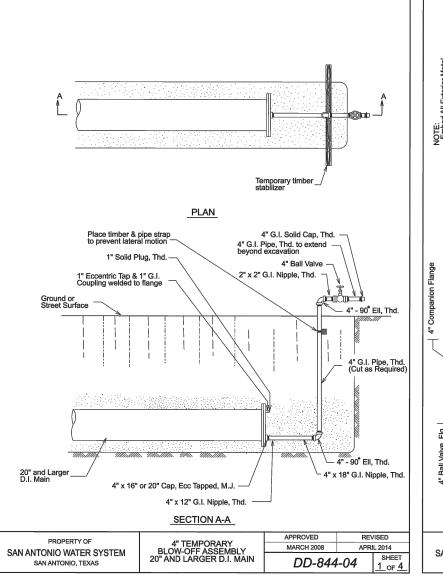


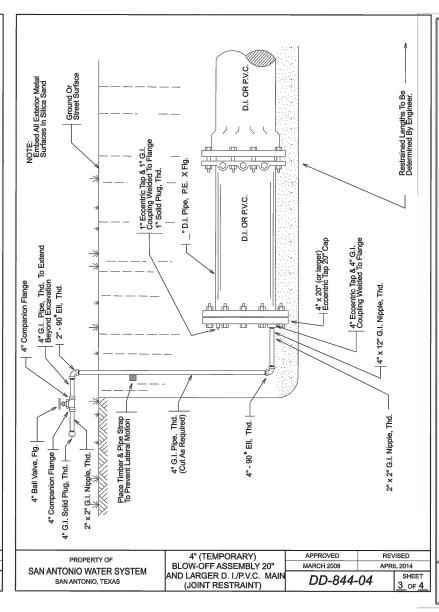


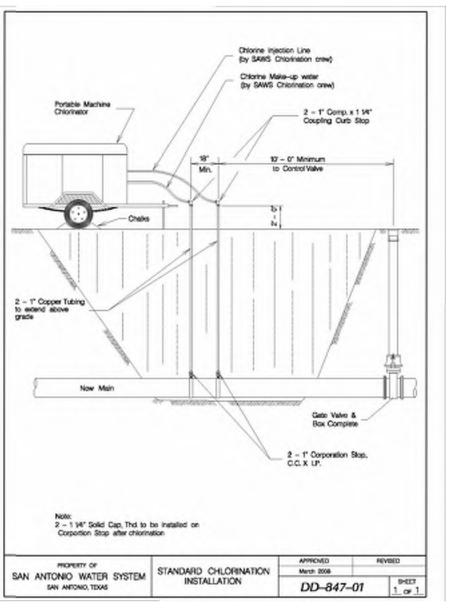


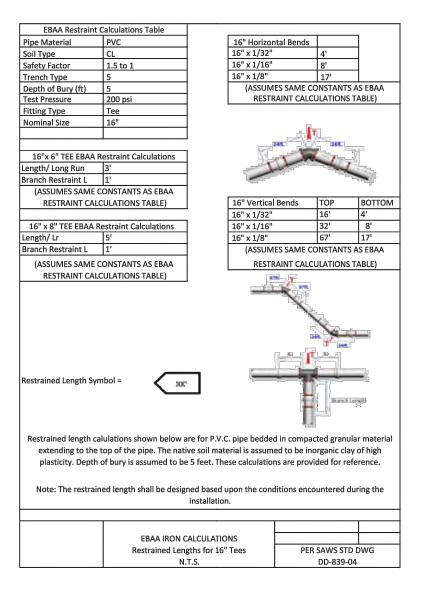


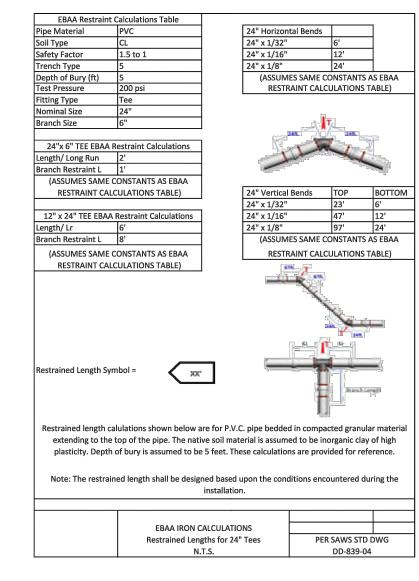


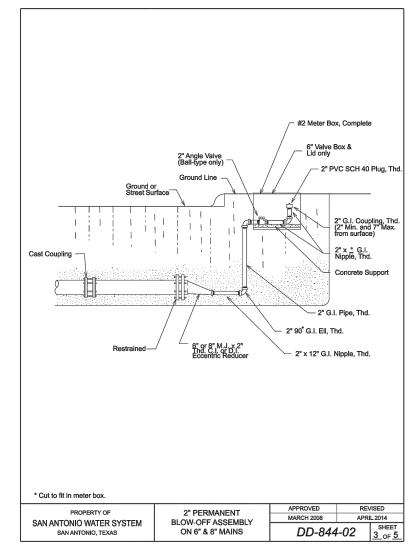


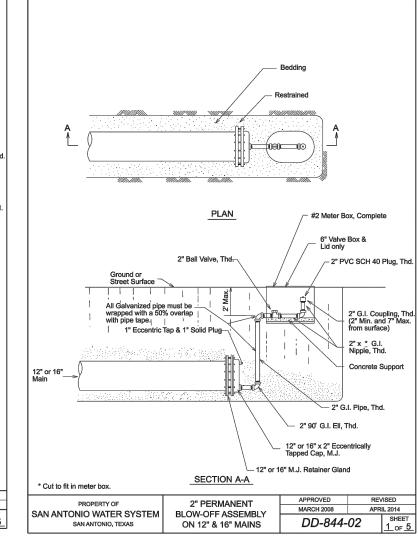

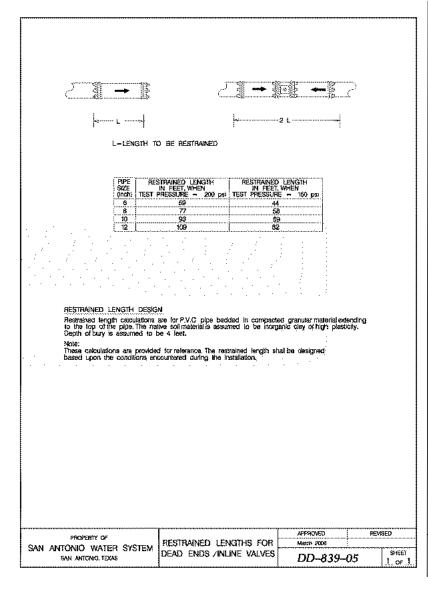

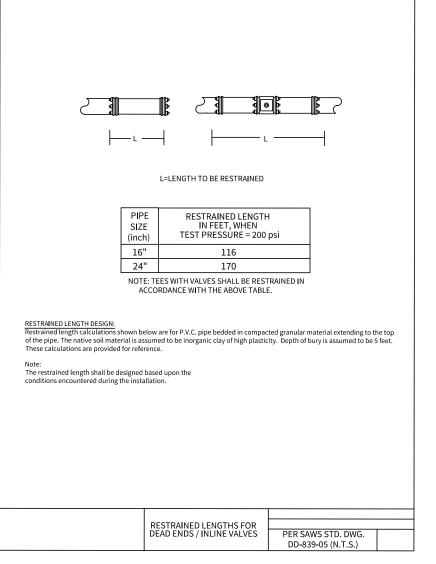

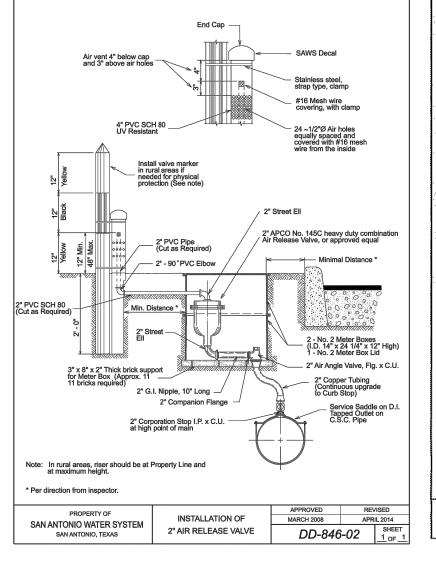

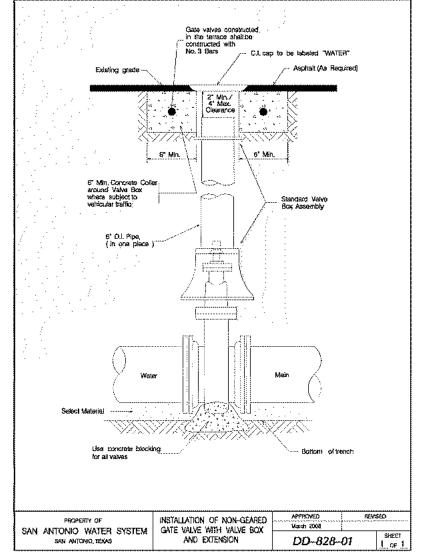


REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.


TRENCH EXCAVATION SAFETY PROTECTION

RESULTS.

CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR STRUCTURAL DESIGN/GEOTECHNICAL/SAFETY/EQUIPMENT CONSULTANT, IF ANY, SHALL REVIEW THESE PLANS AND AVAILABLE GEOTECHNICAL INFORMATION AND THE ANTICIPATED INSTALLATION SITE(S) WITHIN THE PROJECT WORK AREA IN ORDER TO IMPLEMENT CONTRACTOR'S TRENCH EXCAVATION SAFETY PROTECTION SYSTEMS, PROGRAMS AND/OR PROCEDURES FOR THE PROJECT DESCRIBED IN THE CONTRACT DOCUMENTS. THE CONTRACTOR'S IMPLEMENTATION OF THESE SYSTEMS, PROGRAMS AND/OR PROCEDURES SHALL PROVIDE FOR ADEQUATE TRENCH EXCAVATION SAFETY PROTECTION THAT COMPLY WITH AS A MINIMUM, OSHA STANDARDS FOR TRENCH EXCAVATIONS. SPECIFICALLY, CONTRACTOR AND/OR CONTRACTOR'S INDEPENDENTLY RETAINED EMPLOYEE OR SAFETY CONSULTANT SHALL IMPLEMENT A TRENCH SAFETY PROGRAM IN ACCORDANCE WITH OSHA STANDARDS GOVERNING THE PRESENCE AND ACTIVITIES OF INDIVIDUALS WORKING IN AND AROUND TRENCH EXCAVATION. CAUTION NOTE:

THE CONTRACTOR SHALL BE RESPONSIBLE FOR MEETING 98% COMPACTION ON ALL TRENCH BACKFILL AND PAYING FOR THE TESTS TO BE PERFORMED BY A THIRD PARTY. COMPACTION TEST WILL BE DONE AT ONE LOCATION POINT RANDOMLY SELECTED OR AS INDICATED BY THE SAWS INSPECTOR/TEST ADMINISTER, PER EACH 12-INCH LOOSE LIFT PER 400 LINEAR FEET AT A MINIMUM. THIS PROJECT WILL NOT BE ACCEPTED AND FINALIZED BY SAWS WITHOUT THIS REQUIREMENT BEING MET AND VERIFIED BY PROVIDING ALL NECESSARY DOCUMENTED TEST

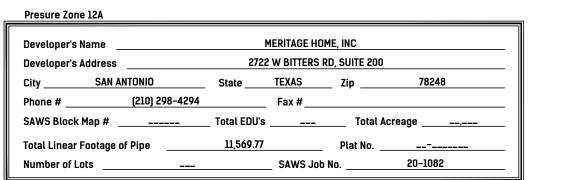



4122 Pond Hill Road, Suite 101 P:(210) 681.2951 F: (210) 523.7112

San Antonio, Texas 78231

TER < 9 2 OA

SPEC

Q

DATE 10/14/2021 PROJECT NO. 03473.001

CG CHECKED BY


DRAWN BY


CLM REVISIONS .. 2020-06-03 - SAWS COMMENTS





_TBPE No. 455 TBPLS No. 10048500


13 of 24

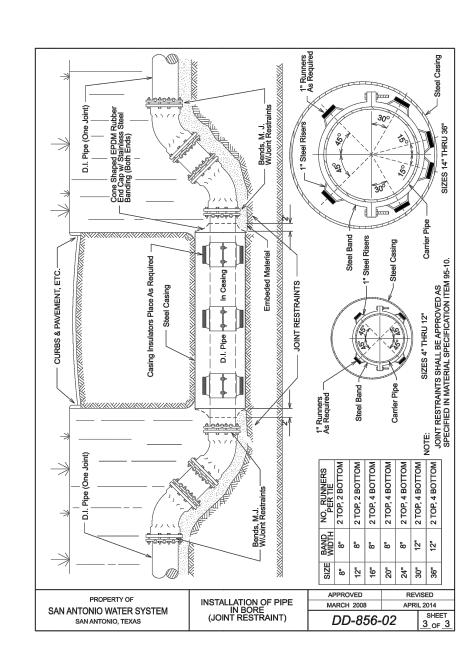


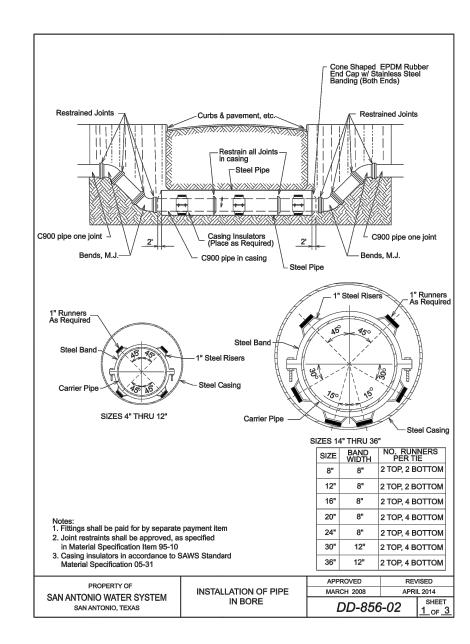

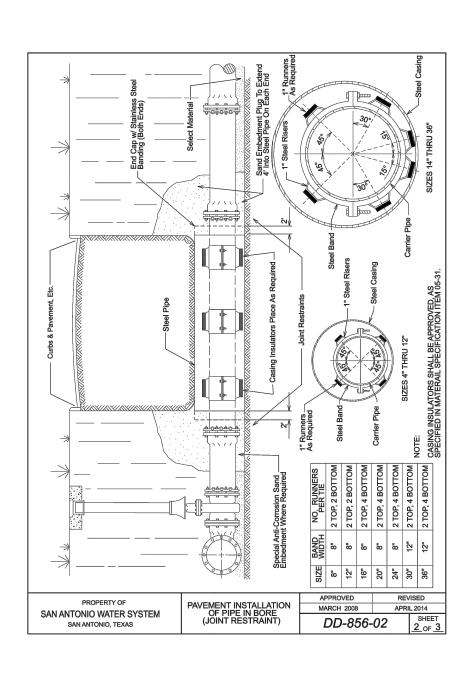


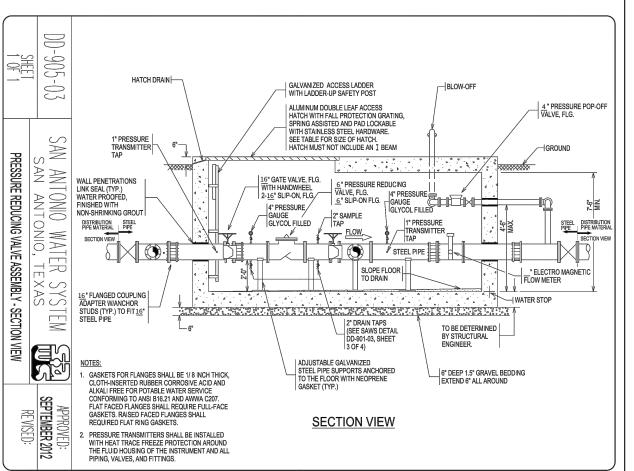


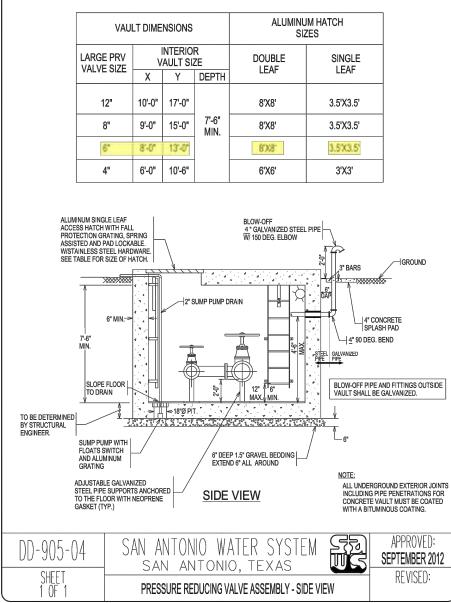

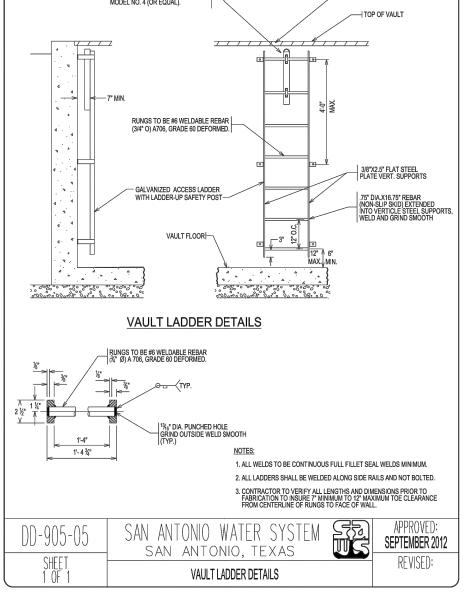


--- PROPOSED HATCH GRATING

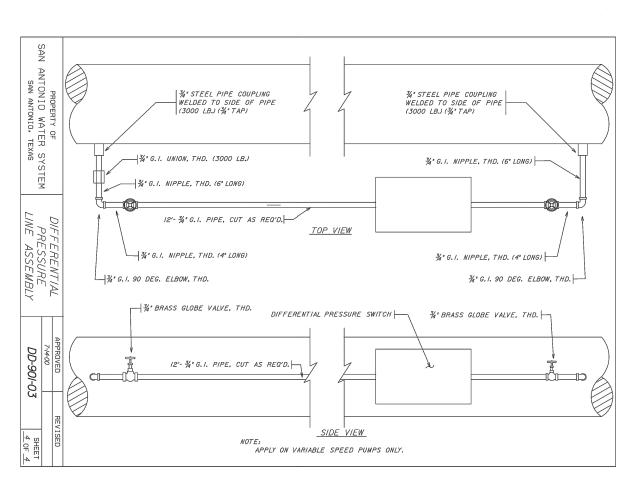

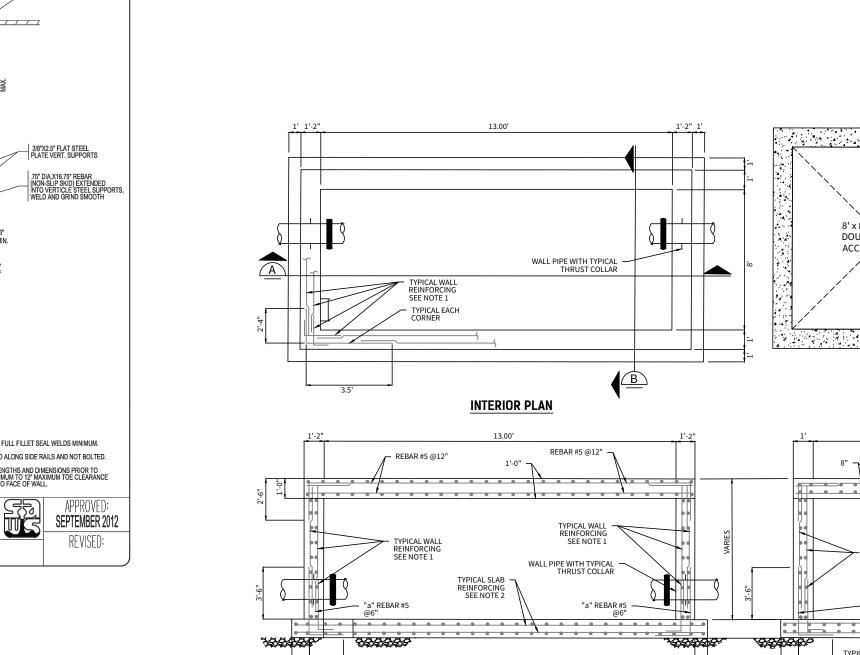

SECTION A

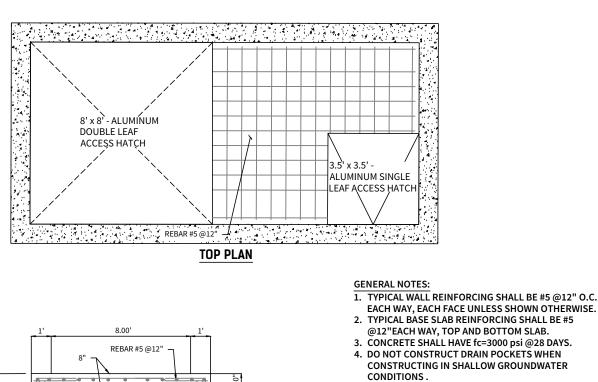

FLOOD LIGHT (TYPICAL)

2" DRAIN AND SAMPLE TAP ASSEMBLY

2" PRESSURE (REFERENCE SAWS PEDUCING VALVE, FLG. (REFERENCE SAWS DETAIL DD-901-03)

WALL REINFORCING NOTES: 1. "a" BAR DESIGNATION REPRESENTS WALL DOWELS PROTRUDING VERTICALLY FROM BASE SLAB ALONG LENGTHWISE DIMENSION "L" OR WIDTH DIMENSION "W". 2. "b" BAR DESIGNATION REPRESENTS ADDITIONAL HORIZONTAL WALL CORNER REINFORCING.

- 4" PRESSURE POP-OFF VALVE, FLG.

- 16" GATE VALVE, FLG. W/ HAND WHEEL 16" SLIP ON FLG. (TYPICAL) - 16"FLANGED COUPLING ADAPTOR

L 8" X 2" REDUCER, FLG.

PRESSURE REDUCING VALUE ASSEMBLY

PLAN VIEW

SECTION B

WITH ANCHORS STUDS (TYPICAL) TO FIT 16" STEEL PIPE

6" MIN. BETWEEN -WALL AND FLANGE

DISTRIBUTION STEE PIPE MATERIAL PIPE

2" SUMP PUMP DRAIN —

8" FLANGED COUPLING
ADAPTOR WITH ANCHORS
STUDS (TYPICAL) TO FIT
8" STEEL PIPE
AIR RELEASE VALVE ON

HIGH SIDE (REFERENCE SAWS DD-901-03)

ALL VALVES INSIDE THE VAULT MUST OPEN LEFT (COUNTERCLOCKWISE)

2. ALL VALVES OUTSIDE THE VAULT MUST OPEN RIGHT (CLOCKWISE)

5. STRUCTURAL VAULT MUST BE DESIGNED BY A PROFESSIONAL ENGINEER REGISTERED IN THE STATE OF TEXAS.

7. PROVIDE FLOOD LIGHTS, SWITCHES AND OUTLETS, THREE (3) MINIMUM. 8. PROVIDE $\frac{1}{4}$ INCH STAINLESS STEEL TUBING FROM TAPS TO ELEVTRICAL CABINET.

6. VAULT MUST BE WATER PROOFED.

4" GATE VALVE, FLG. W/ HAND WHEEL

WALL PENETRATION LINK-SEAL (TYP.) WATER PROOFED FINISHEI WITH NON-SHRINKING GROUT.

4" 4 BEND, FLG 2 - 4" SLIP-ON FLG.

- 16" GATE VALVE, FLG. 16" SLIP ON FLG.

. TYPICAL FOR ALL OPENINGS IN CONCRETE WALLS AND SLABS. 2. DO NOT WELD REINFORCEMENT TO PIPE SLEEVES AND INSERTS.

Developer's Name		M			
Developer's Address	2722 W BITTERS RD, SUITE 200				
City SAN A	NTONIO	State	TEXAS	Zip	78248
Phone #	(210) 298-4294		Fax #		
SAWS Block Map #		_ Total EDU's		Total Ac	reage
Total Linear Footage (of Pipe	11,569.77		Plat No.	

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

CUDEENGINEERS.COM 4122 Pond Hill Road, Suite 101

San Antonio, Texas 78231 P:(210) 681.2951 F: (210) 523.7112

WATER MENT 80 16 CIP ROAD

Q

SPEC

ST

DATE 10/14/2021 PROJECT NO. 03473.001

DRAWN BY CG

CHECKED BY

CLM REVISIONS

.. 2020-06-03 - SAWS COMMENTS



TBPLS No. 10048500

14 of 24

PRV HYDRAULIC CALCULATIONS TOTAL EDUs = 125

RESIDENTIAL FIRE FLOW = 1000 GPM AVERAGE DAILY FLOW = 0.22 GPM PER EDU = 0.22 * 125 = 27.5 GPM PEAK DAILY FLOW = 0.44 GPM PER EDU = 0.44 * 125 = 55.0 GPM PEAK HOURLY FLOW = 1.50 GPM PER EDU = $1.50 \times 125 = \overline{187.5 \text{ GPM}}$

PEAK DAILY FLOW WITH FIRE FLOW = 0.44 GPM PER EDU = (0.44 * 125) + 1000 = 1055.0 GPM PEAK HOURLY FLOW WITH FIRE FLOW = 1.50 GPM PER EDU = $(1.50 * 125) + 1000 = \overline{1187.5 \text{ GPM}}$

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101 San Antonio, Texas 78231 P:(210) 681.2951 F: (210) 523.7112

RO

DATE 10/14/2021 PROJECT NO. 03473.001

> DRAWN BY CG CHECKED BY CLM

REVISIONS . 2020-06-03 - SAWS COMMENTS

TBPB No. 455 TBPLS No. 10048500

15 of 24

SILT FENCE NOTES

ISOMETRIC PLAN VIEW

SECTION DETAIL

1. The rock berm shall be inspected weekly or after each rain and the stone shall be replaced


when the structure ceases to function as intended due to silt accumulation, washout, etc.

2. When silt reaches a depth of 12", the silt shall be removed and disposed of at an approved site.

3 TO 4 INCHES

General Notes

- 1. SILT FENCE MATERIAL SHOULD BE POLYPROPYLENE, POLYETHYLENE OR POLYAMIDE WOVEN OR NONWOVEN FABRIC. THE FABRIC WIDTH SHOULD BE 36 INCHES, WITH A MINIMUM UNIT WEIGHT OF 4.5 OZ/YD, MULLEN BURST STRENGTH EXCEEDING 190 LB/IN 2, ULTRAVIOLET STABILITY SEQUENCE OF ACTIVITY: EXCEEDING 70%, AND MINIMUM APPARENT OPENING SIZE OF U.S. SIEVE NO. 30.
- 2. FENCE POSTS SHOULD BE MADE OF HOT ROLLED STEEL, AT LEAST 4 FEET LONG WITH TEE OR Y-BAR CROSS SECTION, SURFACE PAINTED OR GALVANIZED, MINIMUM NOMINAL WEIGHT 1.25 LB/FT 2 , AND BRINDELL HARDNESS EXCEEDING 140.
- 3. WOVEN WIRE BACKING TO SUPPORT THE FABRIC SHOULD BE GALVANIZED 2" X 4" WELDED WIRE, 12.5 GAUGE MINIMUM.
- MUST BE EMBEDDED A MINIMUM OF 1 FOOT DEEP AND SPACED NOT MORE THAN 5 FEET ON CENTER.
- 5. LAY OUT FENCING DOWN-SLOPE OF DISTURBED AREA, FOLLOWING THE CONTOUR AS CLOSELY AS POSSIBLE. THE FENCE SHOULD BE SITED SO THAT THE MAXIMUM DRAINAGE AREA IS ¼ ACRE/100 FEET OF FENCE.
- 6. THE TOE OF THE SILT FENCE SHOULD BE TRENCHED IN WITH A SPADE OR MECHANICAL TRENCHER, SO THAT THE DOWN-SLOPE FACE OF THE TRENCH IS FLAT AND PERPENDICULAR TO THE LINE OF FLOW. WHERE FENCE CANNOT BE TRENCHED IN (E.G., PAVEMENT OR ROCK OUTCROP), WEIGHT FABRIC FLAP WITH 3 INCHES OF PEA GRAVEL ON UPHILL SIDE TO PREVENT FLOW FROM SEEPING UNDER FENCE.
- 7. THE TRENCH MUST BE A MINIMUM OF 6 INCHES DEEP AND 6 INCHES WIDE TO ALLOW FOR THE SILT FENCE FABRIC TO BE LAID IN THE GROUND
- 8. SILT FENCE SHOULD BE SECURELY FASTENED TO EACH STEEL SUPPORT POST OR TO WOVEN WIRE, WHICH IS IN TURN ATTACHED TO THE STEEL FENCE POST. THERE SHOULD BE A 3-FOOT OVERLAP, SECURELY FASTENED WHERE ENDS OF FABRIC MEET.
- 9. SILT FENCE SHOULD BE REMOVED WHEN THE SITE IS COMPLETELY STABILIZED SO AS NOT TO BLOCK OR IMPEDE STORM FLOW OR DRAINAGE.
- 10. REMOVE SEDIMENT WHEN BUILDUP REACHES 6 INCHES, OR INSTALL A SECOND LINE OF FENCING PARALLEL TO THE OLD FENCE.
- 11. REPLACE ANY TORN FABRIC OR INSTALL A SECOND LINE OF FENCING PARALLEL TO THE TORN SECTION.
- 12. REPLACE OR REPAIR ANY SECTIONS CRUSHED OR COLLAPSED IN THE COURSE OF CONSTRUCTION ACTIVITY. IF A SECTION OF FENCE IS OBSTRUCTING VEHICULAR ACCESS, CONSIDER RELOCATING IT TO A SPOT WHERE IT WILL PROVIDE EQUAL PROTECTION, BUT WILL NOT OBSTRUCT VEHICLES. A TRIANGULAR FILTER DIKE MAY BE PREFERABLE TO A SILT FENCE AT COMMON VEHICLE ACCESS POINTS.

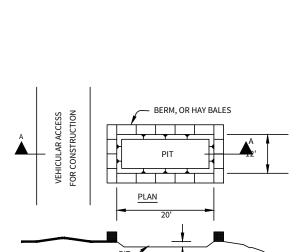

1. INSTALL SILT FENCES WHERE SHOWN.

STEEL FENCE POST -

WOVEN WIRE FABRIC -

(HOG WIRE) 12.5 GA.

MAX. 5' SPACING

2. ADJUST SILT FENCES AS WORK PROGRESSES.

3. REMOVE SILT FENCES AFTER VEGETATION HAS BEEN ESTABLISHED PER SPECIFICATIONS.

SILT FENCE DETAIL


GENERAL NOTES:

 DETAIL ABOVE ILLUSTRATES MINIMUM DIMENSIONS. PIT CAN BE INCREASED IN SIZE DEPENDING ON EXPECTED FREQUENCY OF USE.

SECTION A-A

- 2. IF HAY BALES ARE USED, THEY SHALL BE PLACED IN ACCORDANCE WITH DETAILS SHOWN ON EXHIBIT FOR
- 3. WASHOUT PIT SHALL BE LOCATED IN AN AREA EASILY ACCESSIBLE TO CONSTRUCTION TRAFFIC.
- 4. WASHOUT PIT SHALL NOT BE LOCATED IN AREAS SUBJECT TO INUNDATION FROM STORM WATER RUNOFF.
- 5. WASHOUT PIT SHALL BE LINED WITH A 10-MIL THICK POLYETHYLENE SHEETING FREE OF HOLES, TEARS AND OTHER DEFECTS.



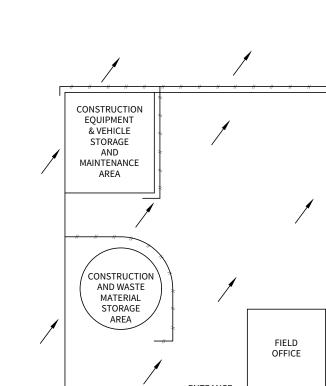


SECTION DETAIL

—#— SILT FENCE ─► FLOW ARROWS TYP. CONSTRUCTION STAGING AREA

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

Developer's Nai	ne	1	MERITAGE HOME	E, INC		
Developer's Add	dress	2722 W BITTERS RD, SUITE 200				
City	SAN ANTONIO	State	TEXAS	Zip	78248	
Phone #	(210) 298-4294		Fax #			
SAWS Block Ma	p#	_ Total EDU's		Total Ac	creage	
Total Linear Foo	otage of Pipe	11,569.77		Plat No.		
Number of Lots			SAWS Job N	n	20-1082	

4. STEEL POSTS, WHICH SUPPORT THE SILT FENCE, SHOULD BE INSTALLED ON A SLIGHT ANGLE TOWARD THE ANTICIPATED RUNOFF SOURCE. POST

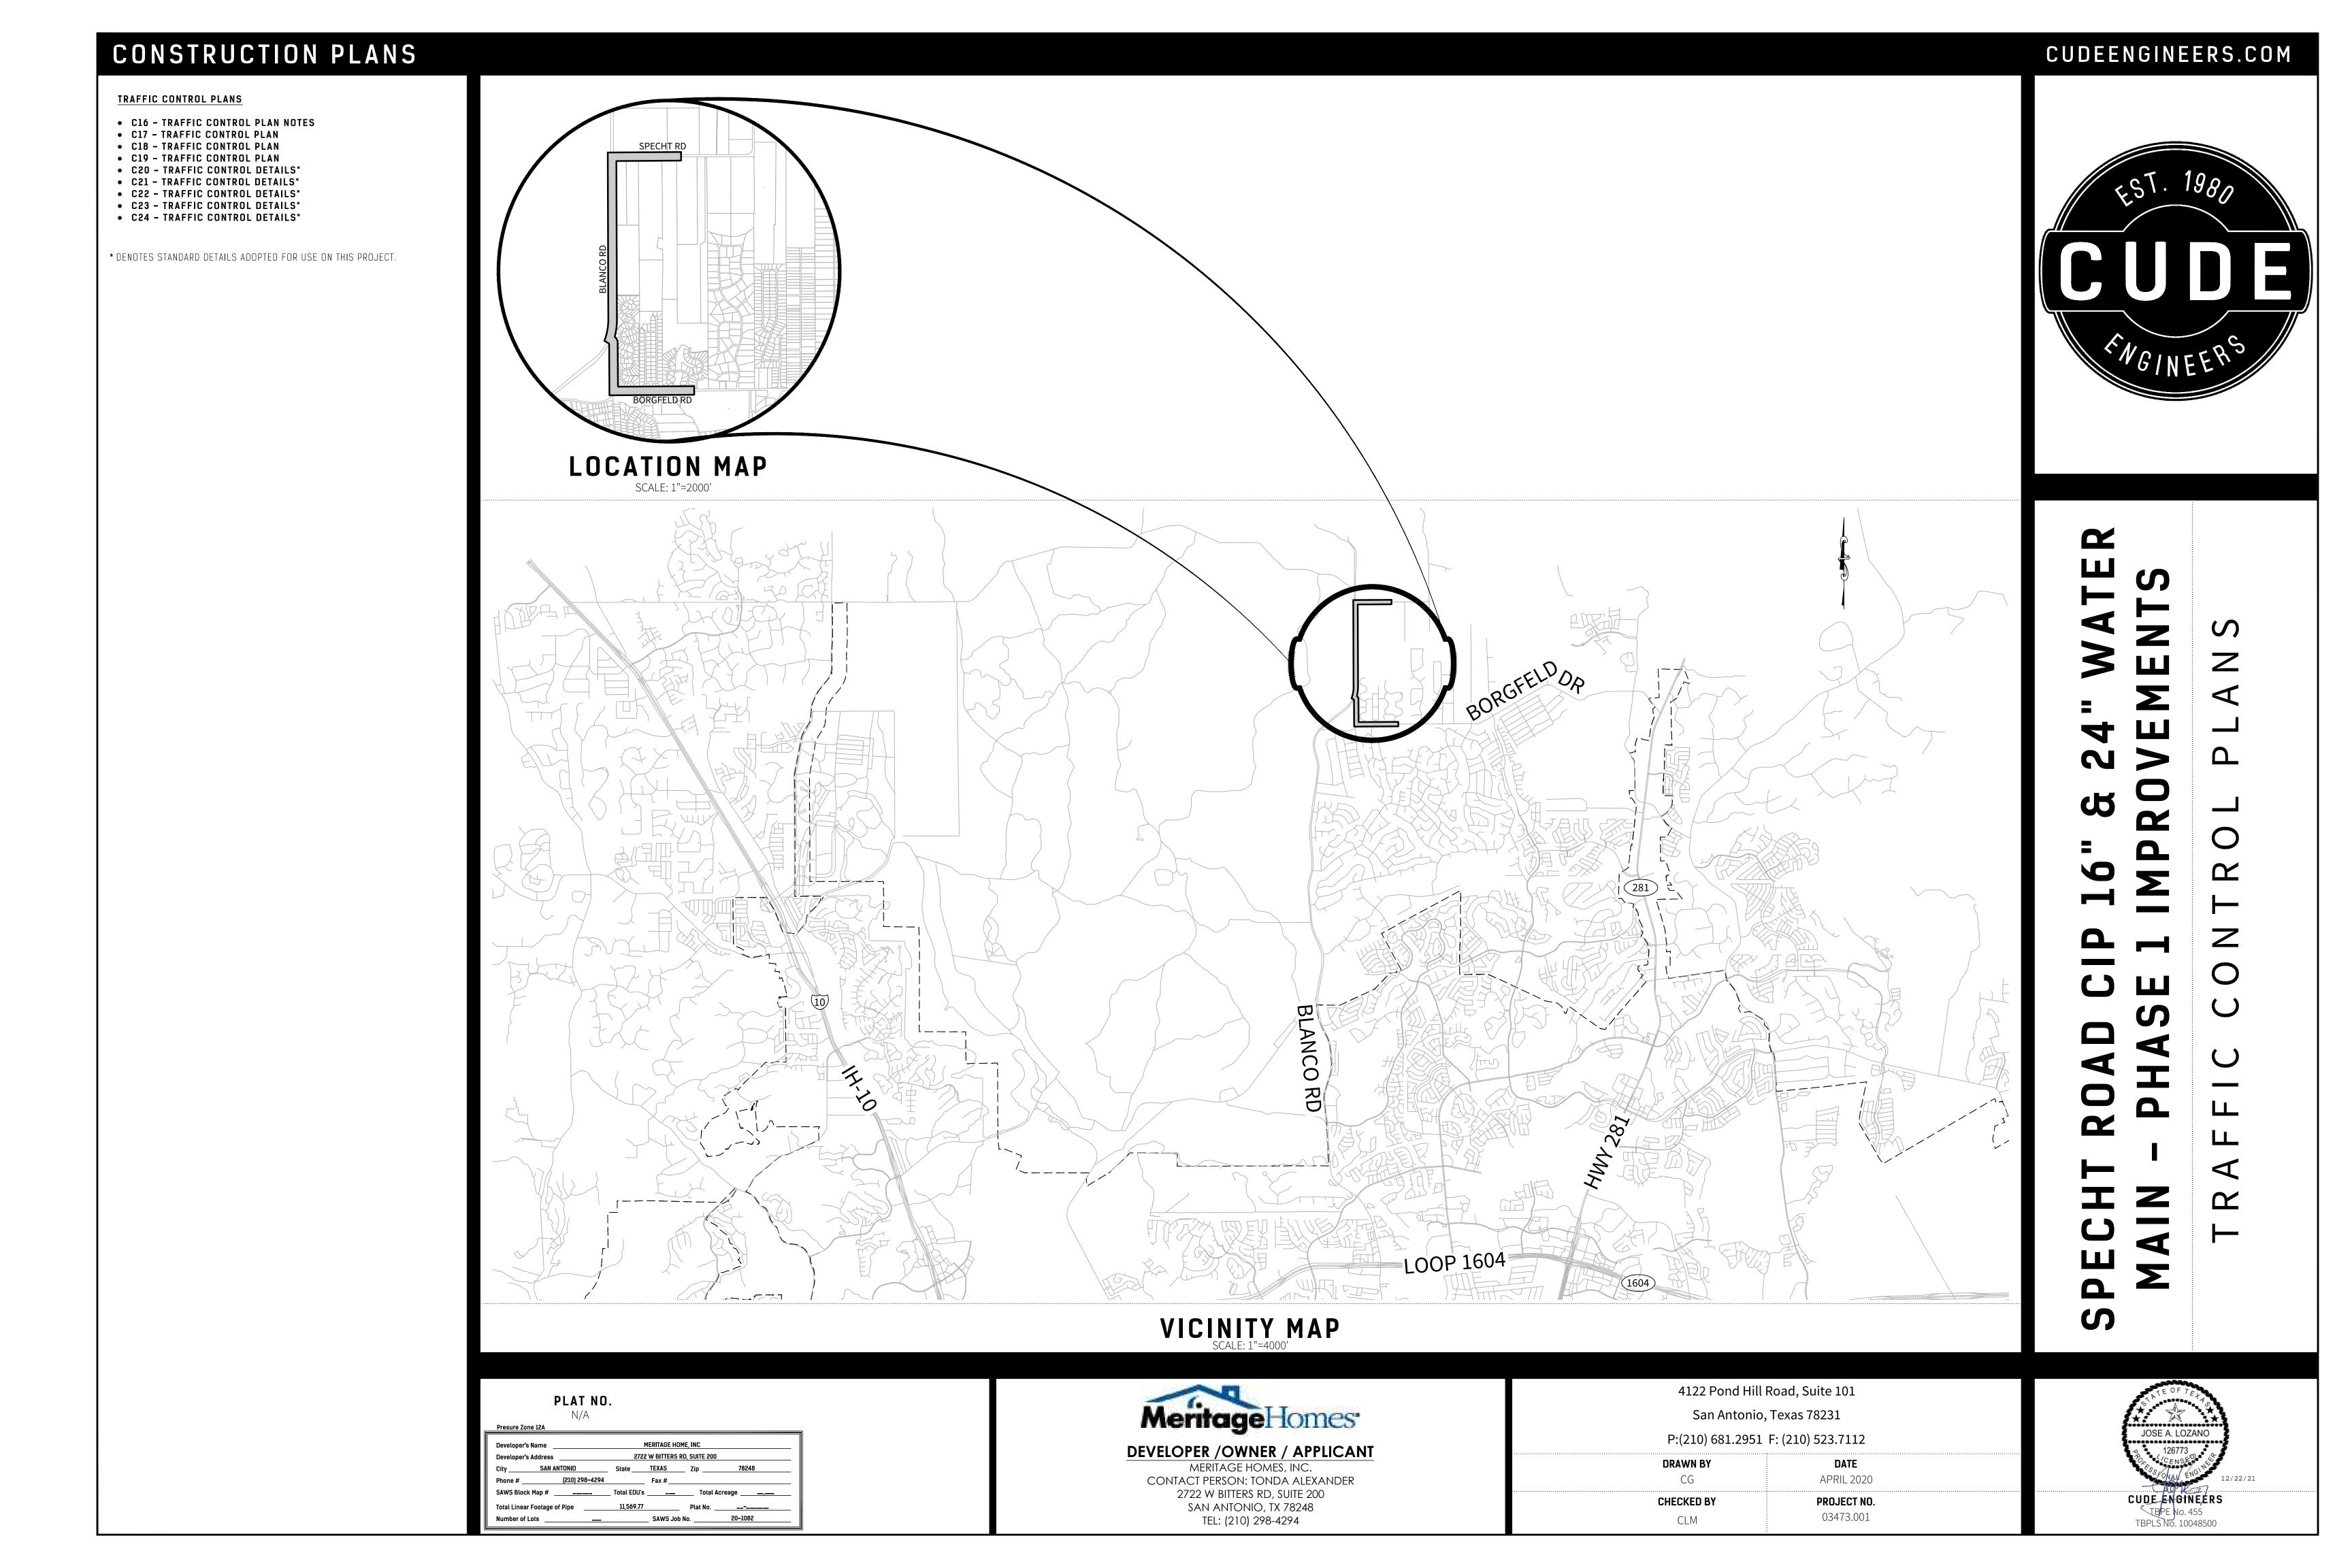

PHASING GENERAL NOTES

- 1. PRIOR TO EACH PHASE OF CONSTRUCTION, THE STORMWATER POLLUTION PREVENTION DEVICES SHALL BE PLACED IN ACCORDANCE WITH THE SW3P AS DIRECTED BY THE
- ENGINEER. 2. IT IS THE CONTRACTOR'S RESPONSIBILITY TO IDENTIFY AND LOCATE ALL UTILITIES
- 3. CONTRACTOR SHALL PROVIDE ACCESS TO RESIDENTIAL AND COMMERCIAL DRIVES AT ALL TIMES DURING CONSTRUCTION.
- 4. CONTRACTOR SHALL PROVIDE TEMPORARY VERTICAL TRANSITIONS AS NEEDED BETWEEN CONSTRUCTION AREAS, TRAVEL WAYS AND ACCESS POINTS.

PHASE 1

1. WESTBOUND TRAFFIC CONTROL ON BORGFELD ROAD:

PRIOR TO CONSTRUCTION OF EACH PHASE.

- FROM EAST OF THE INTERSECTION OF SAN PORTOLA AND BORGFELD ROAD MERGE TRAFFIC FROM TWO WESTBOUND LANES TO ONE WESTBOUND LANE OVER A DISTANCE OF
- BARRICADE THE RIGHT WESTBOUND LANE OF BORGFELD ROAD FROM THE INTERSECTION OF SAN PORTOLA AND BORGFELD DRIVE UNTIL THE INTERSECTION OF OLD BLANCO ROAD AND BORGFELD DRIVE.
- SEE SHEET C17 FOR DETAILS.
- 2. NORTHBOUND TRAFFIC CONTROL ON OLD BLANCO ROAD:
 - BARRICADE OFF THE ENTIRE NORTHBOUND LANE FOR OLD BLANCO ROAD FROM BORGFELD DRIVE TO BLANCO ROAD.
 - OLD BLANCO ROAD TO BE ONE WAY TRAFFIC, SOUTHBOUND ONLY.
 - REFERENCE SHEET C17 FOR DETAILS

PHASE 2

- 1. NORTHBOUND TRAFFIC CONTROL ON BLANCO ROAD:
- BARRICADE OFF THE SHOULDER OF BLANCO ROAD FROM ITS INTERSECTION WITH OLD BLANCO ROAD THROUGH TO THE INTERSECTION OF BLANCO ROAD AND SPECHT ROAD.
- REFERENCE SHEET C17, C18, & C19 FOR DETAILS.

PHASE 3


- 3. EASTBOUND TRAFFIC CONTROL ON SPECHT ROAD:
 - BARRICADE OFF THE SHOULDER OF SPECHT ROAD THROOUGH THE PROPOSED WATER MAIN IMPROVEMENTS.
 - REFERENCE SHEET C19 FOR DETAILS.

FINAL OVERLAY

- 1. ONCE TRAFFIC HAS BEEN SHIFTED TO THE FULL ROADWAY SECTION, THE CONTRACTOR SHALL PROVIDE THE FINAL 2" COURSE OF WARM MIX ASPHALTIC CONCRETE TYPE "D" OVERLAY FOR THE ENTIRE PROJECT INCLUDING DRIVEWAYS. CONTRACTOR SHALL PROVIDE TRAFFIC CONTROL FOR THIS WORK IN ACCORDANCE WITH TXDOT STANDARD TCP (3-3) 14 MOBILE OPERATIONS - UNDIVIDED HIGHWAYS. SEE SHEET C9 FOR DETAILS.
- 2. CONTRACTOR SHALL PLACE TEMPORARY TABS DURING OVERLAY OPERATIONS AS REQUIRED TO MARK CENTERLINE AND LANE LINES.
- 3. CONTRACTOR SHALL PLACE PERMANENT MARKINGS AND MARKERS FOR THE ENTIRE
- LENGTH OF THE PROJECT.
- 4. CONTRACTOR SHALL COMPLETE FINAL CLEANUP.

FINAL CLEAN UP

- 1. UPON COMPLETION OF THE WORK AND BEFORE FINAL ACCEPTANCE IS MADE, THE PROJECT WILL BE THOROUGHLY CLEANED OF ALL CONSTRUCTION MATERIALS AND ALL STOCKPILE LOCATIONS.
- 2. UPON COMPLETION OF THE WORK AND BEFORE FINAL ACCEPTANCE IS MADE, SHAPE AND FINISH SUCH PORTIONS OF THE RIGHT-OF-WAY WHICH MAY HAVE BEEN DISTURBED IN MAKING PROVISIONS FOR TRAFFIC. LEAVE THE ENTIRE RIGHT-OF-WAY IN A SMOOTH, NEAT AND SIGHTLY CONDITION.



4122 Pond Hill Road, Suite 101 San Antonio, Texas 78231 P:(210) 681.2951 F: (210) 523.7112

RO SPECHT MAIN – PH


> DATE 12/22/2021 PROJECT NO. 03473.001 DRAWN BY CG


> > CHECKED BY


CLM


REVISIONS


16 of 24 REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

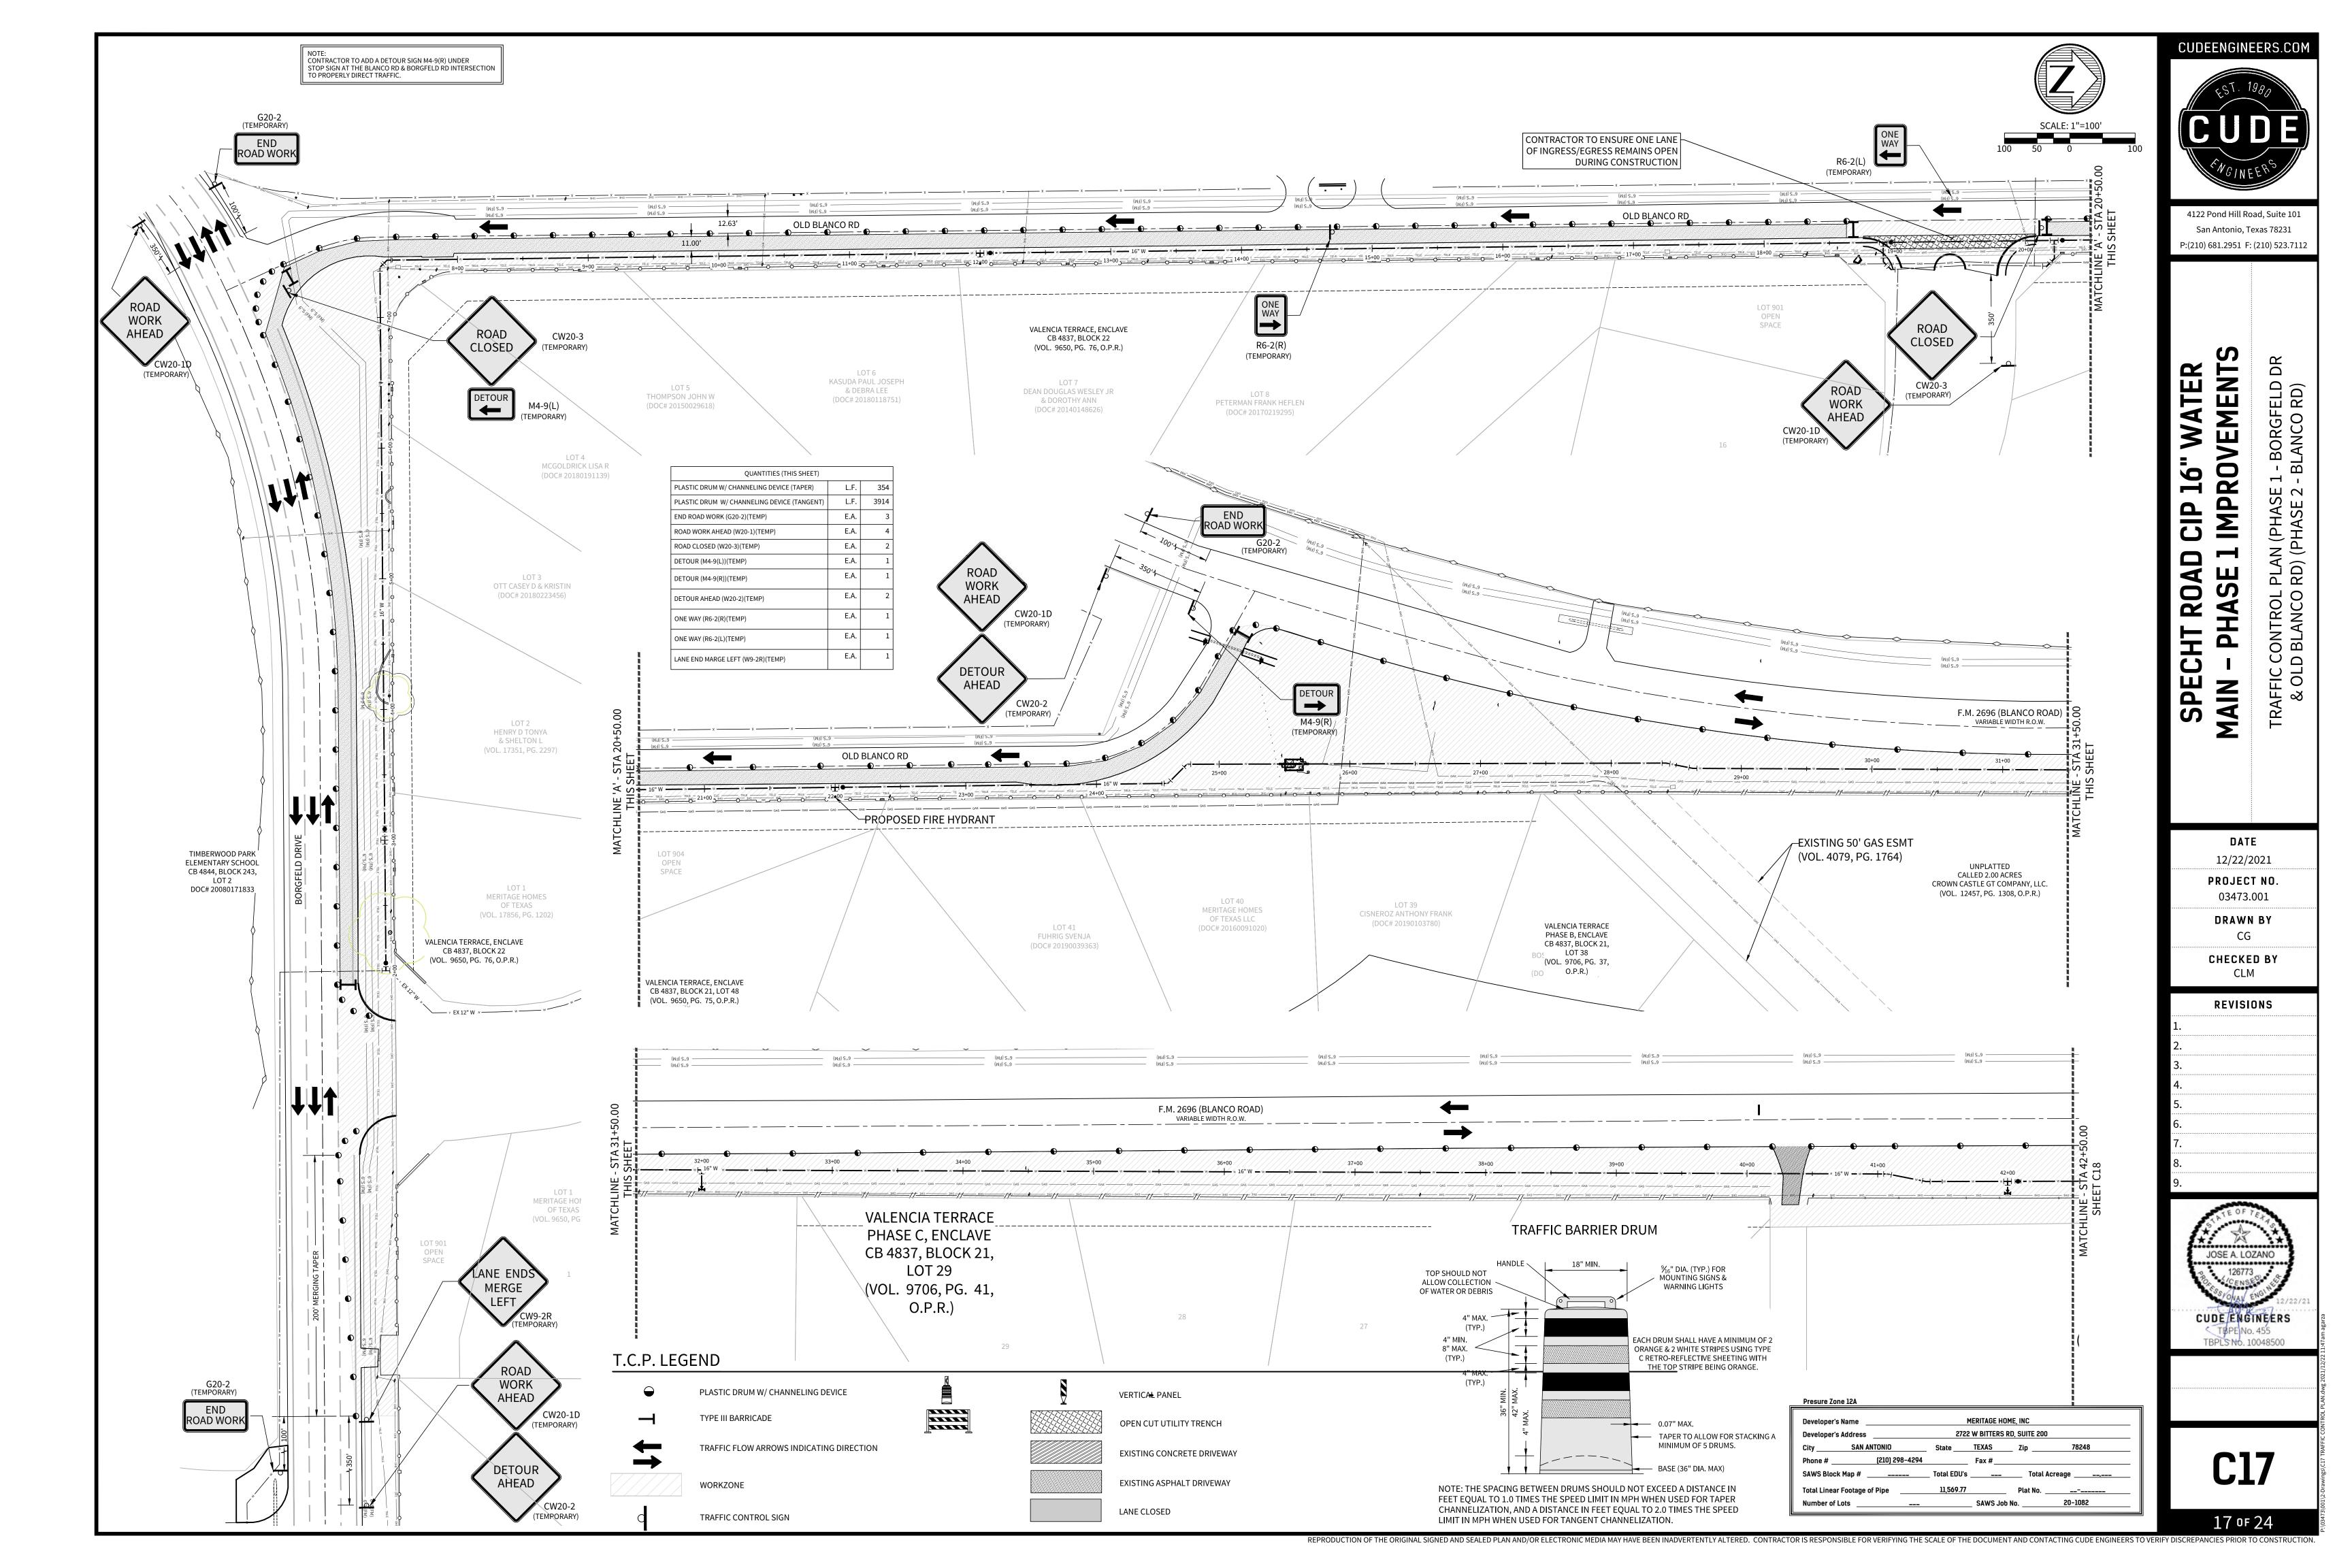


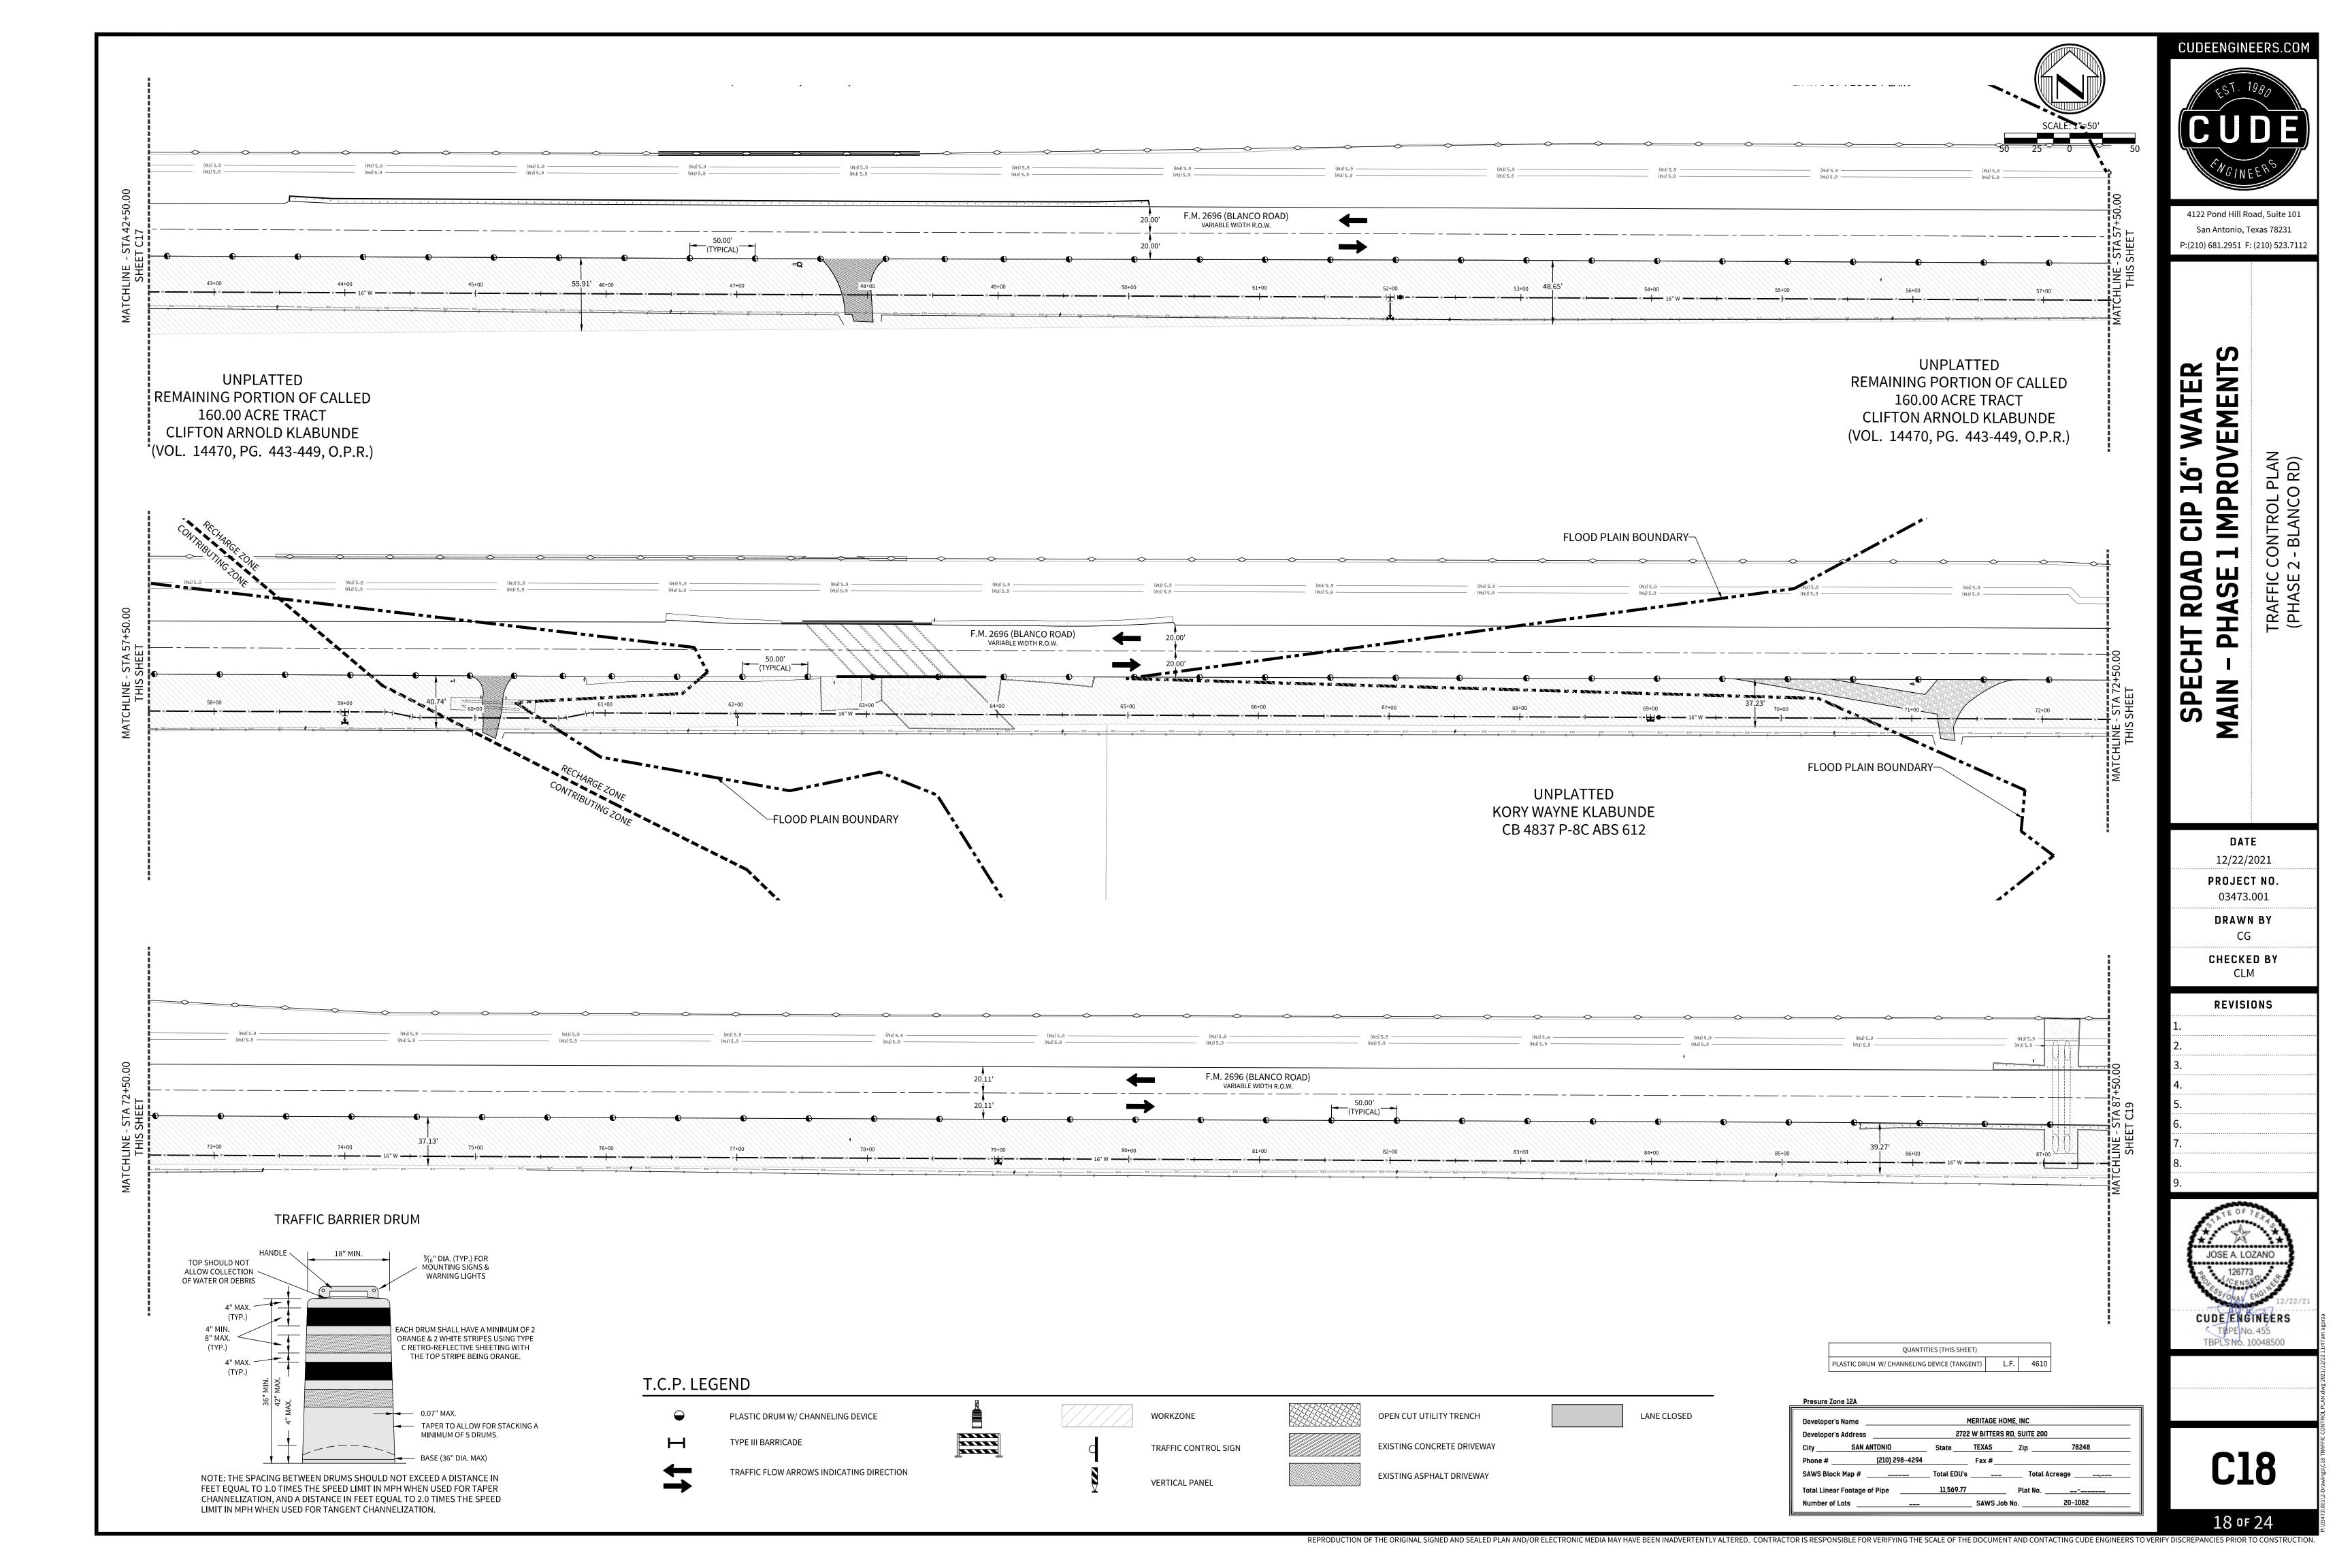


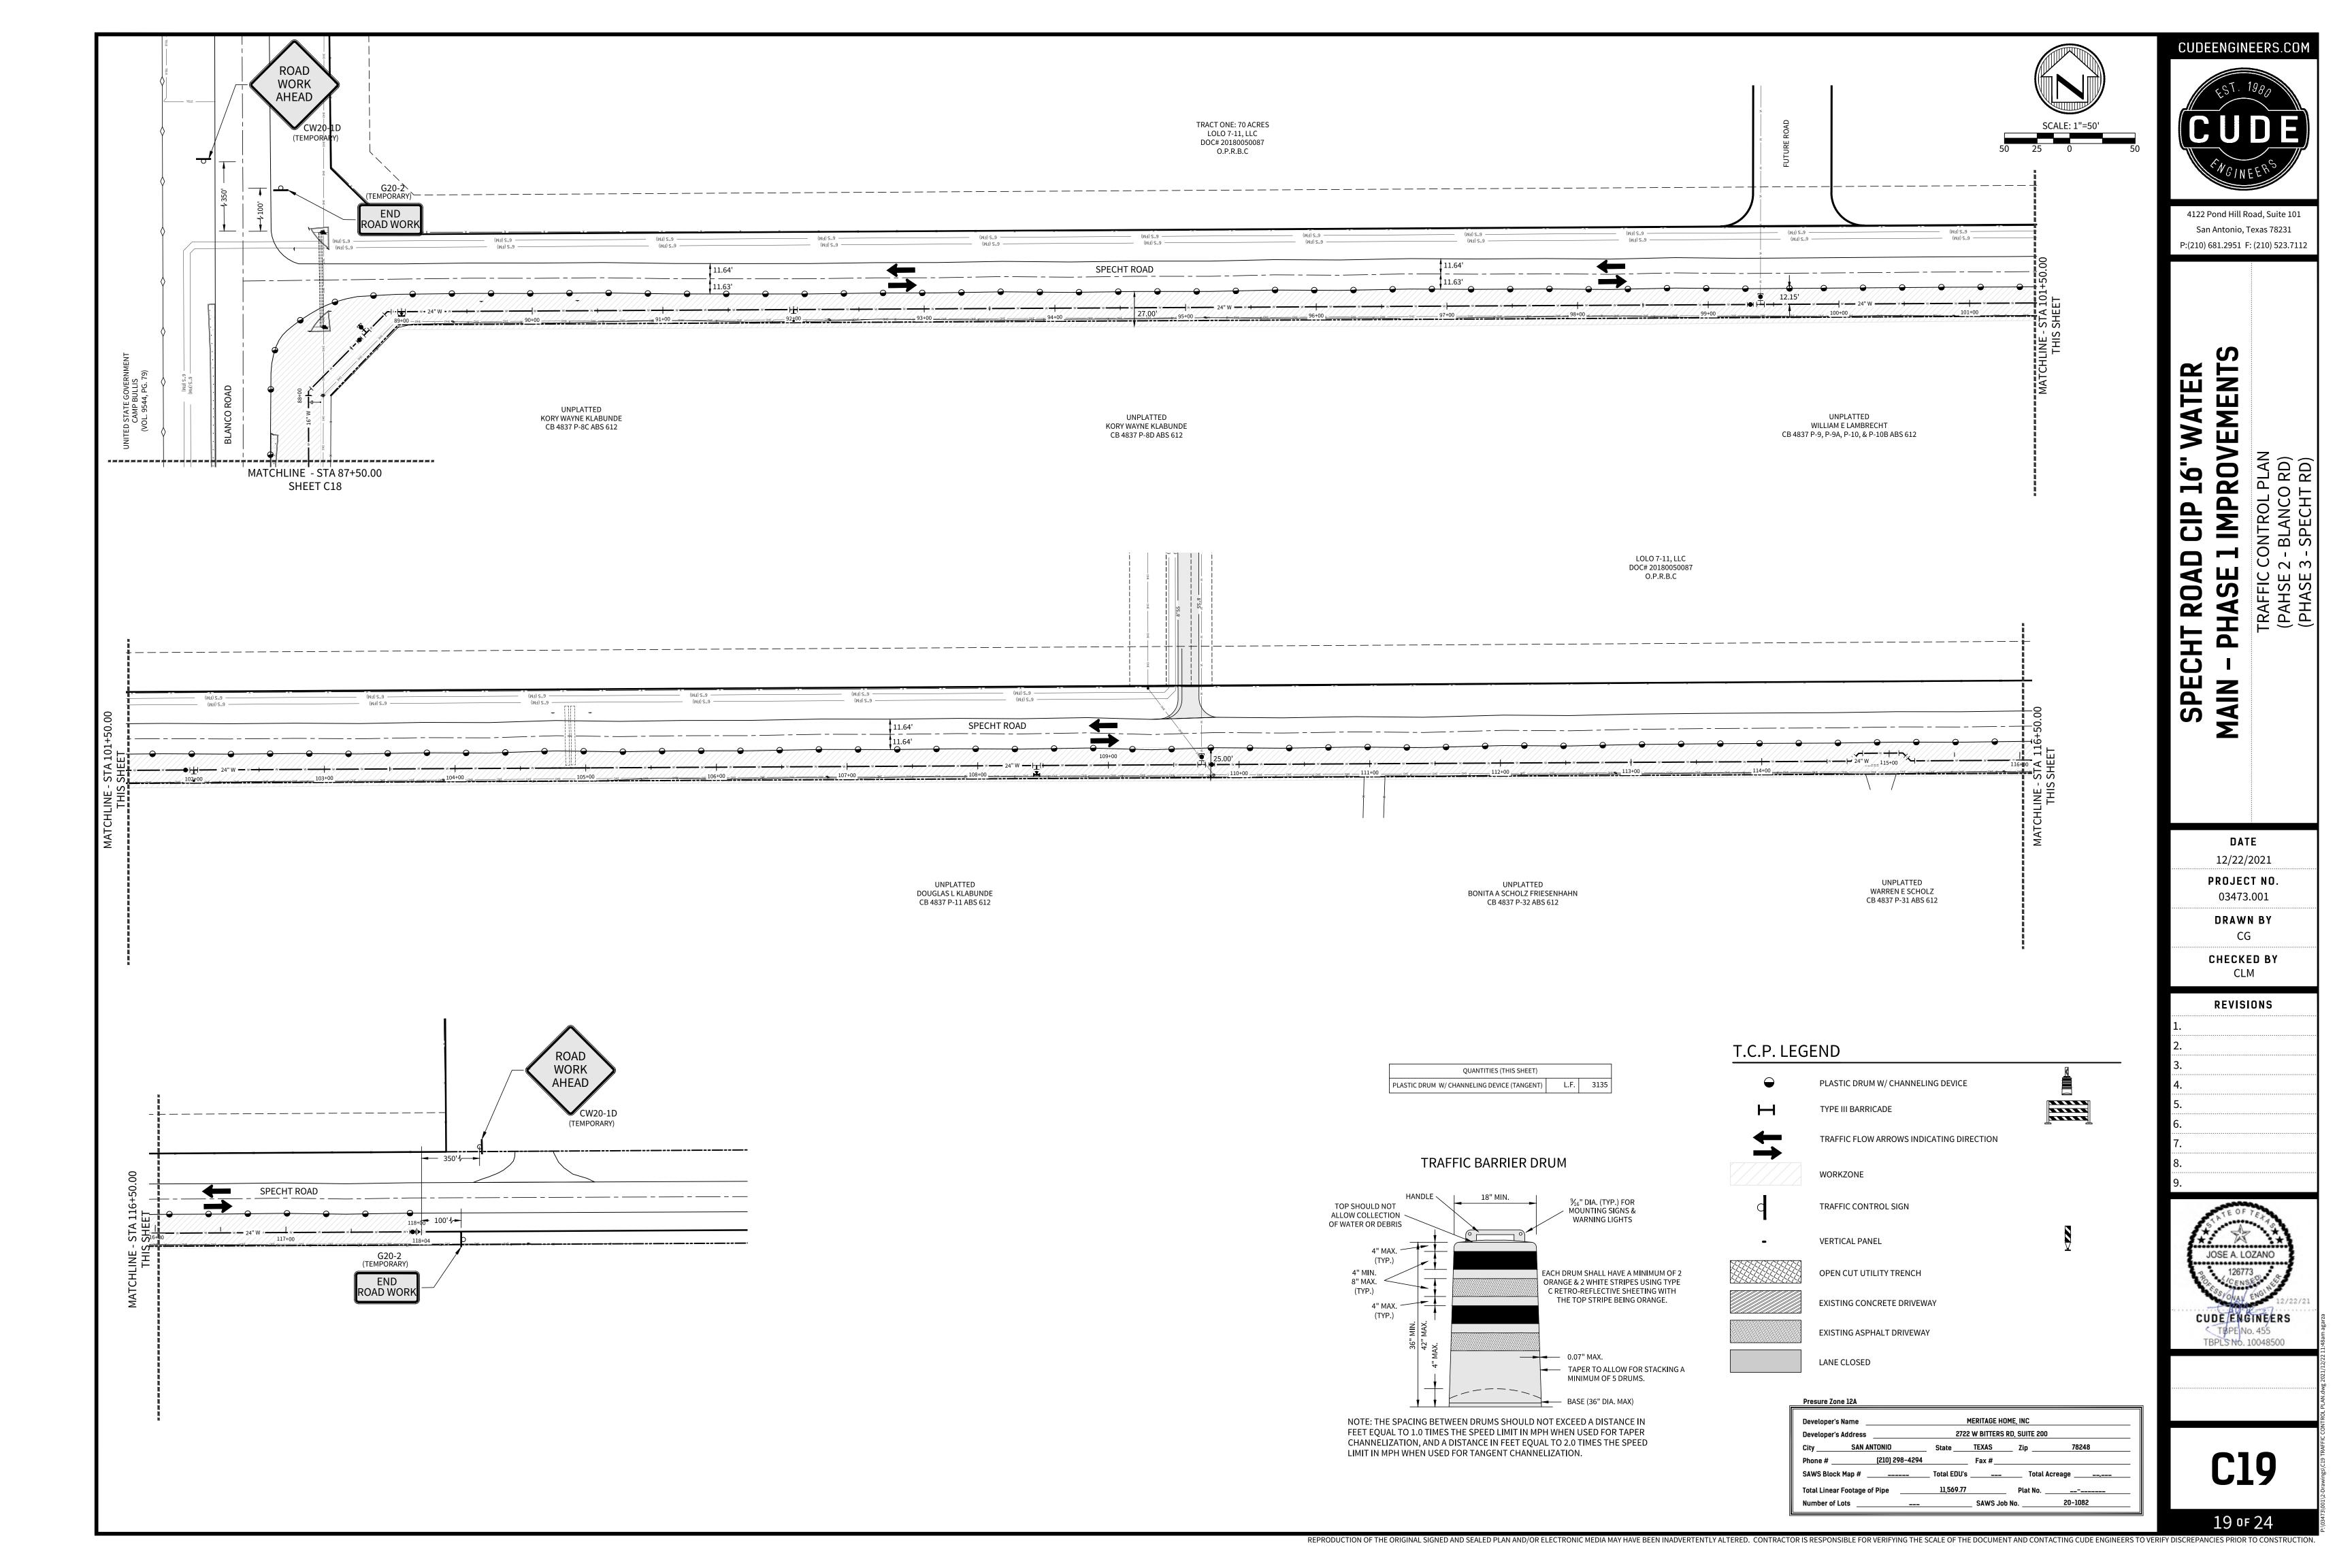


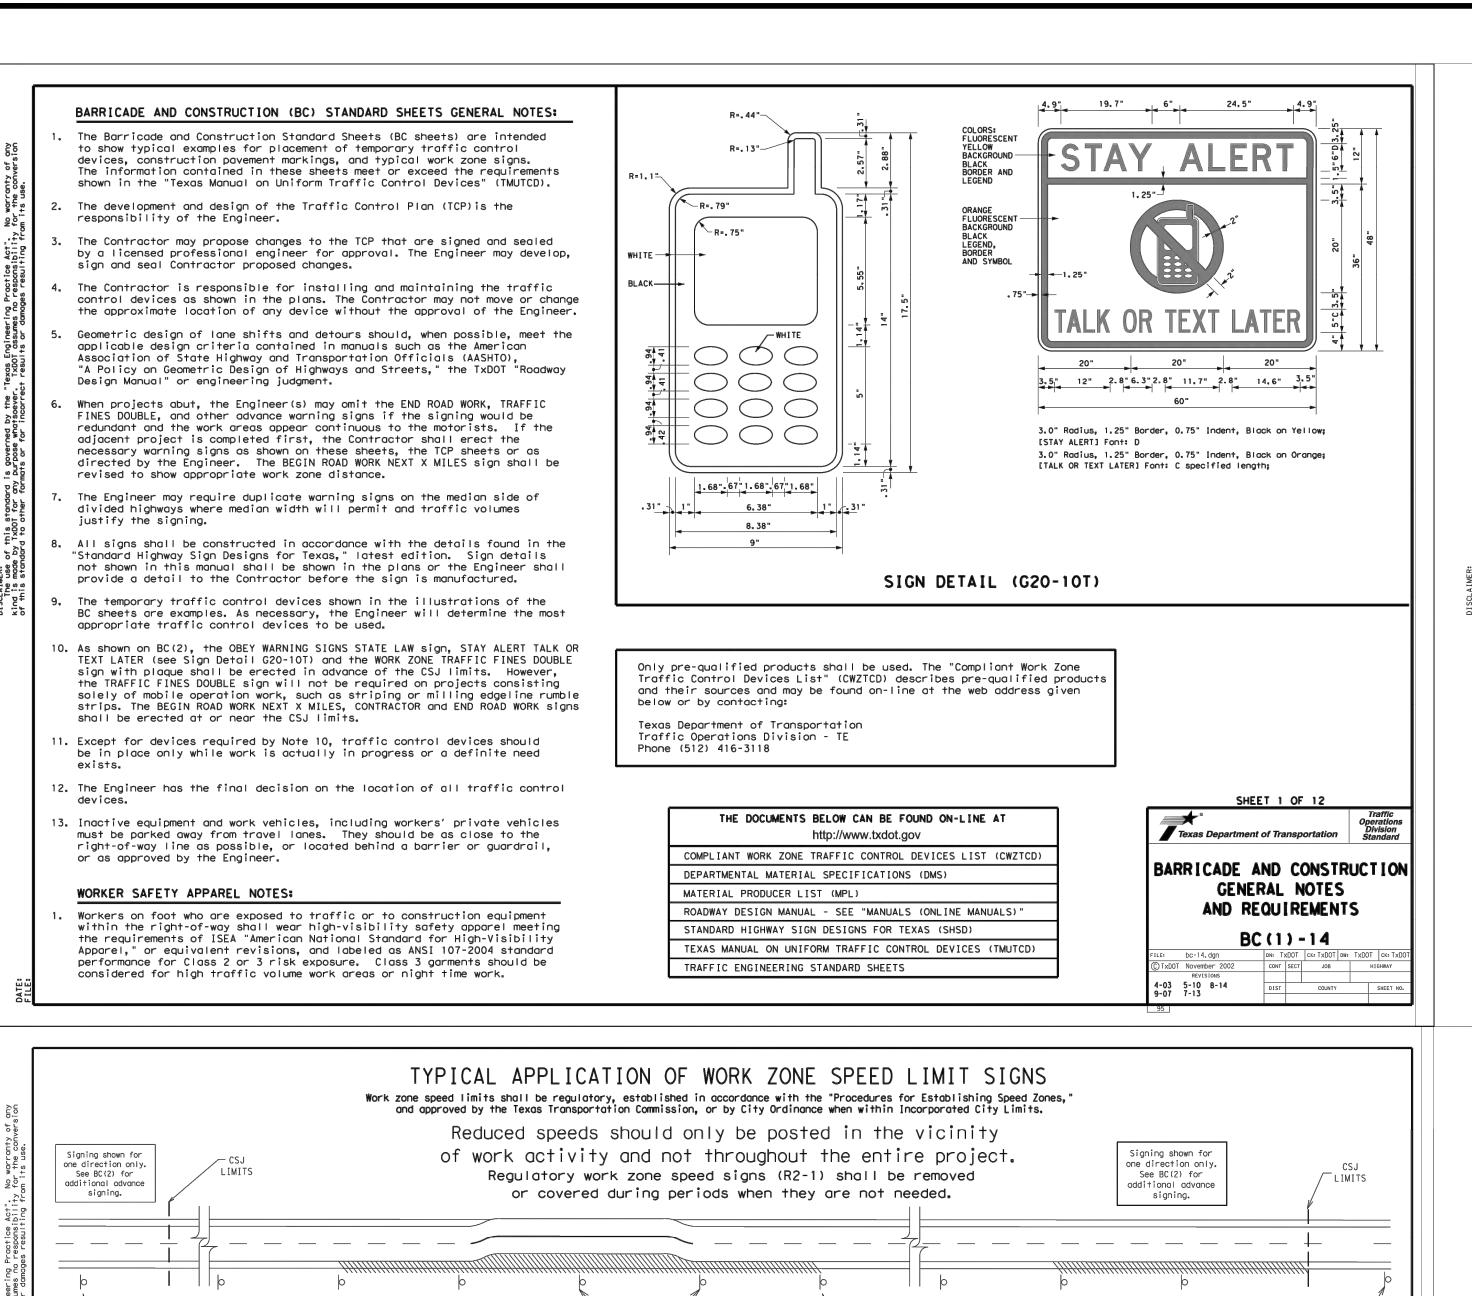

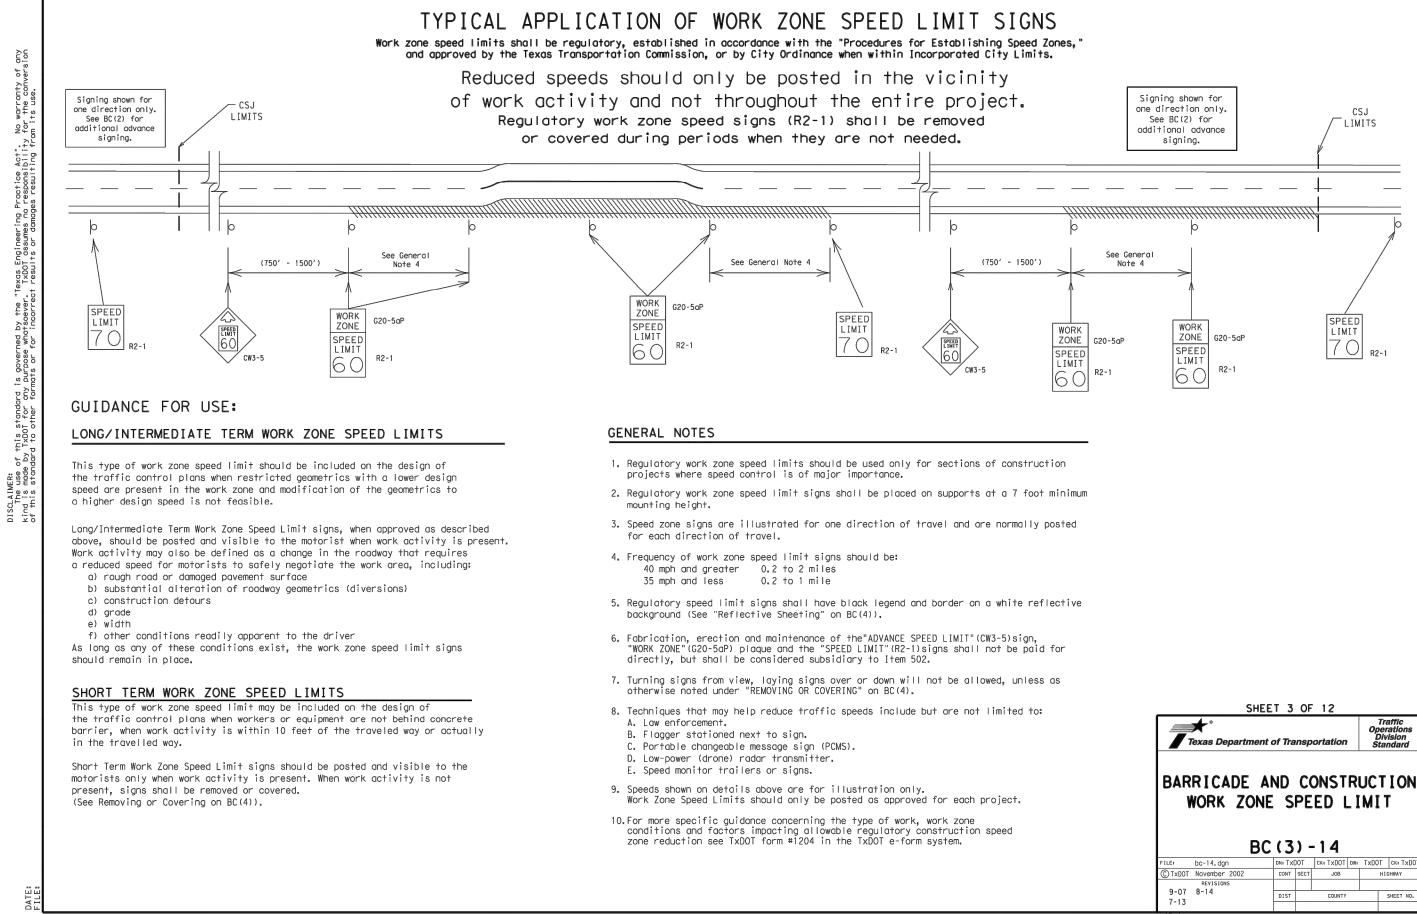

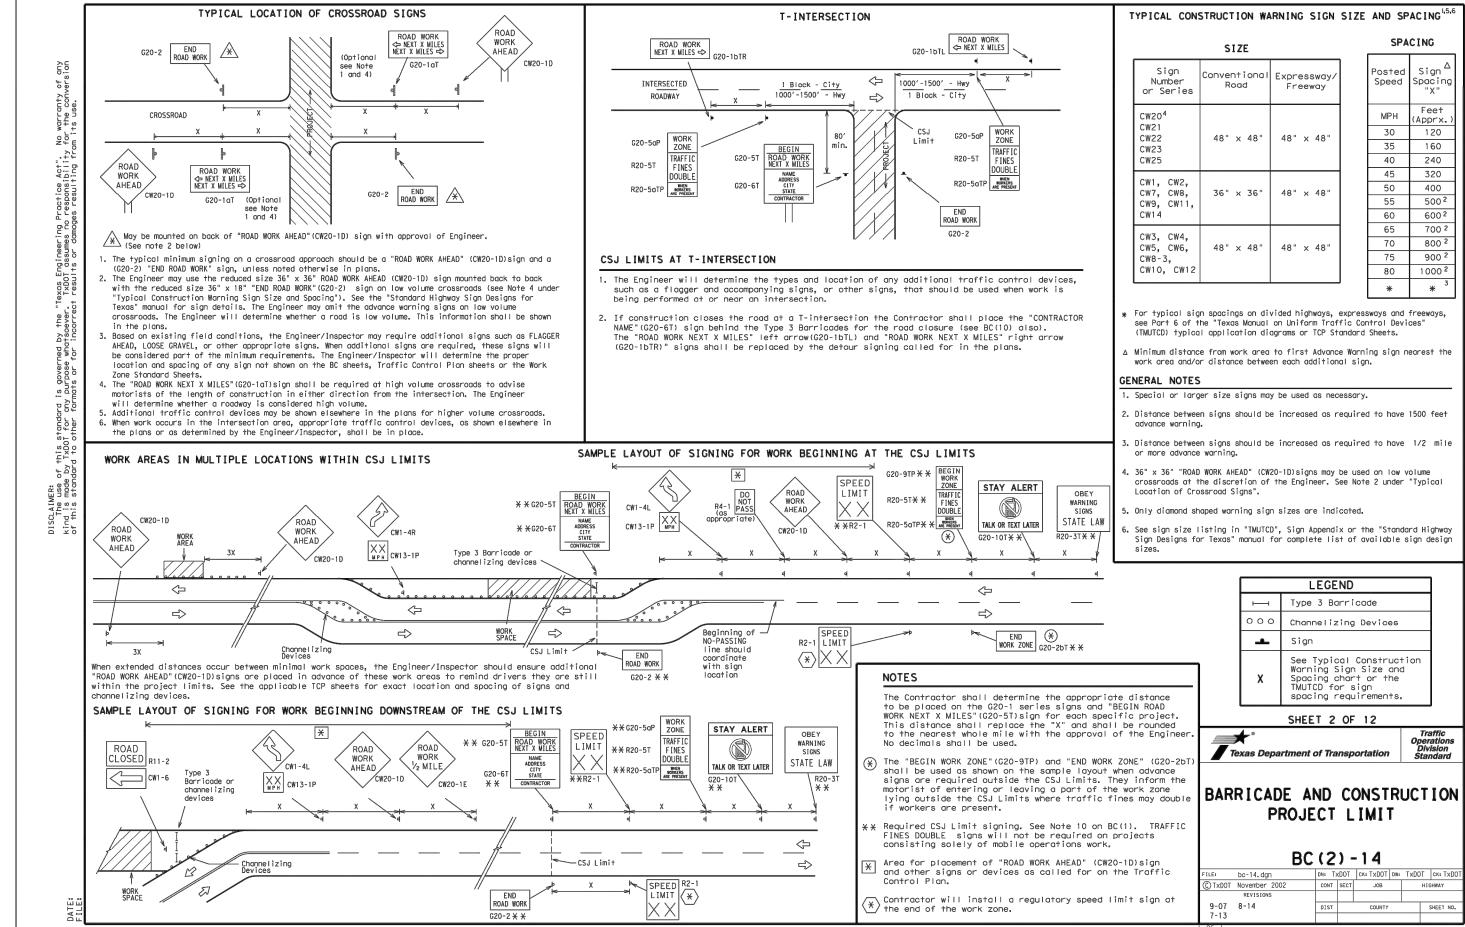

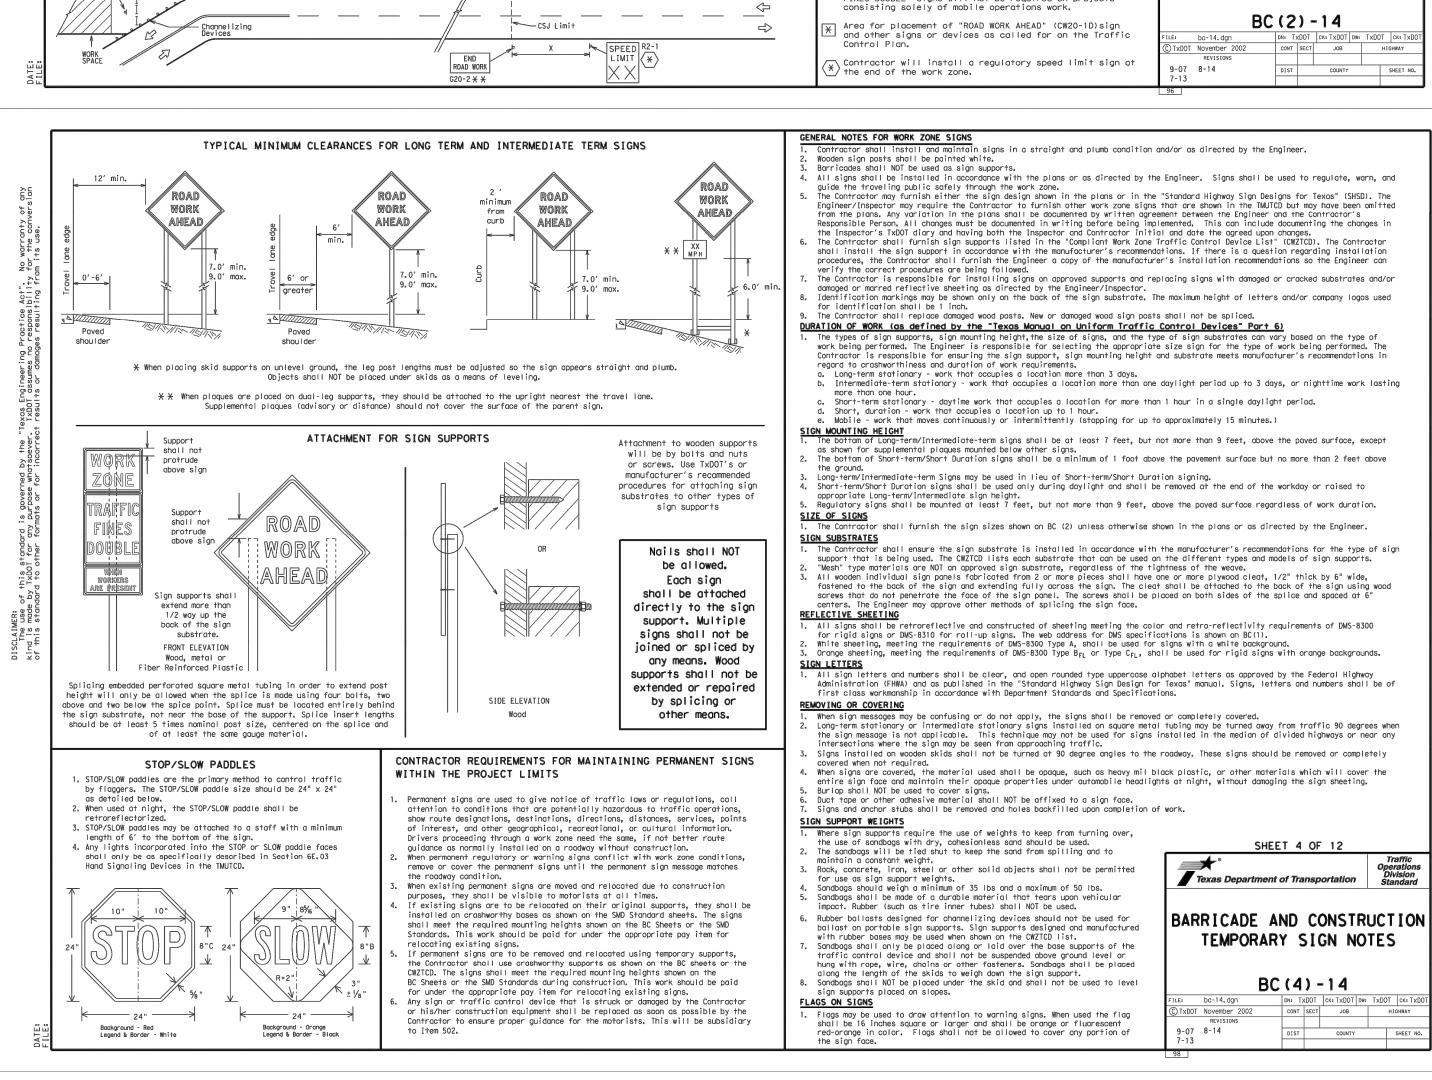



4122 Pond Hill Road, Suite 101 San Antonio, Texas 78231 P:(210) 681.2951 F: (210) 523.7112

TER

9

Q

노

0

PE

<u>_</u>

 \triangleleft

DATE

12/22/2021

PROJECT NO.

03473.001


DRAWN BY

CG

CHECKED BY

 CLM

REVISIONS

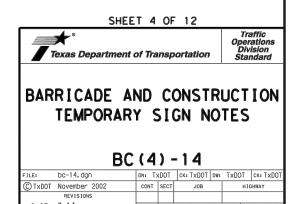


REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION.

JOSE A. LOZANO

TBPLS No. 10048500

20 of 24

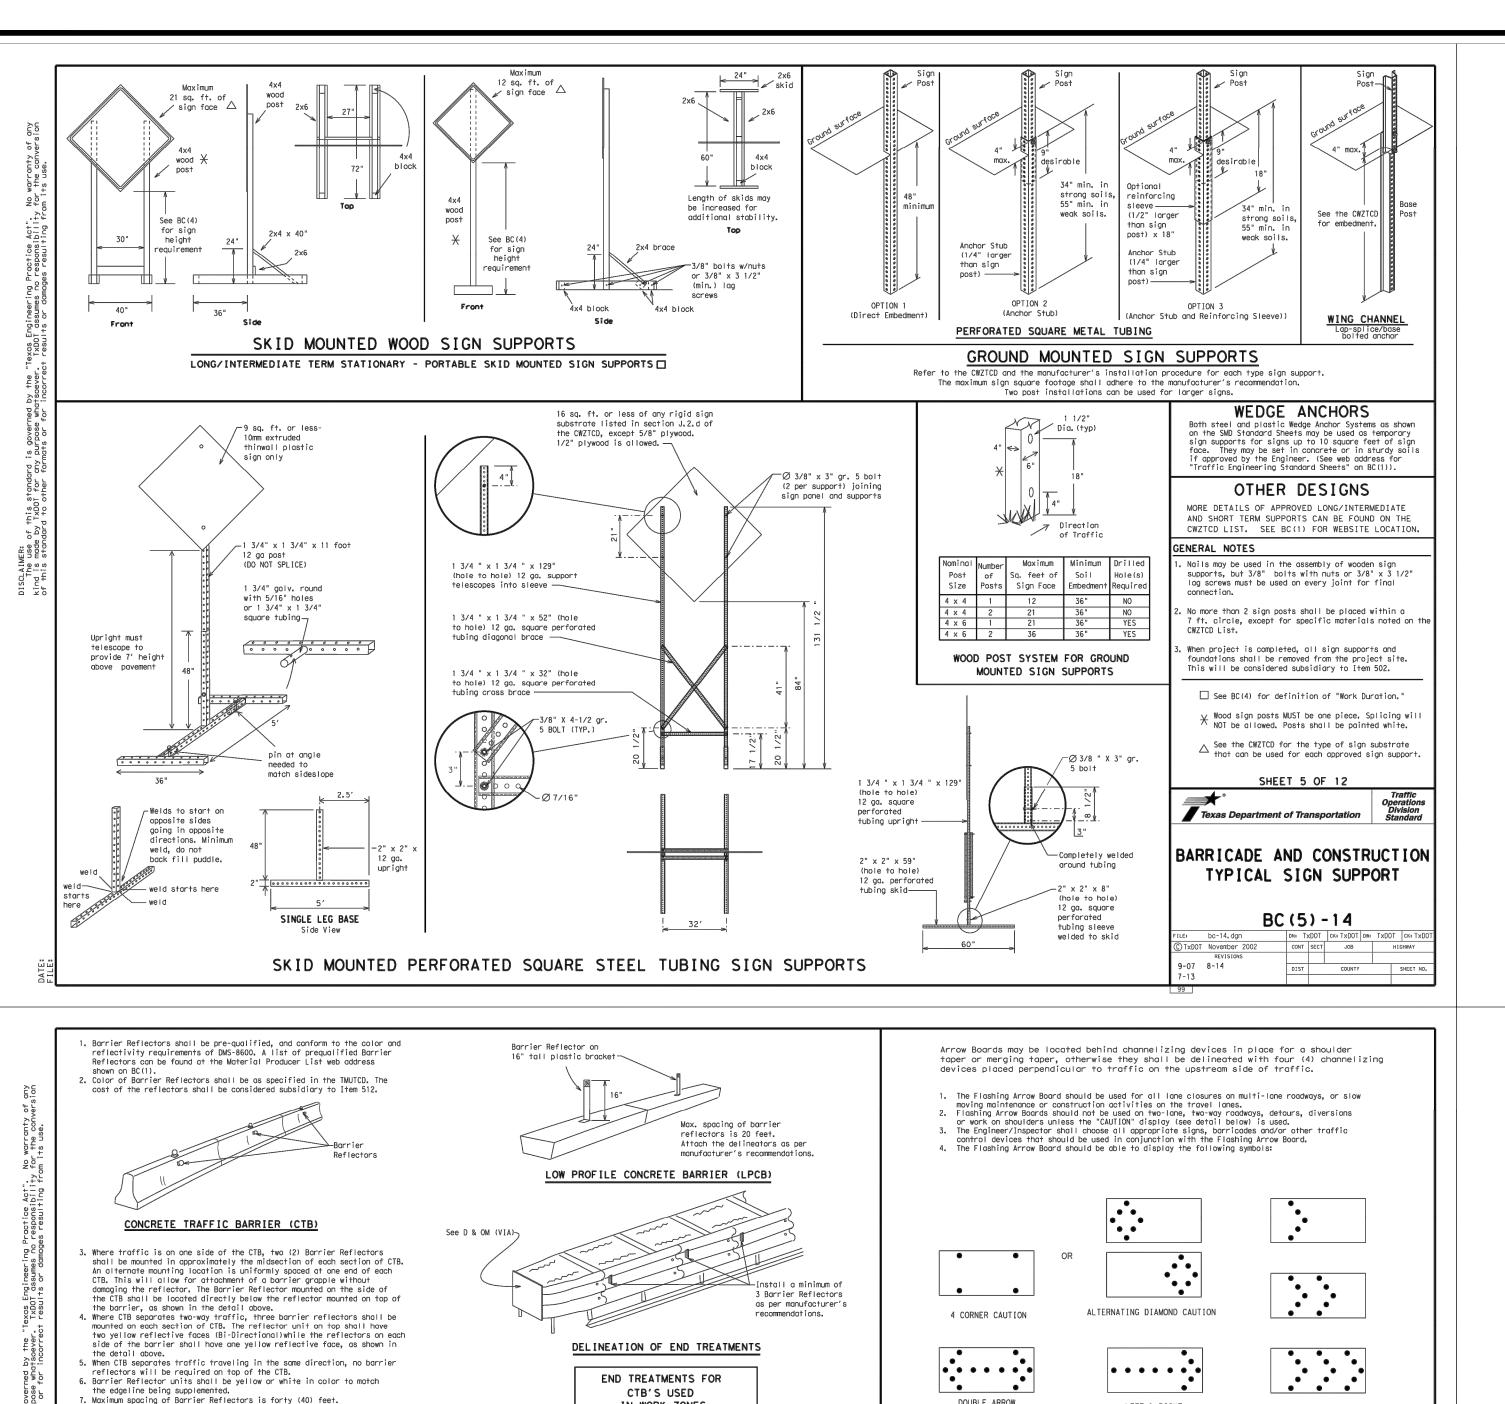

IN WORK ZONES

nd treatments used on CTB's in work

as defined in the National Cooperative

he CWZTCD List for approved end

treatments and manufacturers.

Type A-Low Intensity Flashing Warning Lights are commonly used with drums. They are intended to warn of or mark a potentially hazardous area. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "FL". The Type A Warning Lights shall

not be used with signs manufactured with Type B_{FL} or C_{FL} Sheeting meeting the requirements of Departmental Material Specification DMS-8300. 4. Type-C and Type D 360 degree Steady Burn Lights are intended to be used in a series for delineation to supplement other traffic control

devices. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "SB".

The Engineer/Inspector or the plans shall specify the location and type of warning lights to be installed on the traffic control devices.

6. When required by the Engineer, the Contractor shall furnish a copy of the warning lights certification. The warning light manufacturer will

certify the warning lights meet the requirements of the latest ITE Purchase Specifications for Flashing and Steady-Burn Warning Lights. When used to delineate curves, Type-C and Type D Steady Burn Lights should only be placed on the outside of the curve, not the inside.

Type A random flashing warning lights are not intended for delineation and shall not be used in a series. A A series of sequential flashing warning lights placed on channelizing devices to form a merging taper may be used for delineation. If used,

the successive flashing of the sequential warning lights should occur from the beginning of the taper to the end of the merging taper in

WARNING REFLECTORS MOUNTED ON PLASTIC DRUMS AS A SUBSTITUTE FOR TYPE C (STEADY BURN) WARNING LIGHTS

. A warning reflector or approved substitute may be mounted on a plastic drum as a substitute for a Type C, steady burn warning light at the

. The warning reflector shall be yellow in color and shall be manufactured using a sign substrate approved for use with plastic drums listed

4. Round reflectors shall be fully reflectorized, including the area where attached to the drum.
5. Square substrates must have a minimum of 30 square inches of reflectorized sheeting. They do not have to be reflectorized where it

6. The side of the warning reflector facing approaching traffic shall have sheeting meeting the color and retroreflectivity requirements for

order to identify the desired vehicle path. The rate of flashing for each light shall be 65 flashes per minute, plus or minus 10 flashes.

4. Type C and D steady-burn warning lights are intended to be used in a series to delineate the edge of the travel lane on detours, on lane

. Type A flashing warning lights are intended to warn drivers that they are approaching or are in a potentially hazardous area.

5. Type A, Type C and Type D worning lights shall be installed at locations as detailed on other sheets in the plans.
6. Worning lights shall not be installed on a drum that has a sign, chevron or vertical panel.

BARRIER REFLECTORS FOR CONCRETE TRAFFIC BARRIER AND ATTENUATORS

8. The location of warning lights and warning reflectors on drums shall be as shown elsewhere in the plans.

. The maximum spacing for warning lights on drums should be identical to the channelizing device spacing.

The warning reflector shall have a minimum retroreflective surface area (one-side) of 30 square inches,

8. The warning reflector should be mounted on the side of the handle nearest approaching traffic. 9. The maximum spacing for warning reflectors should be identical to the channelizing device spacing requirements.

DMS 8300-Type B or Type C. 7. When used near two-way traffic, both sides of the warning reflector shall be reflectorized.

. Warning lights shall meet the requirements of the TMUTCD.

Warning lights shall NOT be installed on barricades.

WARNING LIGHTS MOUNTED ON PLASTIC DRUMS

changes, on lane closures, and on other similar conditions.

discretion of the Contractor unless otherwise noted in the plans.

attaches to the drum.

ghway Research Report 350. Refer to

ones shall meet crashworthy standards

9. Attachment of Barrier Reflectors to CTB shall be per manufacturer's

recommendations.

10.Missing or damaged Barrier Reflectors shall be replaced as directed

Type C Warning Light or

drum adjacent to the travel way.

Warning reflector may be round

or square. Must have a vellow

30 square inches

reflective surface area of at least

11. Single slope barriers shall be delineated as shown on the above detail.

DOUBLE ARROW

REQUIREMENTS

13 3/4 mile

Truck-mounted attenuators (TMA) used on TxDOT facilities

must meet the requirements outlined in the National Cooperative Highway Research Report No. 350 (NCHRP 350) or the Manual for Assessing Safety Hardware (MASH). Refer to the CWZTCD for the requirements of Level 2 or

Level 3 TMAs.
Refer to the CWZTCD for a list of approved TMAs.

TMAs are required on freeways unless otherwise noted

in the plans. A TMA should be used anytime that it can be positioned

30 to 100 feet in advance of the area of crew exposure without adversely affecting the work performance.

area is spread down the roadway and the work crew is an extended distance from the TMA.

. The only reason a TMA should not be required is when a worl

MINIMUM | MINIMUM NUMBER

RUCK-MOUNTED ATTENUATORS

30 × 60

SIZE OF PANEL LAMPS

LEFT & RIGHT

ATTENTION

automatic dimming devices


9-07 8-14


Flashing Arrow Boards

FLASHING ARROW BOARDS

. The flashing arrow display is the TxDOT standard; however, the sequential Chevron

display may be used during daylight operations.

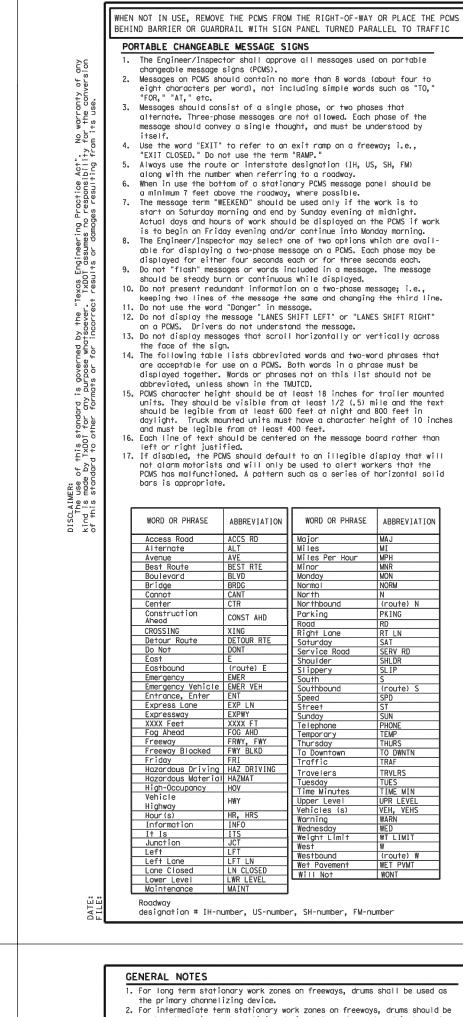


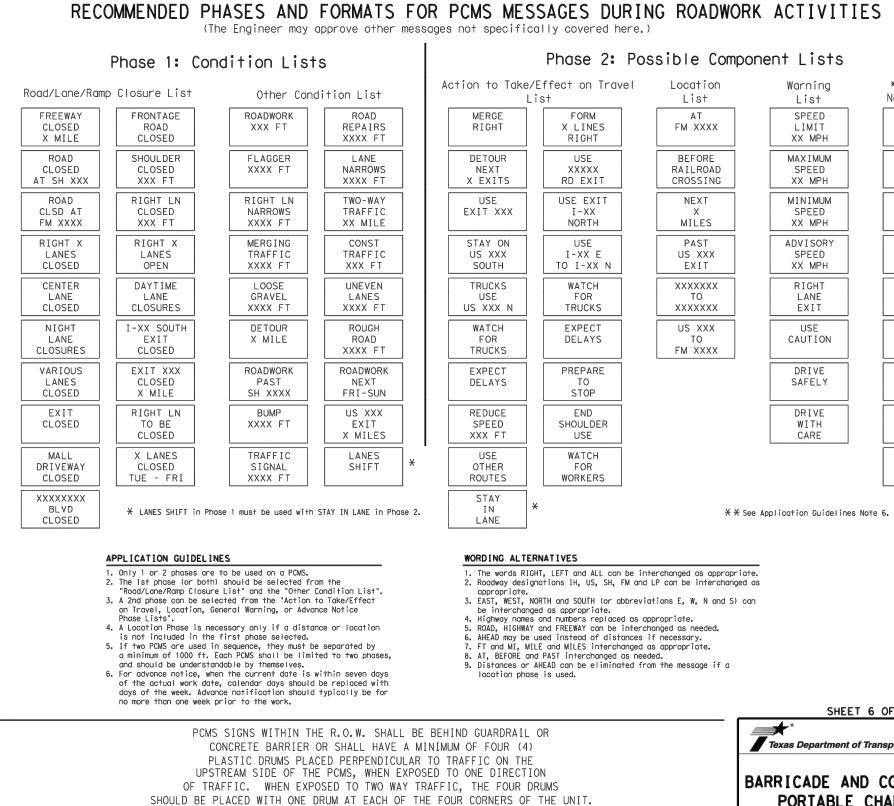

. When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE

for, or replace that sign.

A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the

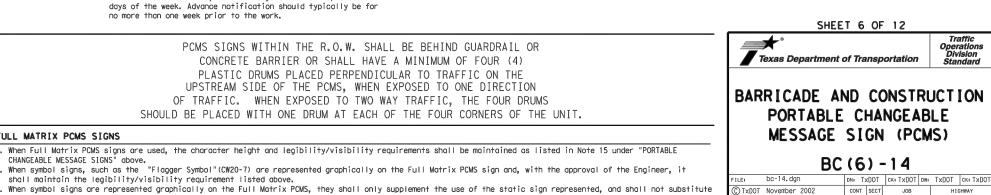

** Advance

Notice List

TUE-FRI

XX AM-

X PM

APR XX-

X PM-X AM

BEGINS

MONDAY

BEGINS

MAY XX

MAY X-X

XX PM ·

XX AM

FRI-SUN

XX AM

XX PM

NEXT TUE

AUG XX

TONIGHT

XX PM-

XX AM

XX MPH

MAXTMUM

SPEED XX MPH

MINIMUM

SPEED XX MPH

ADVISORY

XX MPH

RIGHT

LANE EXIT

CAUTION

DRIVE SAFELY

For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections

one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location. 3. For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangen sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer. Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List"

5. Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability. 5. The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

GENERAL DESIGN REQUIREMENTS Pre-qualified plastic drums shall meet the following requirements: Plastic drums shall be a two-piece design; the "body" of the drum shall

be the top portion and the "base" shall be the bottom. The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles. 3. Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.

Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches. 5. The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to

allow attachment of a warning light, warning reflector unit or approved compliant sign. 6. The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectorized space between any two adjacent stripes shall not exceed 2 inches in

Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base. Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material. 9. Drum body shall have a maximum unballasted weight of 11 lbs. 10.Drum and base shall be marked with manufacturer's name and model number.

RETROREFLECTIVE SHEETING

1. The stripes used on drums shall be constructed of sheeting meeting the . The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of etroreflectivity other than that loss due to abrasion of the sheeting

1. Unballasted bases shall be large enough to hold up to 50 lbs. of sand. 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches. 2. Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or

a solid rubber base. 6. Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list . The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.

5. When used in regions susceptible to freezing, drums shall have drainage

holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle. Ballast shall not be placed on top of drums. Adhesives may be used to secure base of drums to pavement.

Approved manufacturers are shown on the CWZTCD List. Ballast shall be as approved by the manufacturers instructions.

reflective sheeting being orange. Taper to allow minimum of 5 Base (36" This detail is not intend and the CWZTCD list for Detectable Pedestrian

— 9/16" dia, (typ)

warning lights


Each drum shall have

a minimum of 2 orange

and 2 white stripe

using Type A retro

signs and

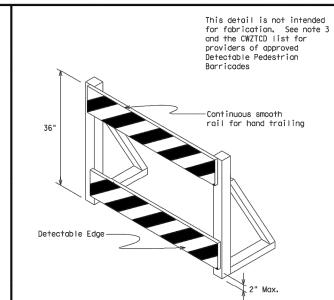

DETECTABLE PEDESTRIAN BARRICADES

with a visual disability traveling with the aid of a long cane shall be placed across the full width of the closed sidewalk. Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, same concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the

"Americans with Disabilities Act Accessibility Guidelines for Buildings and Facilities (ADAAG)" and should not be used as a control for pedestrian movements. Warning lights shall not be attached to detectable pedestrian 6. Detectable pedestrian barricades may use 8" nominal

18" x 24" Sian Chevron CW1-8, Opposing Traffic Lane mount with diagonals

-07 8-14

by Engineer

12" x 24" Divider, Driveway sign D70a, Keep Right sloping down towards R4 series or other signs as approved travel way

Plywood, Aluminum or Metal sign substrates shall NOT be used on plastic drums

SIGNS, CHEVRONS, AND VERTICAL PANELS MOUNTED ON PLASTIC DRUMS

. Signs used on plastic drums shall be manufactured using Chevrons and other work zone signs with an orange background shall be manufactured with Type B_{FI} or Type C_{FI} Orange sheeting meeting the color and retroreflectivity requirement

of DMS-8300, "Sign Face Material," unless otherwise


Vertical Panels shall be manufactured with orange and white sheeting meeting the requirements of DMS-8300 Type A Diagonal stripes on Vertical Panels shall slope down toward the intended traveled lane. . Other sign messages (text or symbolic) may be used as

approved by the Engineer. Sign dimensions shall not exceed 18 inches in width or 24 inches in height, except for the R9 series signs discussed in note 8 below. 5. Signs shall be installed using a 1/2 inch bolt (nomingl) and nut, two washers, and one locking washer for each

. Mounting bolts and nuts shall be fully engaged and adequately torqued. Bolts should not extend more than 1/2

. Chevrons may be placed on drums on the outside of curves. on merging tapers or on shifting tapers. When used in these locations they may be placed on every drum or spaced not more than on every third drum. A minimum of three (3) should be used at each location called for in the plans.

3. R9-9, R9-10, R9-11 and R9-11a Sidewalk Closed signs which are 24 inches wide may be mounted on plastic drums, with approval of the Engineer.



BC(8)-14 4-03 7-13 9-07 8-14

Δ PE DATE 12/22/2021 PROJECT NO. 03473.001 DRAWN BY CG CHECKED BY CLM REVISIONS

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101

San Antonio, Texas 78231

P:(210) 681.2951 F: (210) 523.7112

TER

4

9

4

C

4

0

 The "CAUTION" display consists of four corner lamps flashing simultaneously, or the Alternating Diamond Caution mode as shown.
 The straight line caution display is NOT ALLOWED. The Flashing Arrow Board shall be capable of minimum 50 percent dimming from rated lamp voltage. The flashing rate of the lamps shall not be less than 25 nor more than 40 flashes per minute.

8. Minimum lamp "on time" shall be approximately 50 percent for the flashing arrow and equal intervals of 25 percent for each sequential phase of the flashing chevron.

9. The sequential arrow display is NOT ALLOWED. display may be used during daylight operations.

11. The Flashing Arrow Board shall be mounted on a vehicle, trailer or other suitable support.

12. A Flashing Arrow Board SHALL NOT BE USED to laterally shift traffic.

13. A full matrix PCMS may be used to simulate a Flashing Arrow Board provided it meets visibility, flash rate and dimming requirements on this sheet for the same size arrow.

14. Minimum mounting height of trailer mounted Arrow Boards should be 7 feet from roadway WHEN NOT IN USE, REMOVE THE ARROW BOARD FROM THE RIGHT-OF-WAY OR PLACE THE SHEET 7 OF 12 Texas Department of Transportation BARRICADE AND CONSTRUCTION ARROW PANEL. REFLECTORS. **WARNING LIGHTS & ATTENUATOR** BC(7)-14

CHEVRON ARROW

IRECTION INDICATOR BARRICADE

The Direction Indicator Barricade may be used in tapers. transitions, and other areas where specific directional grantations, and other areas where specific directional guidance to drivers is necessory.

If used, the Direction Indicator Barricade should be used in series to direct the driver through the transition and into the intended travel lane.

The Direction Indicator Barricade shall consist of One-Direction lands areas (CMI) because the process of the pr Large Arrow (CW1-6) sign in the size shown with a black arrow

FULL MATRIX PCMS SIGNS

CHANGEABLE MESSAGE SIGNS" above.

shall maintain the legibility/visibility requirement listed above.

Top should not

allow collection

on a background of Type B_{FL} or Type C_{FL} orange retroreflective sheeting above a rail with Type A retroreflective sheeting in alternating 4" white and orange stripes sloping downword at an angle of 45 degrees in the direction road users are to pass. Sheeting types shall be as per DMS 8300.

Double arrows on the Direction Indicator Barricade will not be allowed.

1. When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility.


2. Where pedestrians with visual disabilities normally use the closed sidewalk, a device that is detectable by a person with a visual disability traveling with the cid of a long cone.


barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTIO

JOSE A. LOZANO T&PE No. 455 TBPLS No. 10048500

21 of 24

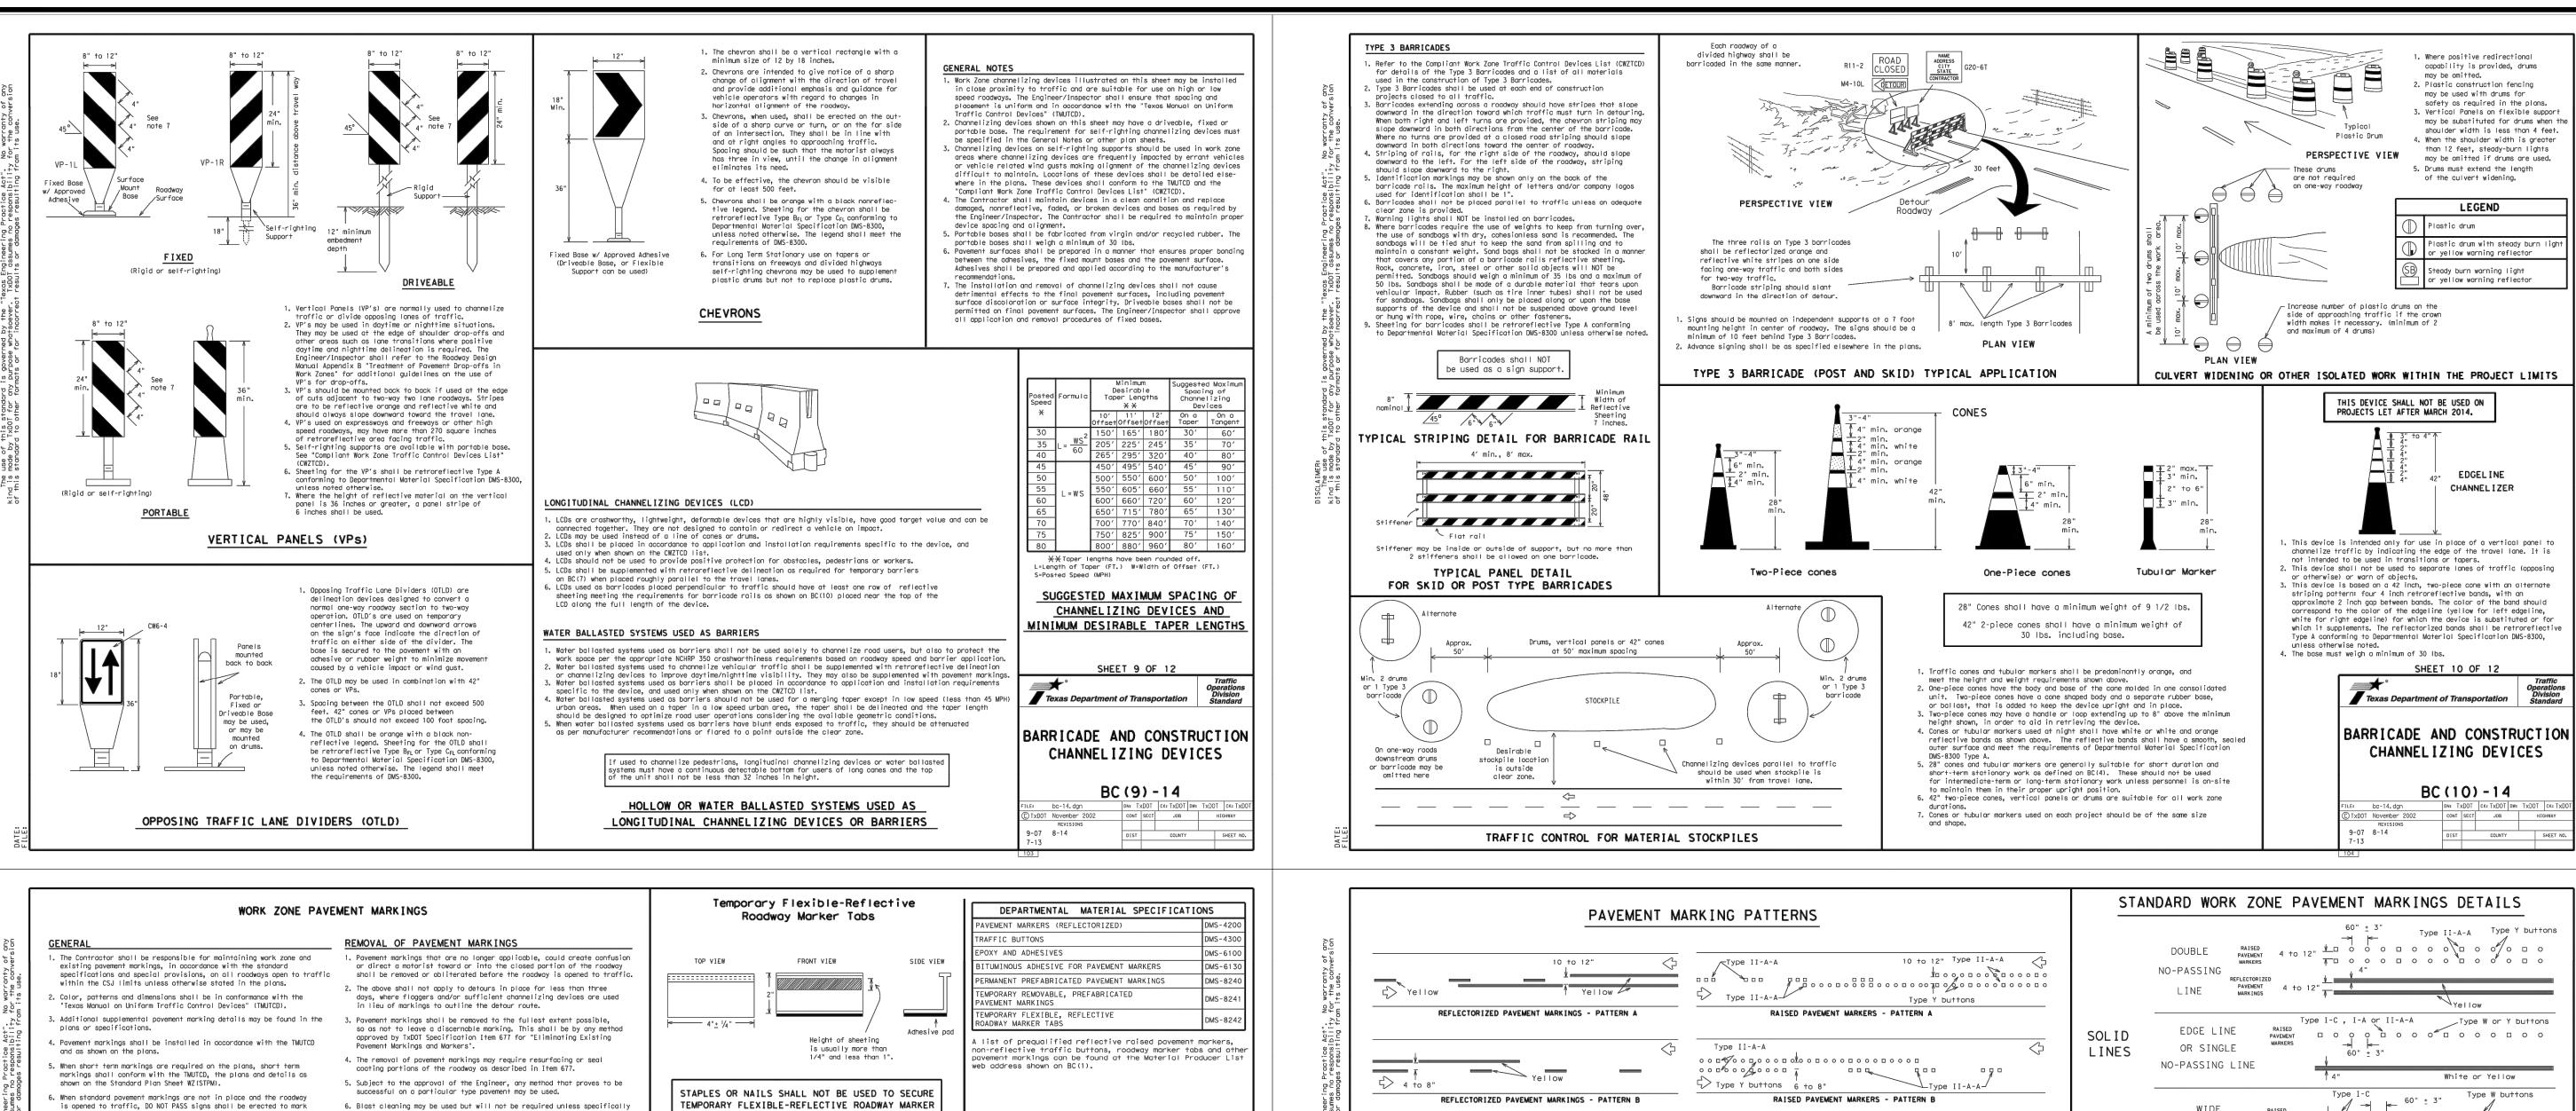

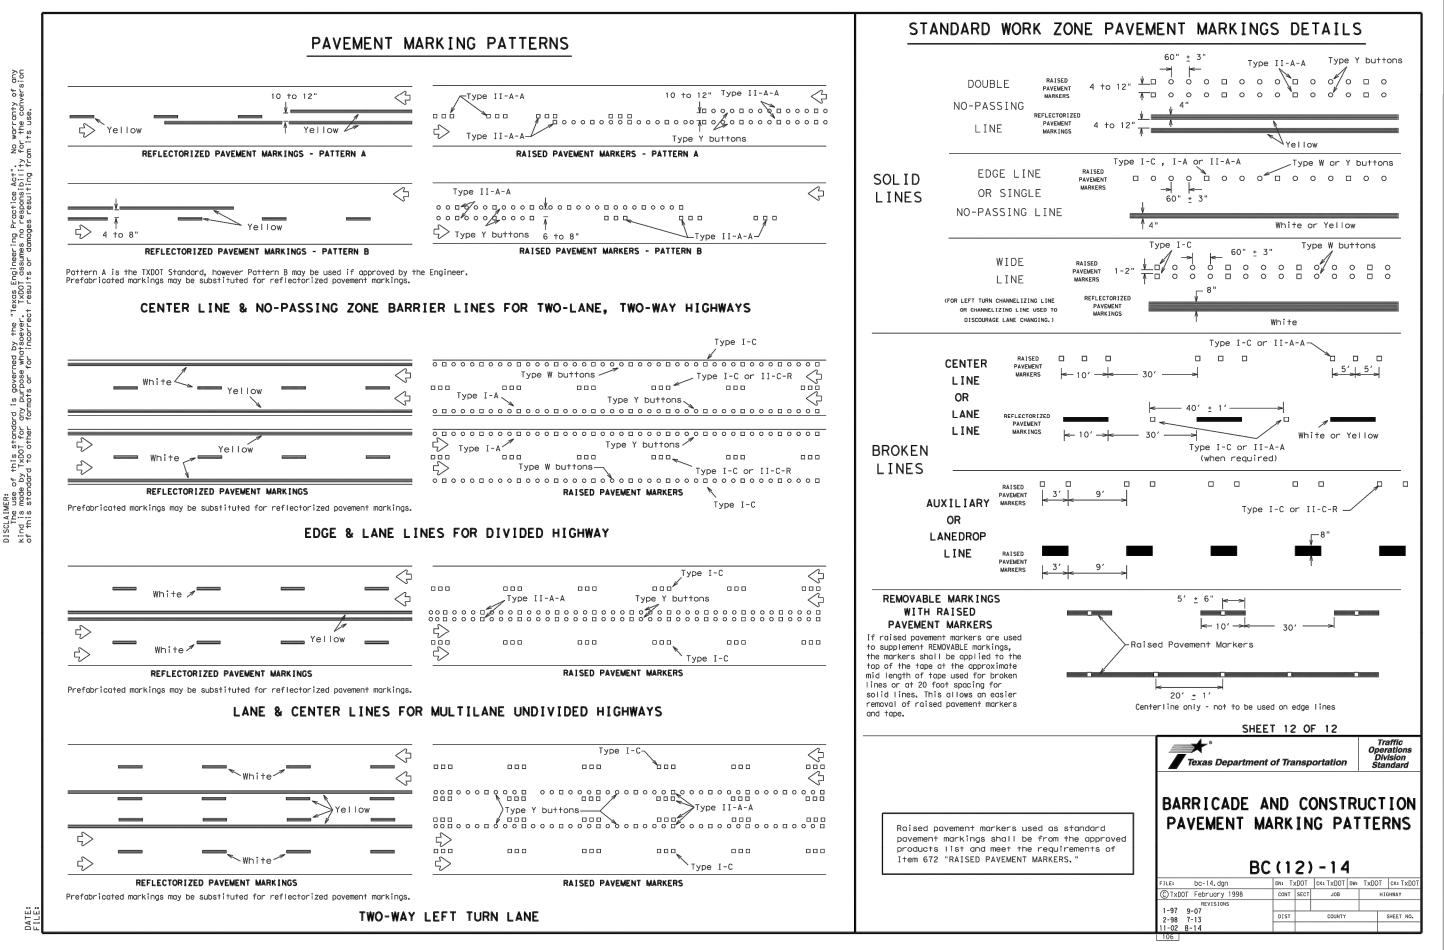

CUDEENGINEERS.COM 4122 Pond Hill Road, Suite 101

San Antonio, Texas 78231 P:(210) 681.2951 F: (210) 523.7112

TER Σ 4 Ш 9 **Q Q** C

4

2

노 C PE \triangleleft S

Q

DATE 12/22/2021 PROJECT NO.

03473.001

DRAWN BY

CG

CHECKED BY CLM

REVISIONS

JOSE A. LOZANO 126773

> T&PEINo. 455 TBPLS No. 10048500

22 of 24 REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTIC

with Item 662, "Work Zone Pavement Markings." Temporary flexible-reflective roadway marker tabs used as guidemarks shall meet the requirements of DMS-8242. 9. Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT Tabs detailed on this sheet are to be inspected and accepted by the RAISED PAVEMENT MARKERS MARKINGS AND MARKERS, " unless otherwise stated in the plans. Engineer or designated representative. Sampling and testing is not normally required, however at the option of the Engineer, either "A" 1. Raised pavement markers are to be placed according to the patterns 10. Black-out marking tape may be used to cover conflicting existing or "B" below may be imposed to assure quality before placement on the markings for periods less than two weeks when approved by the Engineer. 2. All raised payement markers used for work zone markings shall meet the requirements of 1tem 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300. A. Select five (5) or more tabs at random from each lot or shipment and submit to the Construction Division, Materials and Pavement Section to determine specification compliance. B. Select five (5) tabs and perform the following test. Affix five PREFABRICATED PAVEMENT MARKINGS (5) tabs at 24 inch intervals on an asphaltic pavement in a straight line. Using a medium size passenger vehicle or pickup, run over the markers with the front and rear tires at a speed 1. Removable prefabricated pavement markings shall meet the requirements of 35 to 40 miles per hour, four (4) times in each direction. No 2. Non-removable prefabricated pavement markings (foil back) shall meet more than one (1) out of the five (5) reflective surfaces shall the requirements of DMS-8240. be lost or displaced as a result of this test. Small design variances may be noted between tab manufacturers. MAINTAINING WORK ZONE PAVEMENT MARKINGS 4. See Standard Sheet WZ(STPM) for tab placement on new pavements. See Standard Sheet TCP(7-1) for tab placement on seal coat work. 1. The Contractor will be responsible for maintaining work zone pavement markings within the work limits. 2. Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599. RAISED PAVEMENT MARKERS USED AS GUIDEMARKS 3. The markings should provide a visible reference for a minimum Raised pavement markers used as guidemarks shall be from the approved product list, and meet the requirements of DMS-4200. distance of 300 feet during normal daylight hours and 160 feet when Iluminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics. All temporary construction raised pavement markers provided on a project shall be of the same manufacturer. 4. Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per 3. Adhesive for guidemarks shall be bituminous material hot applied or butyl rubber pad for all surfaces, or thermoplastic for concrete Guidemarks shall be designated as: YELLOW - (two amber reflective surfaces with yellow body). WHITE - (one silver reflective surface with white body). SHEET 11 OF 12 Texas Department of Transportation BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS BC(11)-14

7. Over-painting of the markings SHALL NOT BE permitted.


8. Removal of raised pavement markers shall be as directed by the


TABS TO THE PAVEMENT SURFACE

e beginning of the sections where passing is prohibited and

PASS WITH CARE signs at the beginning of sections where passing

. All work zone pavement markings shall be installed in accordance

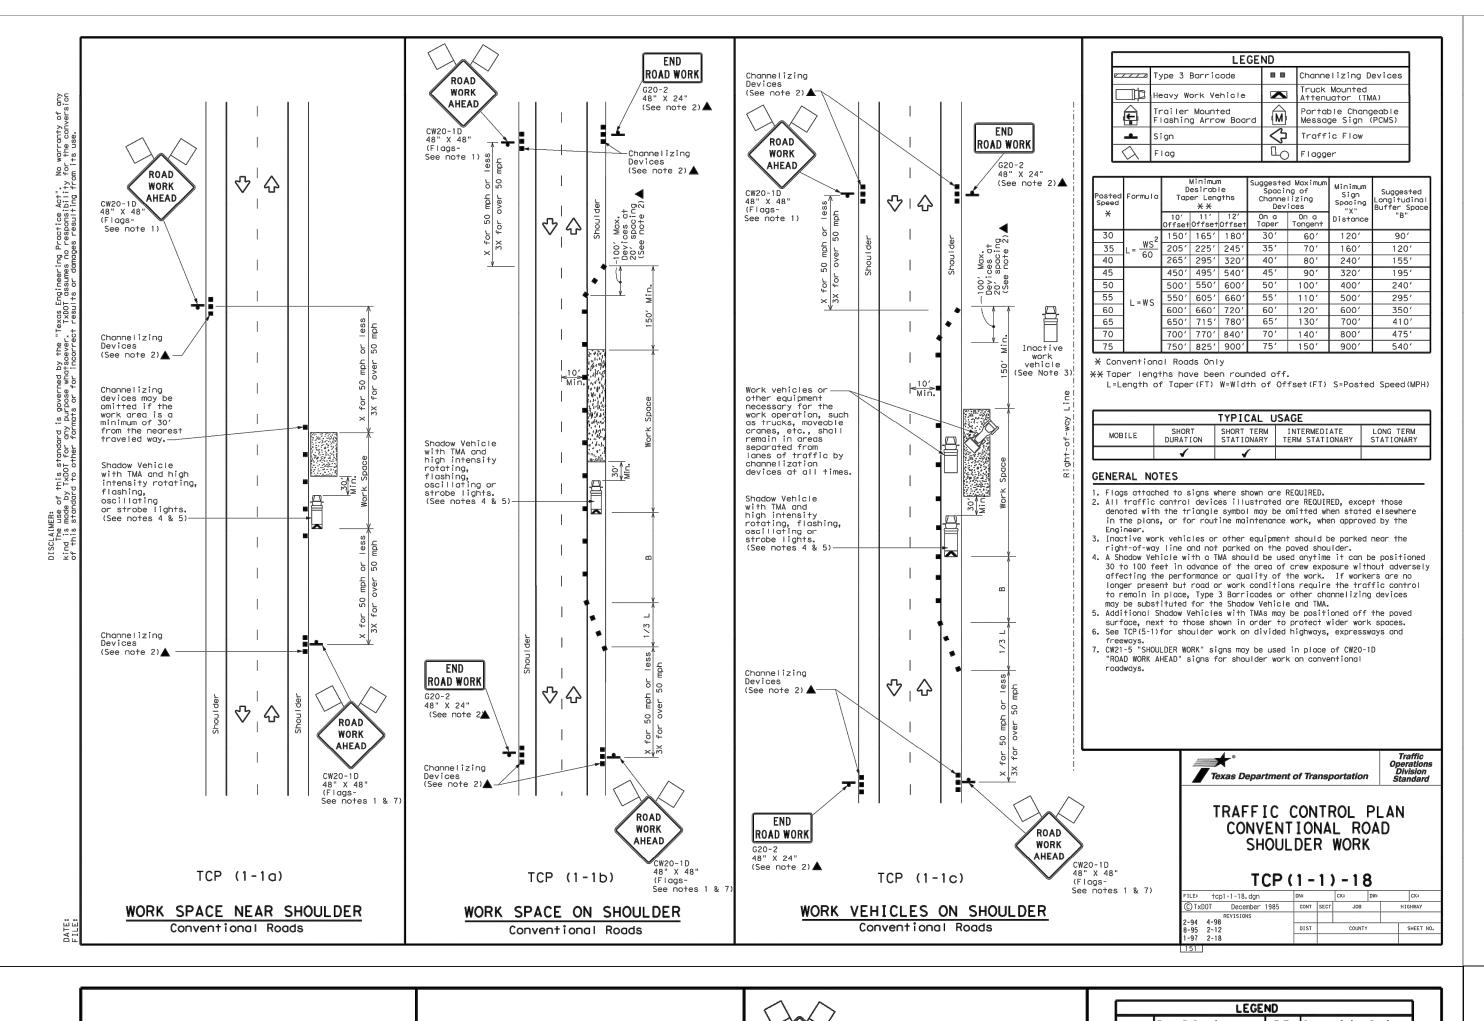

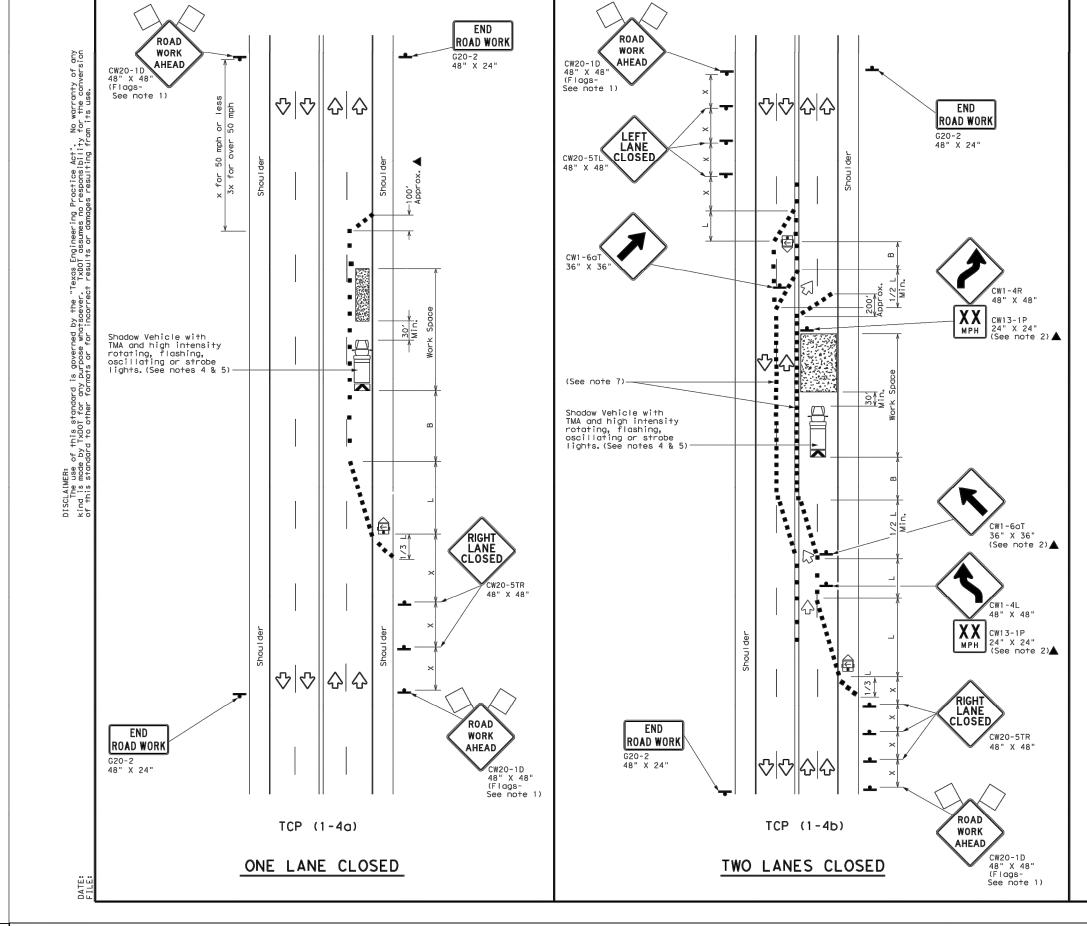

Shoulder

120'-200' Approx.

TCP (3-1a)

UNDIVIDED MULTILANE ROADWAY

Shou I der

**


See note 9 and

WORK ON SHOULDER

See note 9 and Trail/Shadow Vehicle B

Trail/Shadow Vehicle B

─See Note 9 and Trail/Shadow Vehicle A —

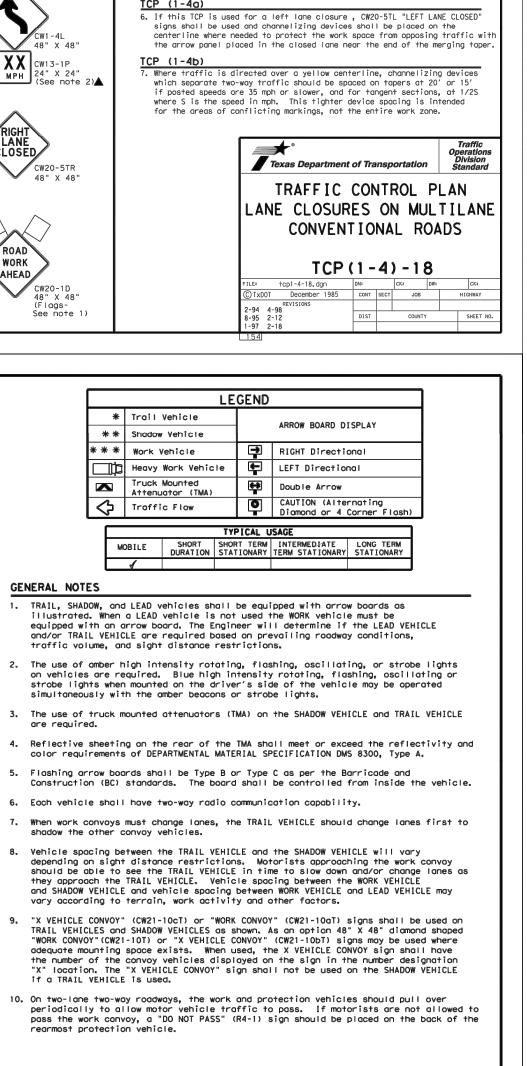

-Red Reflective

STRIPING FOR TMA

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE SCALE OF THE DOCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION

─White Reflective


Texas Department of Transportation

TRAFFIC CONTROL PLAN

MOBILE OPERATIONS

UNDIVIDED HIGHWAYS

TCP(3-1)-13

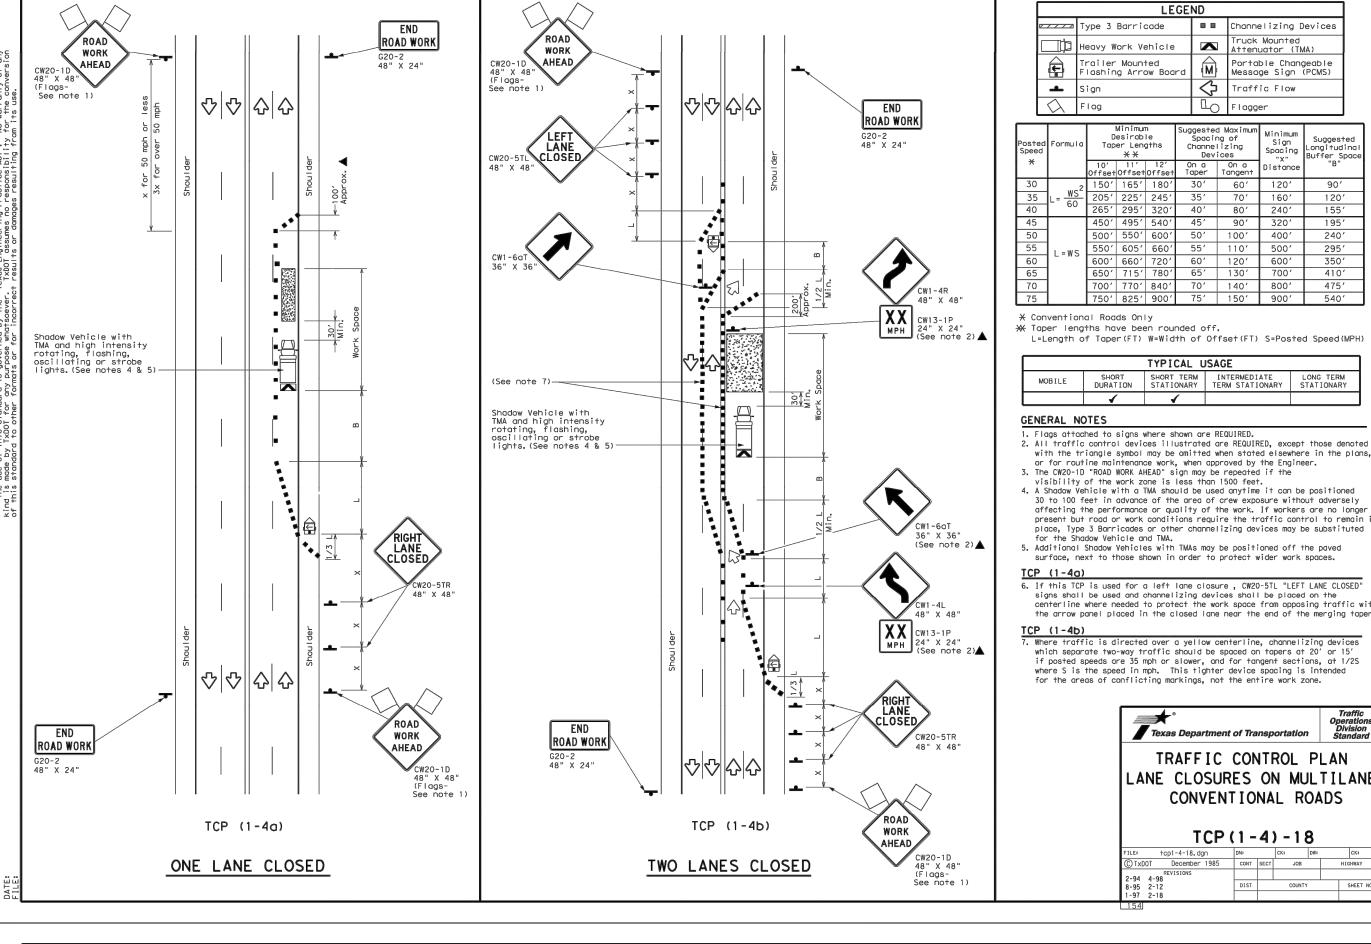

X VEHICLE

CONVOY

See note 9 and

X VEHICLE

CONVOY

WORK ON TRAVEL LANE

➪

Forward Facing

Trail/Shadow Vehicle A ---

WORK

CONVOY

X VEHICLE

CONVOY

TRAIL/SHADOW VEHICLE

with Flashing Arrow Board in CAUTION display

•••••

X VEHICLE

CONVOY

TRAIL/SHADOW VEHICLE

with RIGHT Directional display Flashing Arrow Board

Lead Vehicle with strobes—

Approx.
See note 8

TCP (3-1b)

TWO-WAY ROADWAY WITH PAVED SHOULDERS

-Work Vehicle with strobes

See note 8

TCP (3-1c)


TWO-WAY ROADWAY WITHOUT PAVED SHOULDERS


<>>

<>

| WORK

CONVOY

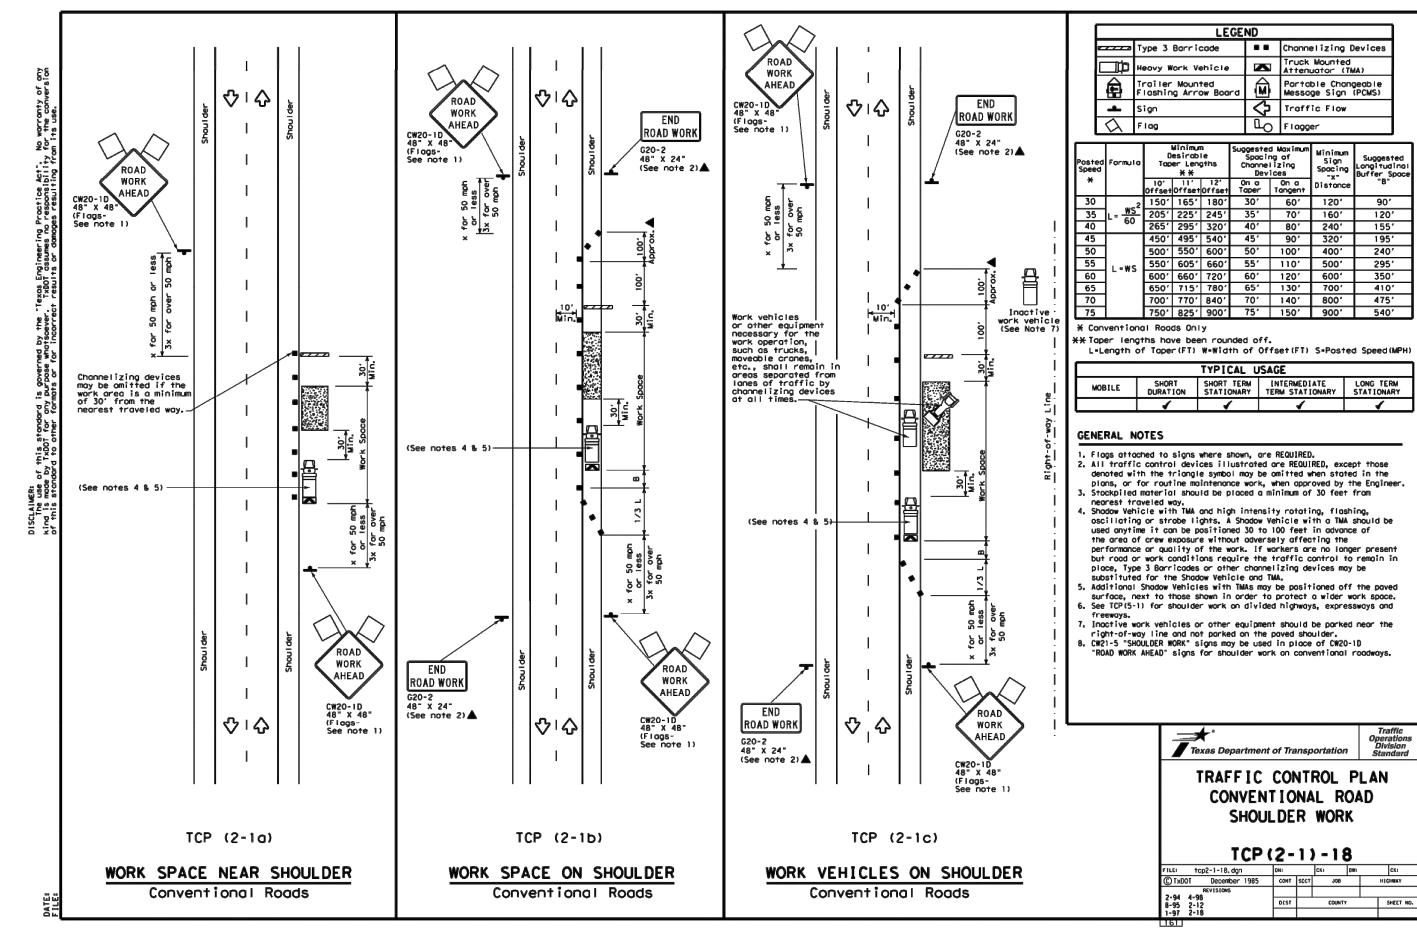

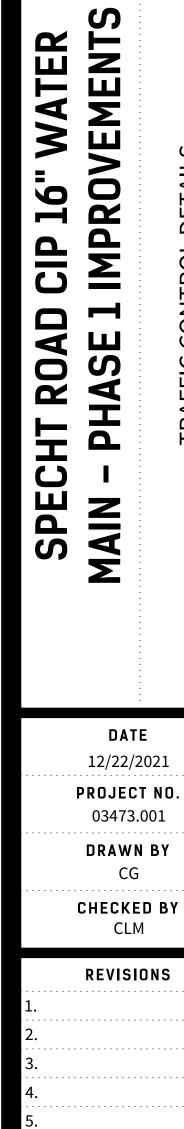

CUDEENGINEERS.COM

4122 Pond Hill Road, Suite 101

San Antonio, Texas 78231 P:(210) 681.2951 F: (210) 523.7112


JOSE A. LOZANO


126773

CUDE ENGINEERS


T&PE No. 455

TBPLS No. 10048500

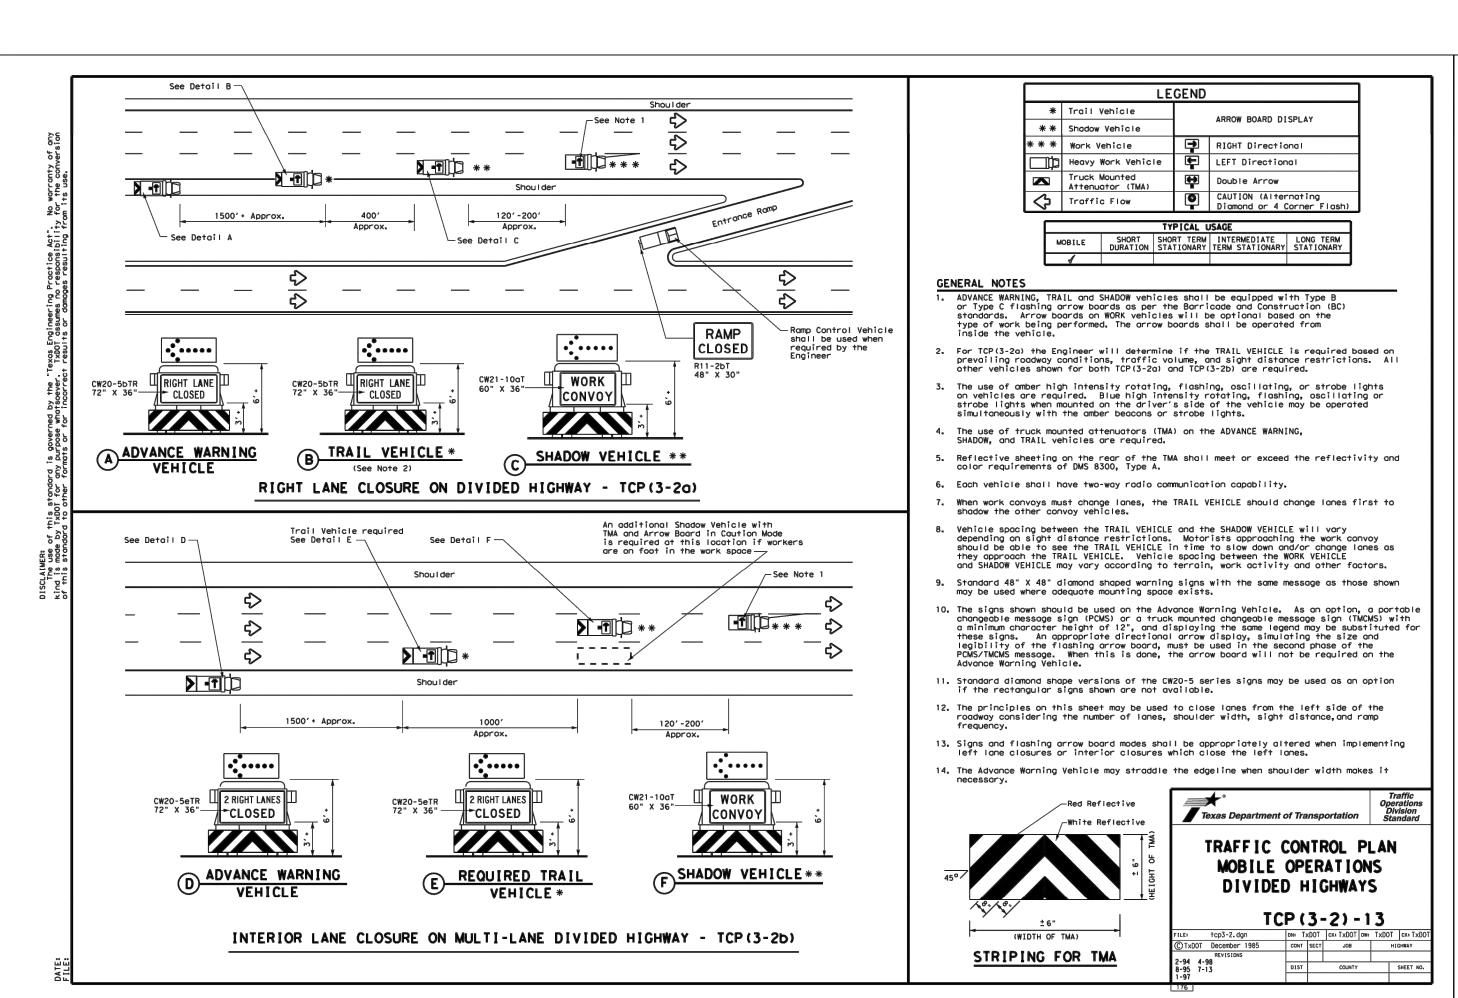

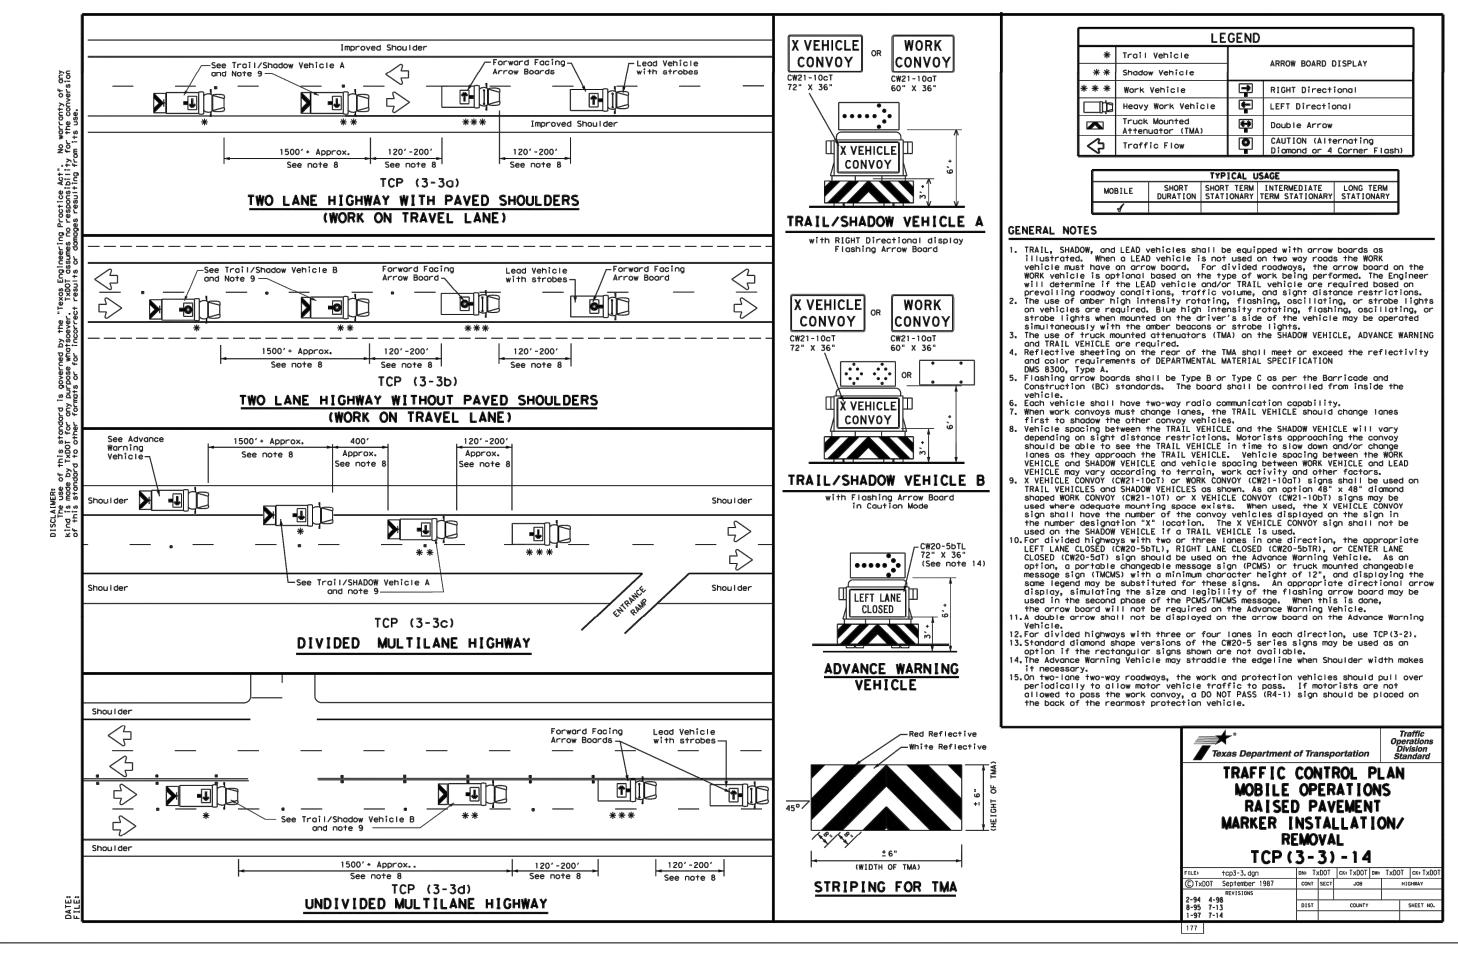

REPRODUCTION OF THE ORIGINAL SIGNED AND SEALED PLAN AND/OR ELECTRONIC MEDIA MAY HAVE BEEN INADVERTENTLY ALTERED. CONTRACTOR IS RESPONSIBLE FOR VERIFYING THE OCCUMENT AND CONTACTING CUDE ENGINEERS TO VERIFY DISCREPANCIES PRIOR TO CONSTRUCTION



4122 Pond Hill Road, Suite 101 San Antonio, Texas 78231 P:(210) 681.2951 F: (210) 523.7112

F:(210) 681.2951 F: (210) 52

OAD CIP 16" WATER SE 1 IMPROVEMENTS

PE

Q

DATE
12/22/2021
PROJECT NO.
03473.001
DRAWN BY

CG CHECKED BY CLM

REVISIONS



C24

24 of 24