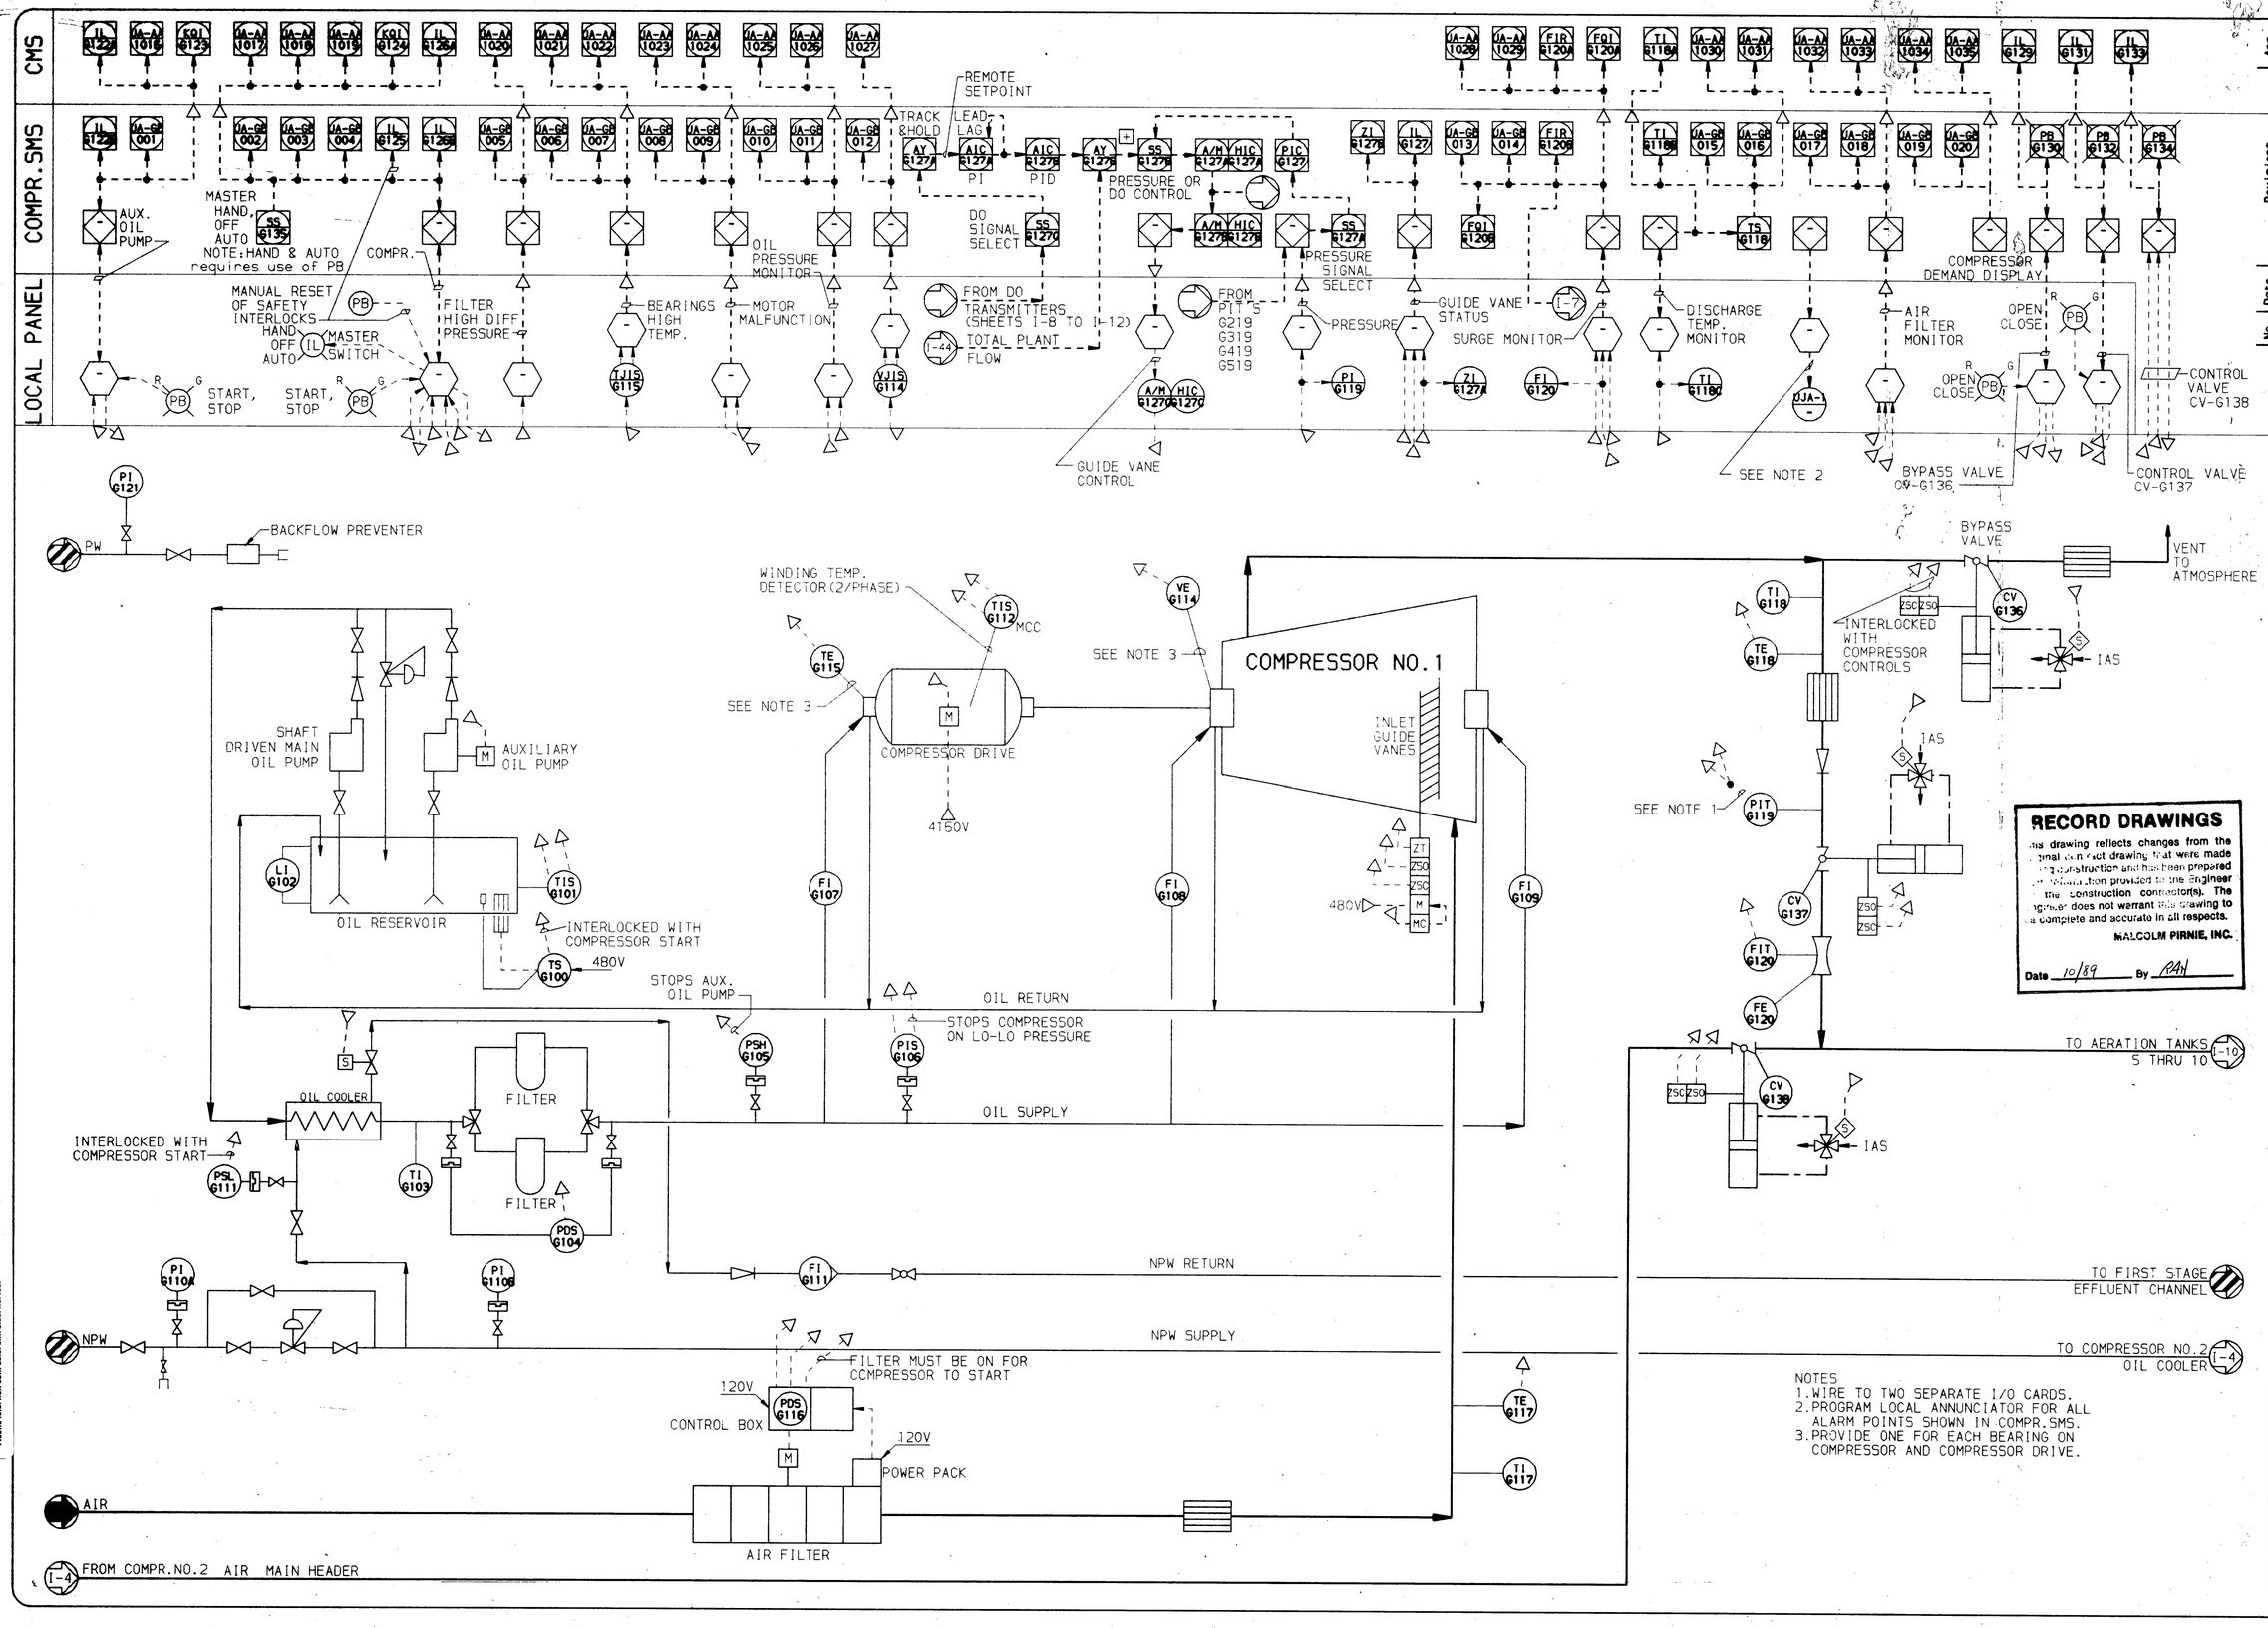

NOTES
1. WIRE TO TWO SEPARATE I/O CARDS.
2. PROGRAM LOCAL ANNUNCIATOR FOR ALL ALARM POINTS SHOWN IN COMPR.SMS.
3. PROVIDE ONE FOR EACH BEARING ON COMPRESSOR AND COMPRESSOR DRIVE.

Drawing No. 410N-84.252-0

App. | Revisions | Date | No.

MALCOLM PIRNIE

Date APRIL 1984
Designed by RH
Drawn by GPG
Checked by HIL
Scale NO SCALE

STATE OF TEXAS — ROBERT J. BONNER — 47446 — REGISTERED PROFESSIONAL ENGINEER

Wastewater Facilities Improvements
San Antonio

CONTRACT NO. 2
DOS RIOS FACILITY
PROCESS AIR COMPRESSOR NO.1
PROCESS & INSTRUMENTATION

Sheet I-3 of I-65

DR 84-6501

9100541