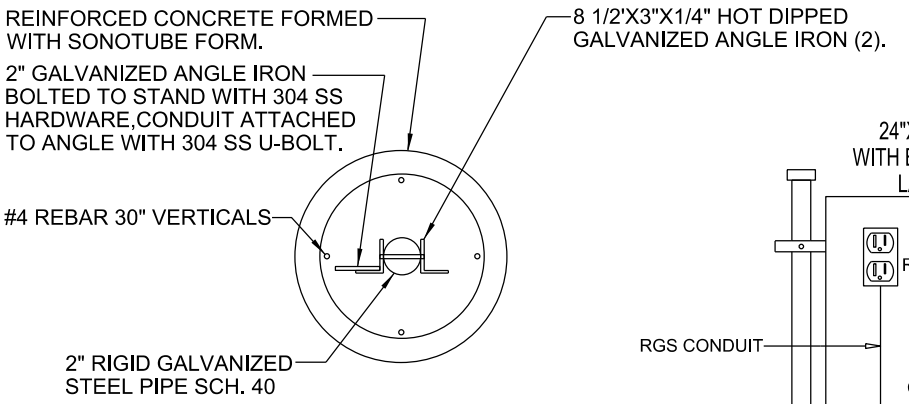

A PLAN VIEW ANTENNA POLE & FOUNDATION
SCALE: N.T.S.

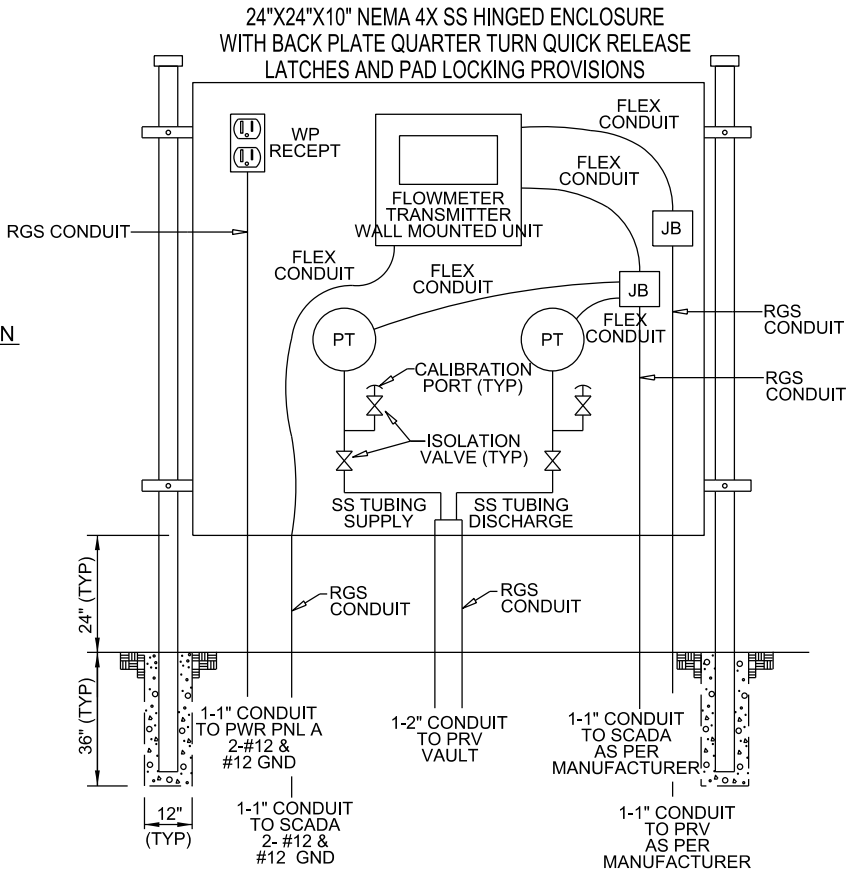

NOTE:
PRESSURE TRANSMITTERS SHALL BE INSTALLED WITH HEAT TRACE FREEZE PROTECTION AROUND THE FLUID HOUSING OF THE INSTRUMENT AND ALL PIPING, VALVES, AND FITTINGS.

C TRANSMITTER ENCLOSURE DETAIL
SCALE: N.T.S.

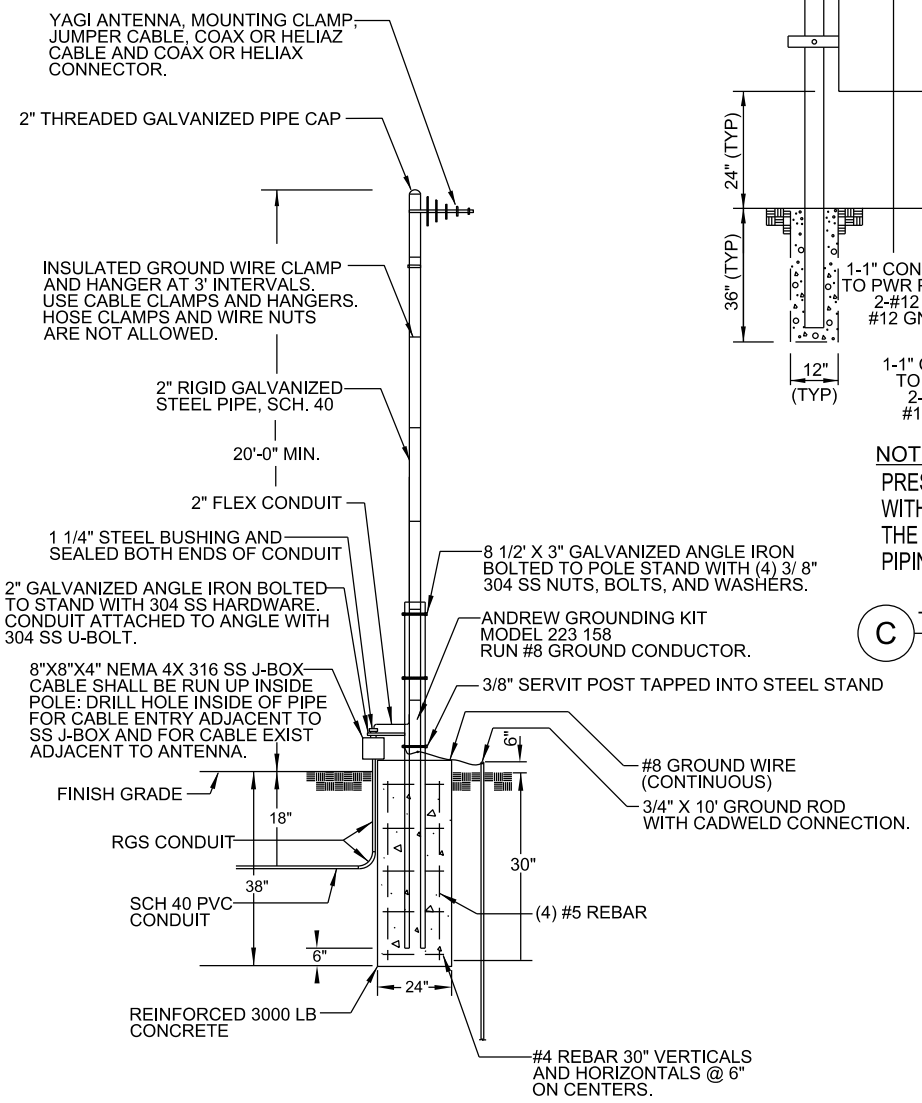

B SIDE VIEW ANTENNA POLE & FOUNDATION
SCALE: N.T.S.

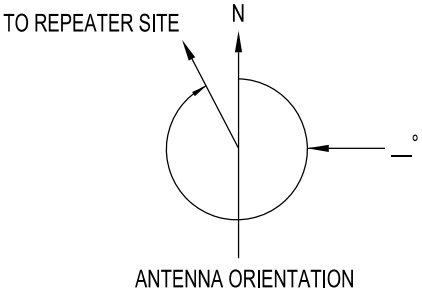

NOTE:
CONTRACTOR TO CONDUCT RADIO PATH STUDY TO DETERMINE SIGNAL STRENGTH TO REPEATER SITE, AND HEIGHT OF ANTENNA POLE.

DD-905-07	SAN ANTONIO WATER SYSTEM SAN ANTONIO, TEXAS	APPROVED: SEPTEMBER 2012
SHEET 1 OF 1	SCADA ANTENNA AND TRANSMITTER DETAIL	REVISED: