



A SCADA DIGITAL INPUT
SCALE: N.T.S.

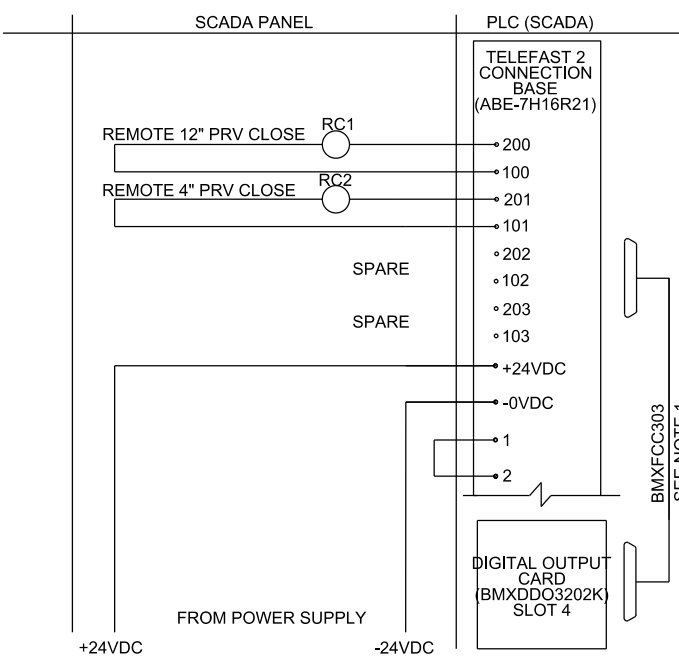

B SCADA DIGITAL OUTPUT
SCALE: N.T.S.

NOTE:
1. PROVIDE ADDITIONAL TELEFAST CONNECTION BASE FOR FUTURE DISCRETE I/O.



DD-905-10

SAN ANTONIO WATER SYSTEM
SAN ANTONIO, TEXAS



APPROVED:
SEPTEMBER 2012

SHEET
1 OF 1

SCADA DIGITAL I/O

REVISED: