


\* TO BE DETERMINED BY SAWS

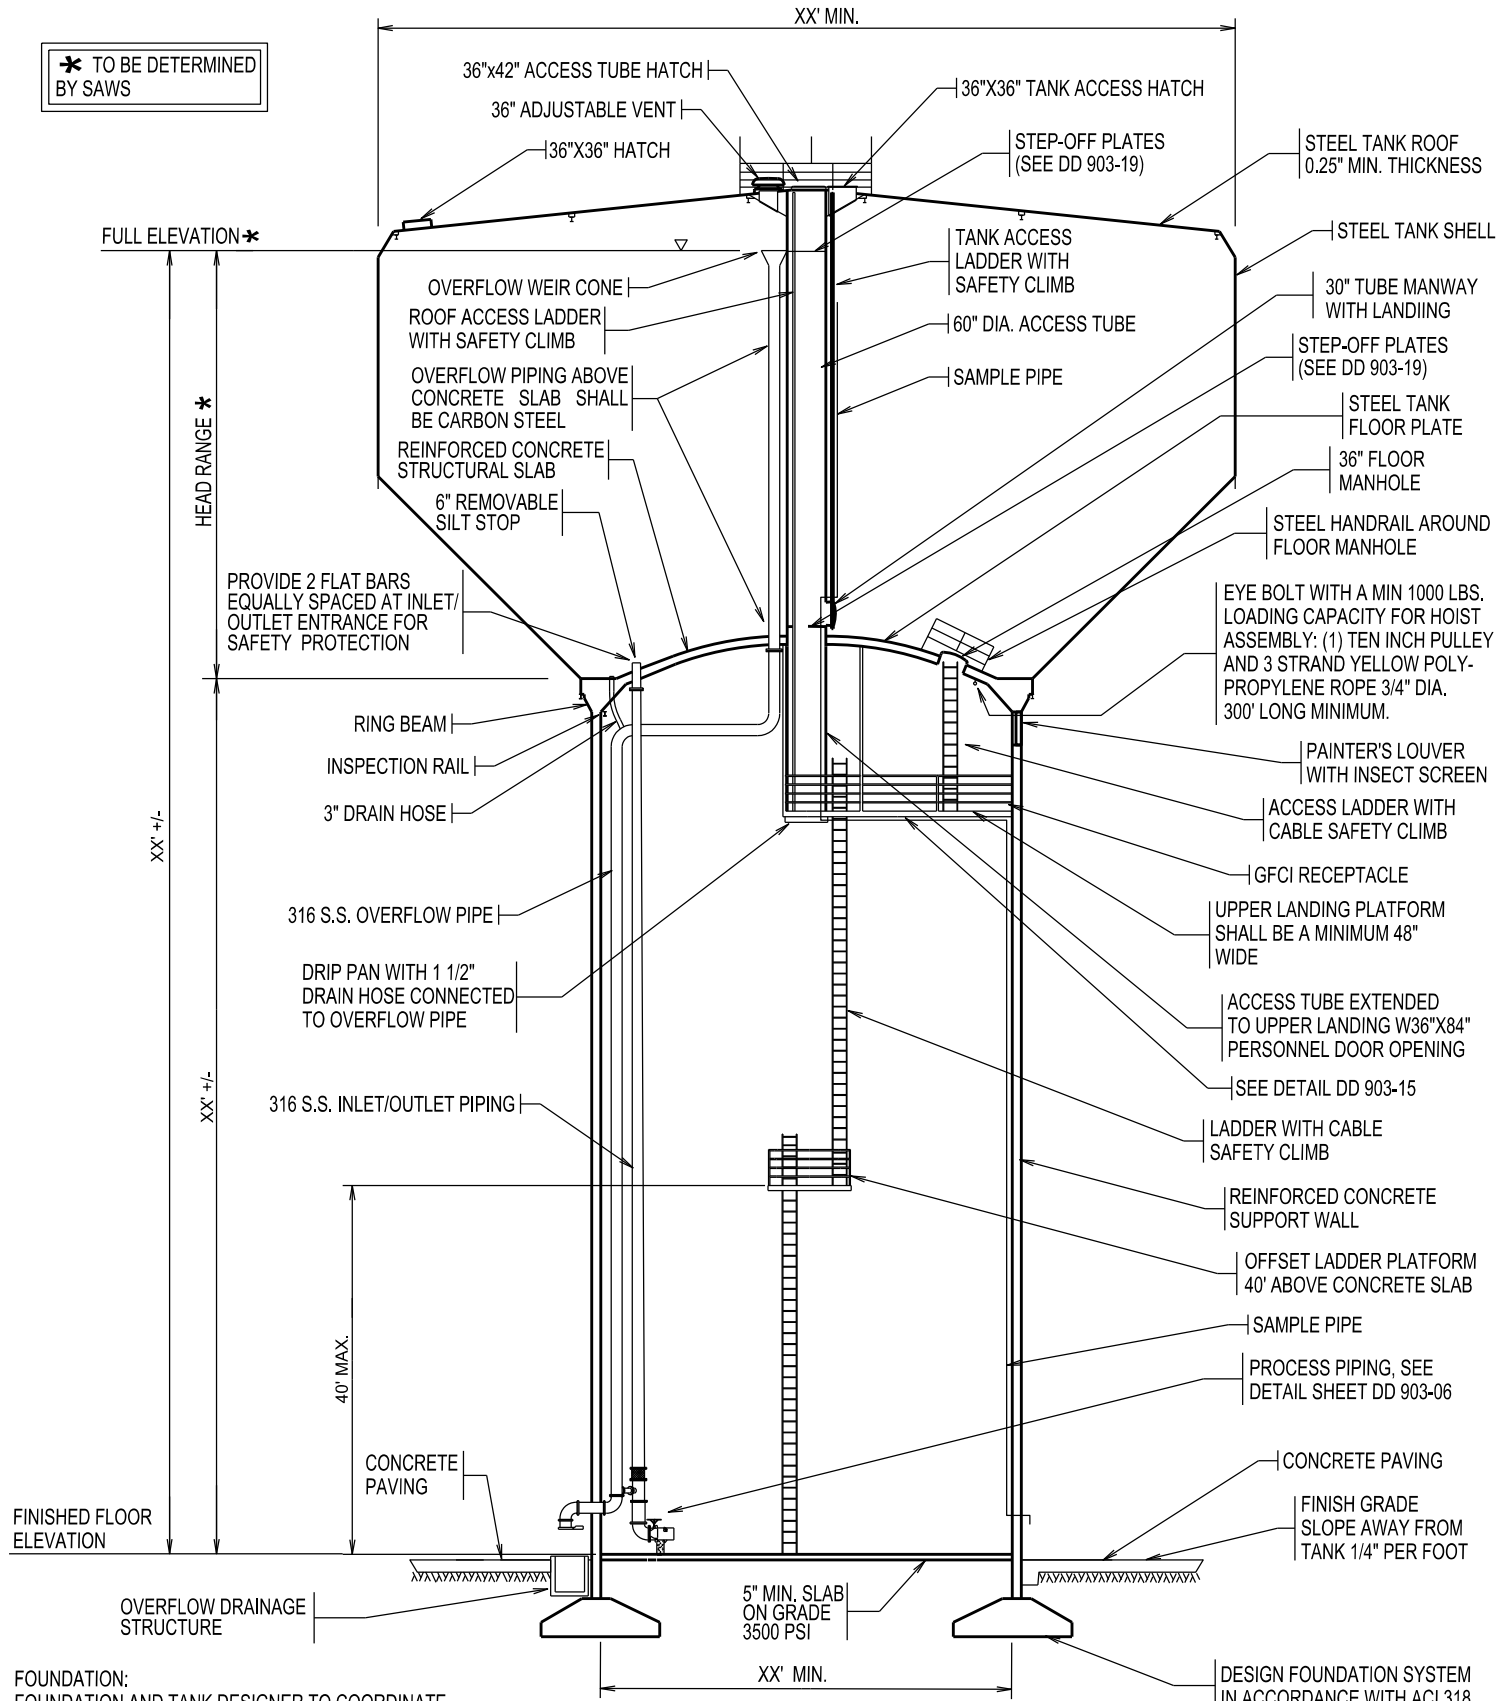

PROVIDE 2 FLAT BARS EQUALLY SPACED AT INLET/OUTLET ENTRANCE FOR SAFETY PROTECTION

EYE BOLT WITH A MIN 1000 LBS. LOADING CAPACITY FOR HOIST ASSEMBLY: (1) TEN INCH PULLEY AND 3 STRAND YELLOW POLY-PROPYLENE ROPE 3/4" DIA. 300' LONG MINIMUM.

FOUNDATION:  
FOUNDATION AND TANK DESIGNER TO COORDINATE WITH ELECTRIC AND MEP CONTRACTORS FOR REQUIRED BLOCKOUTS, CONDUITS, SLEEVES AND MOUNTING HARDWARE.

TANK APPURTENANCES ROTATED FOR CLARITY. ACTUAL LOCATION OF LADDERS TO BE NEXT TO INLET/OUTLET AND OVERFLOW PIPING

DESIGN FOUNDATION SYSTEM IN ACCORDANCE WITH ACI 318

DD-903-04

SAN ANTONIO WATER SYSTEM  
SAN ANTONIO, TEXAS



APPROVED:  
MARCH 2011

SHEET  
1 OF 1

ELEVATED STORAGE TANK - SECTION

REVISED: