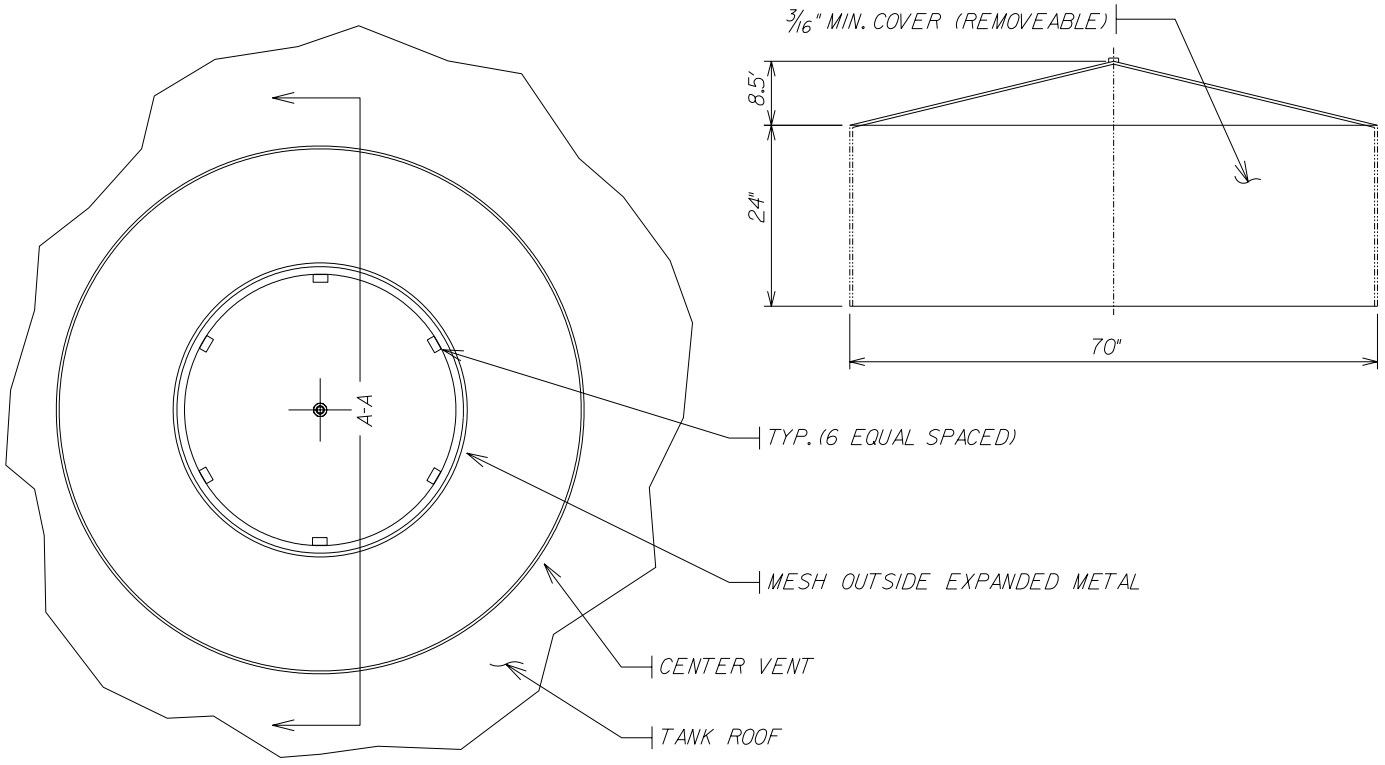

TOP VIEW

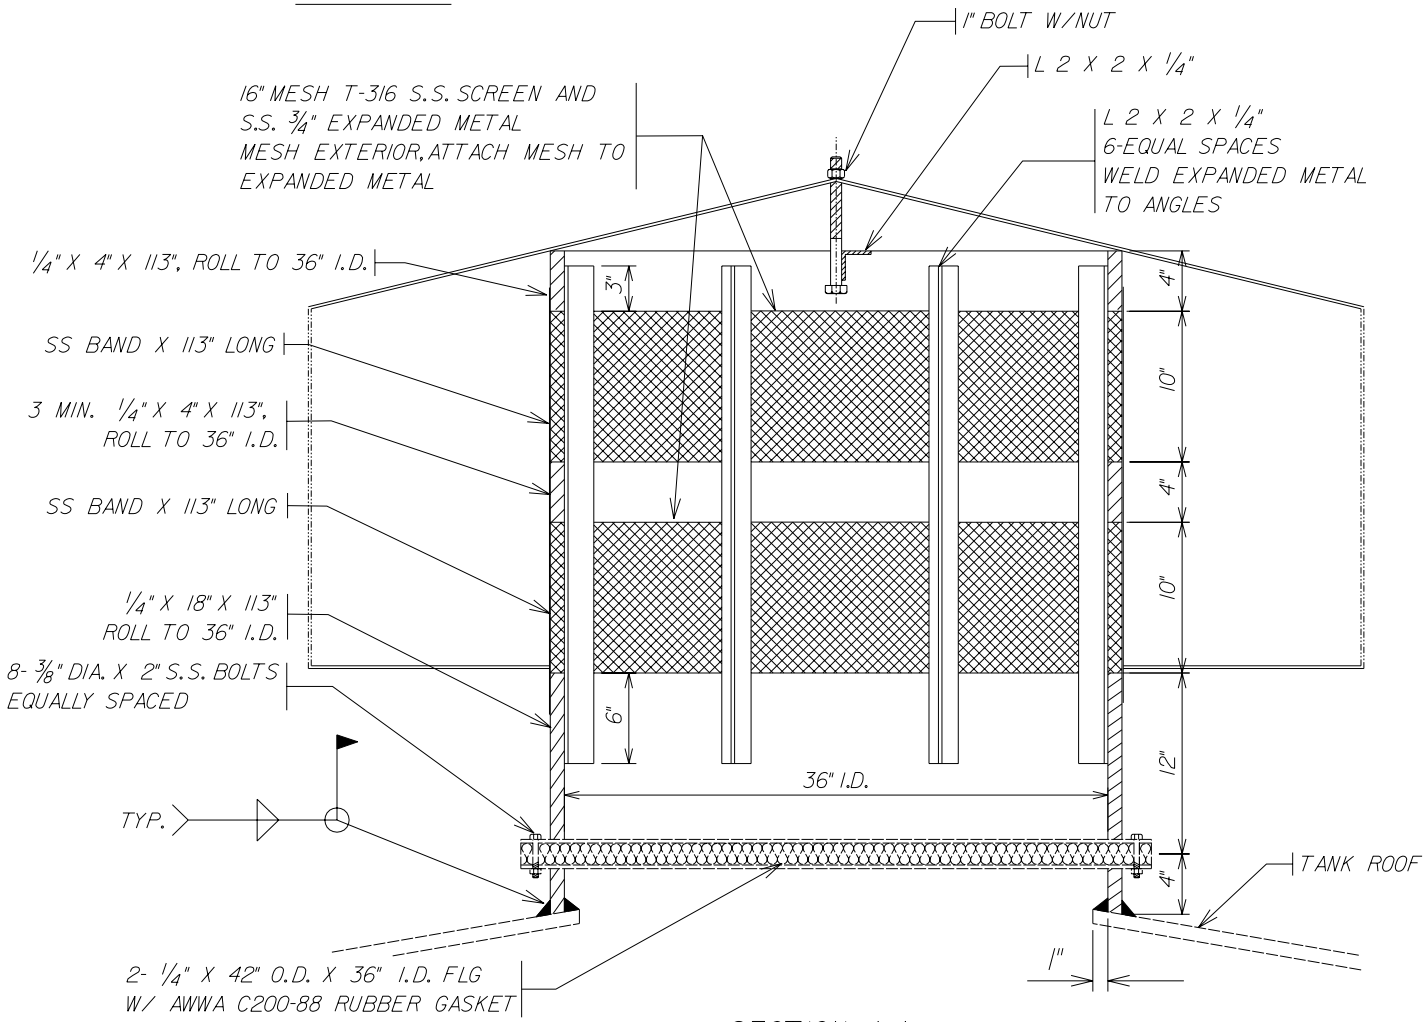

SECTION A-A

PROPERTY OF SAN ANTONIO WATER SYSTEM SAN ANTONIO, TEXAS	5 MG & LOWER CENTER VENT	APPROVED	REVISED
		7-14-00	9-11-03 / 11-23-04
		DD-900-09	SHEET 1 OF 1