


PIPE DIA.	MIN. DISTANCE
24"	36"
30"	39"
36"	42"
42"	45"
48"	48"
54"	51"
60"	54"

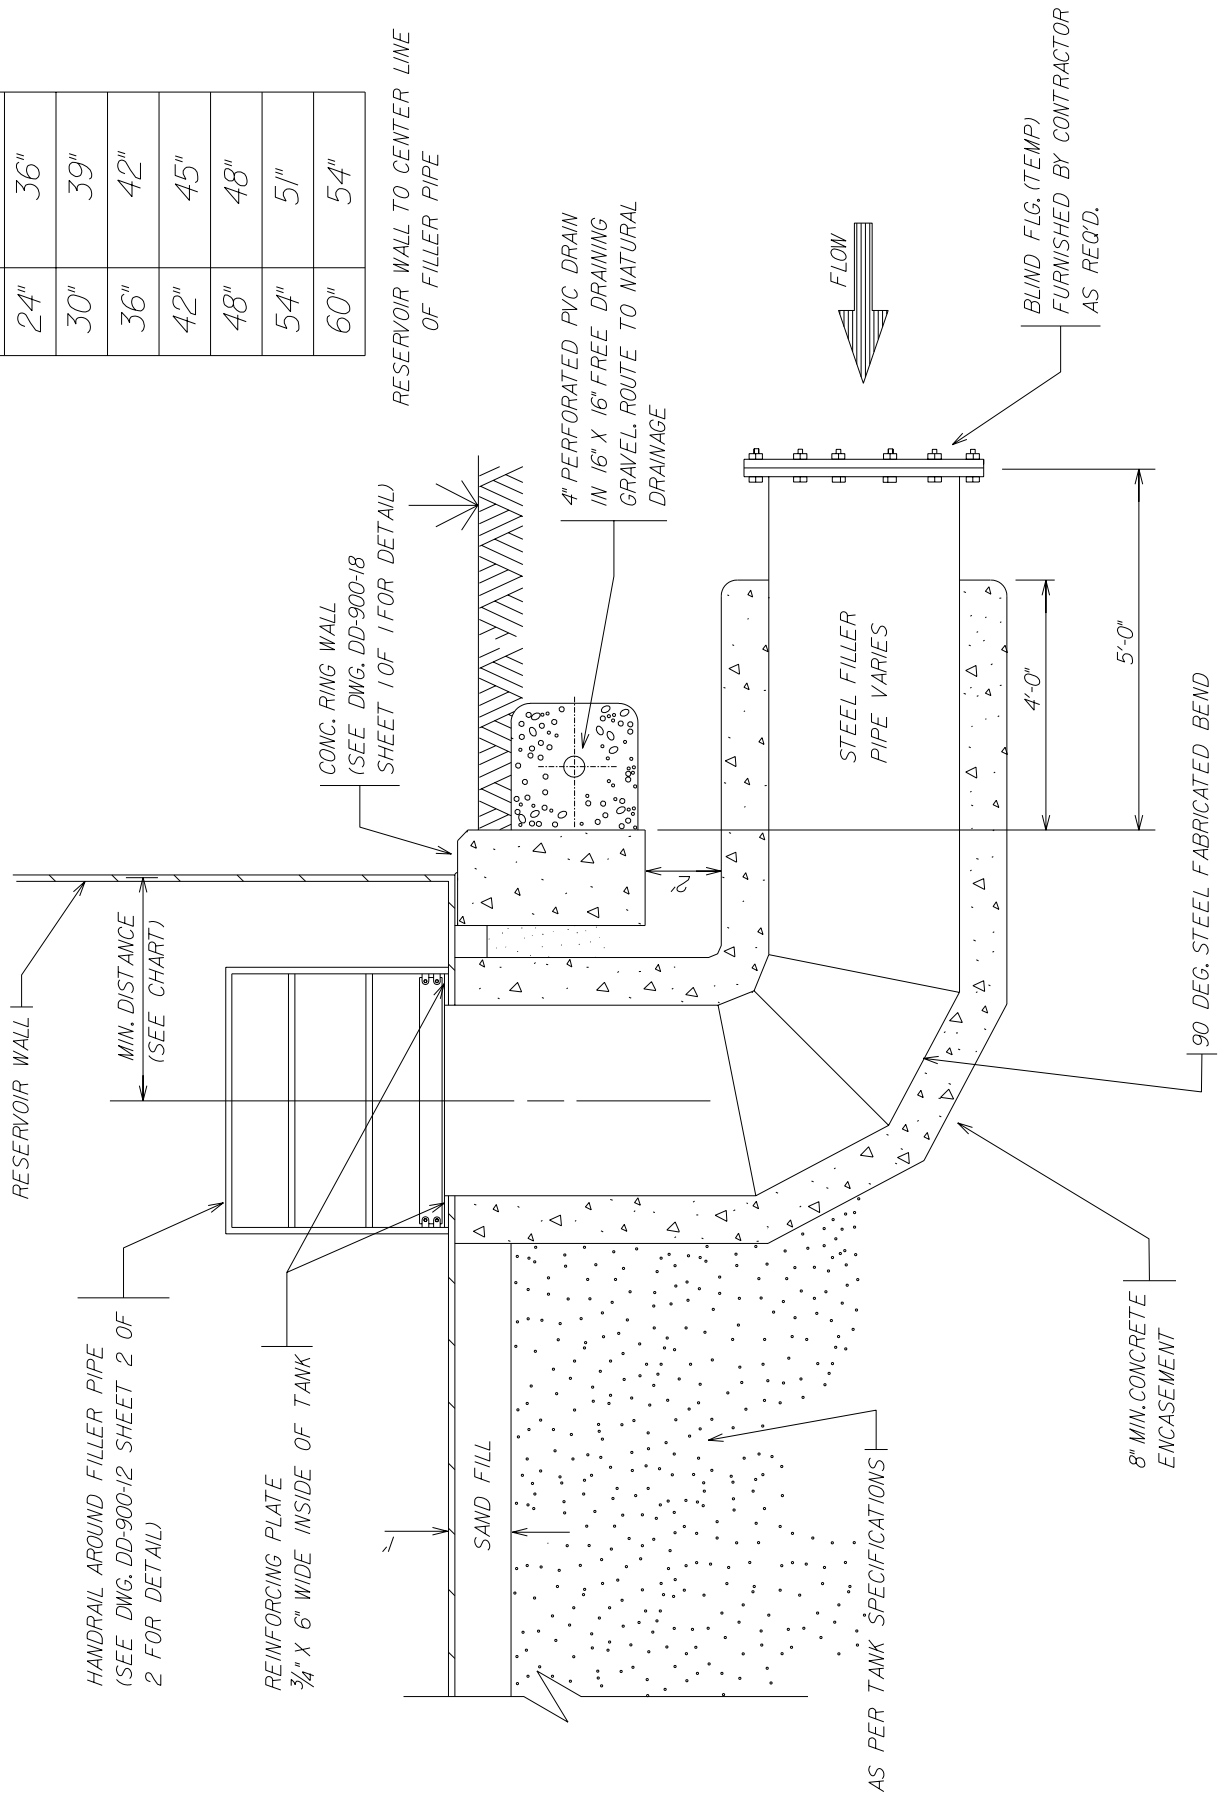

NOTE:
ALL WELDS SHALL BE CONTINUOUS FULL FILLET WELDS MINIMUM.
LARGER WELDS SHALL BE PROVIDED AS REQUIRED BY THE
TANK MANUFACTURER.

PROPERTY OF
SAN ANTONIO WATER SYSTEM
SAN ANTONIO, TEXAS

TANK INLET PIPE

APPROVED

7-14-00

REVISED

9-11-03

11-23-04

DD-900-11

SHEET
2 OF 2