


PIPE DIA.	MIN. DISTANCE
24"	36"
30"	39"
36"	42"
42"	45"
48"	48"
54"	51"
60"	54"

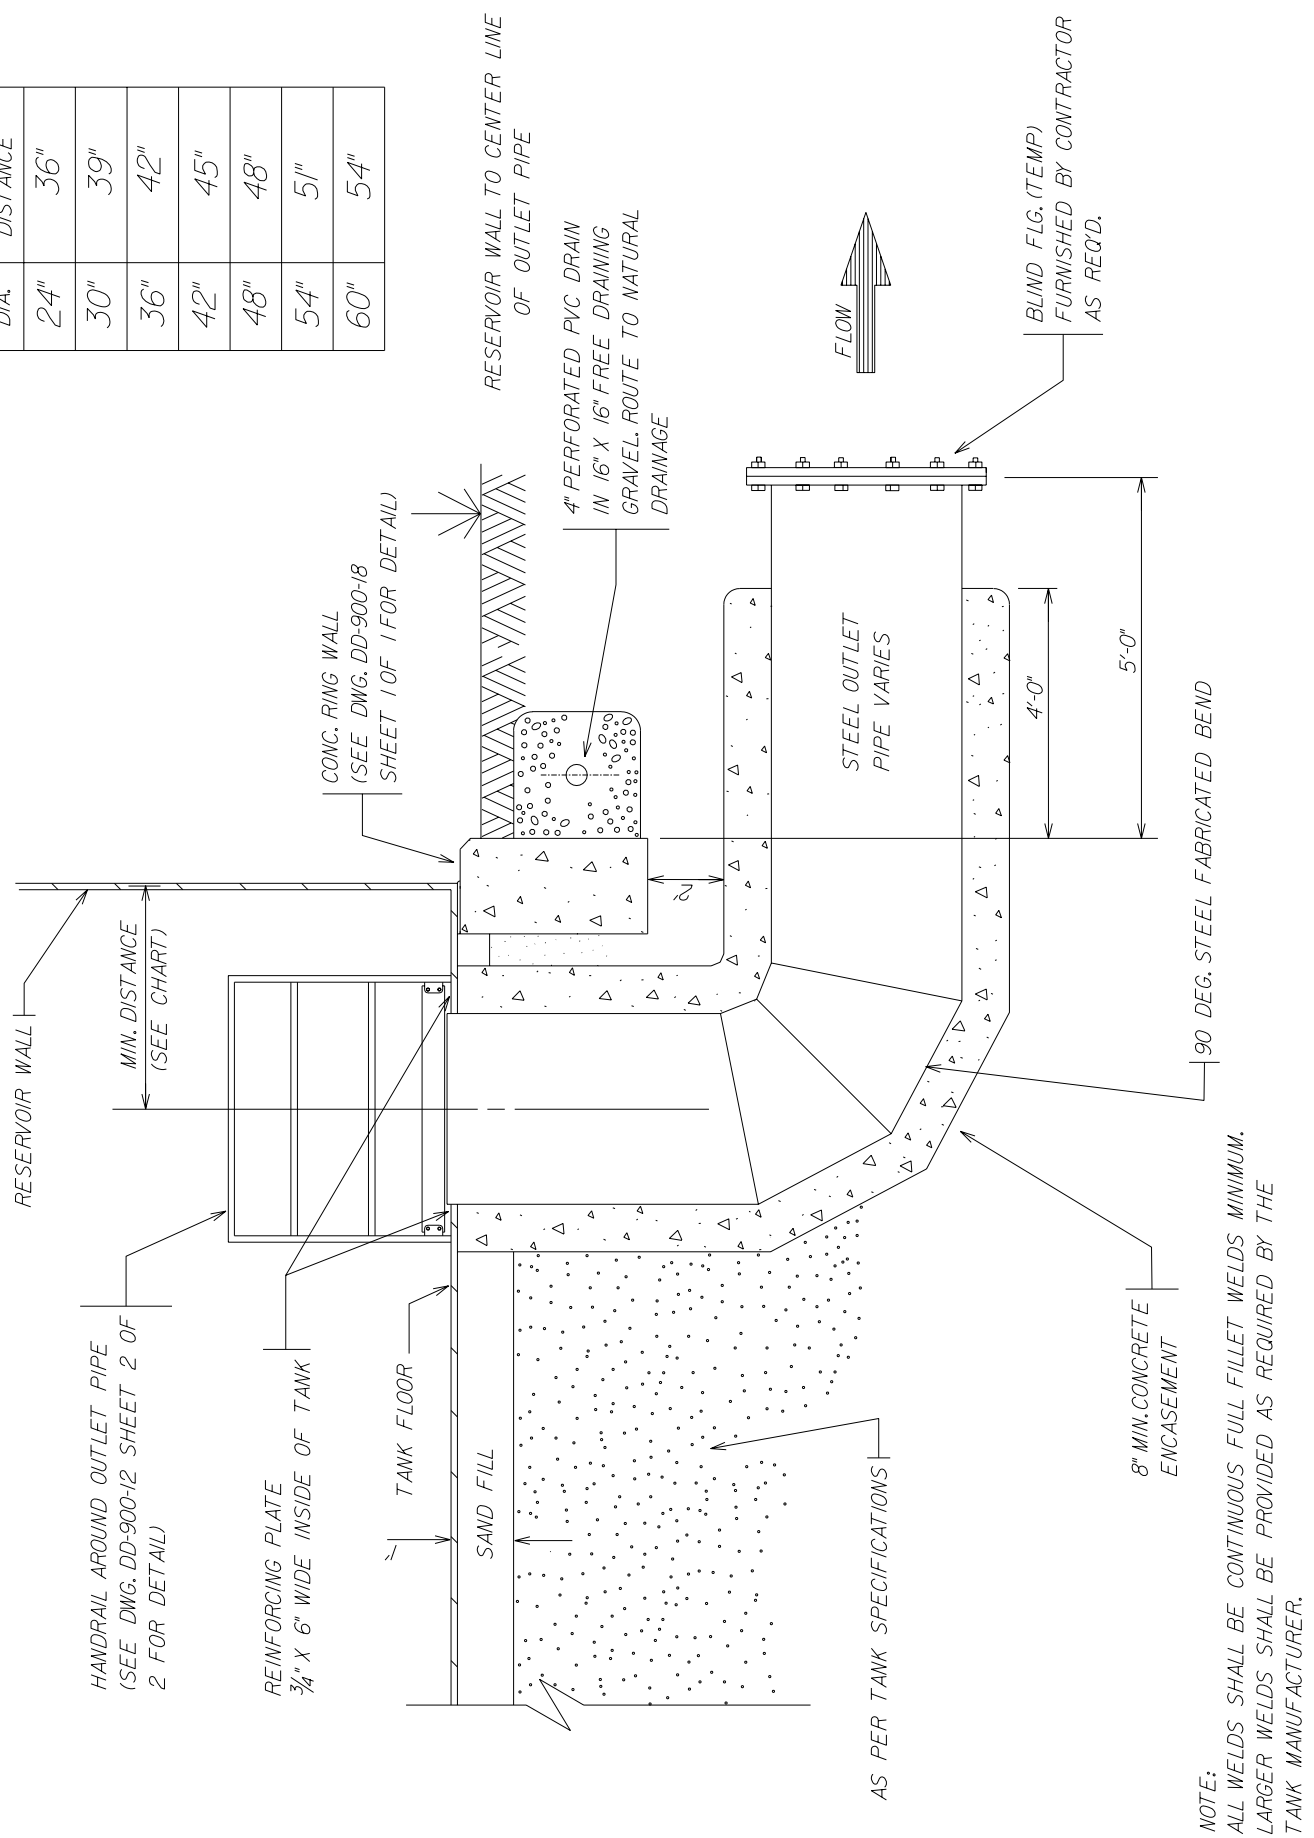

NOTE:
 ALL WELDS SHALL BE CONTINUOUS FULL FILLET WELDS MINIMUM.
 LARGER WELDS SHALL BE PROVIDED AS REQUIRED BY THE
 TANK MANUFACTURER.

PROPERTY OF
 SAN ANTONIO WATER SYSTEM
 SAN ANTONIO, TEXAS

TANK OUTLET PIPE

APPROVED	REVISED	
7-14-00	9-11-03	11-23-04
DD-900-12		SHEET 1 OF 2