


WELD 1/4" STEEL PLATE
TO TOP OF CASING, FOR
TEMPORARY CAP INSTALLED
AFTER WELL ACCEPTANCE
BY ENGINEER.

WELL HEADWORKS
(SEE DWG. DD-902-06).

STEEL PIPE SUCTION CHAMBER

VARIES

24"

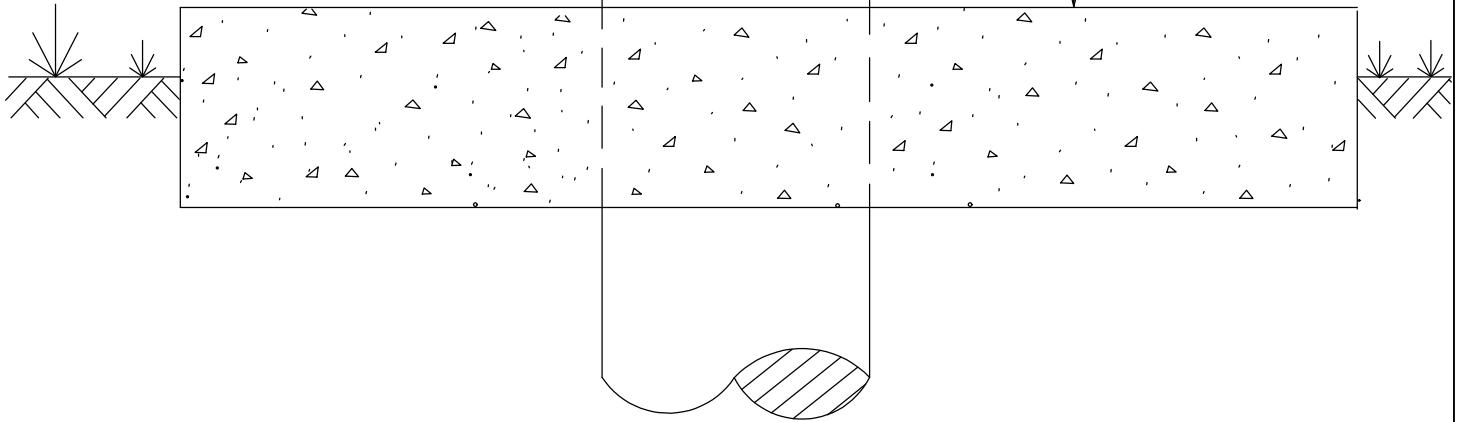

PROPERTY OF
SAN ANTONIO WATER SYSTEM
SAN ANTONIO, TEXAS

TEMPORARY CAP
DETAIL

APPROVED

7-14-00

REVISED

DD-902-07

SHEET
1 OF 1