



INSTALL 3/4" SCH. 80 PVC PIPE ANCHORED
INSIDE THE TANK BOWL AT 10' SPACING.
EXTEND SAMPLE PIPE TO 18" BELOW
OVERFLOW LEVEL. PROVIDE 1/4" HOLES
AT 6" SPACING

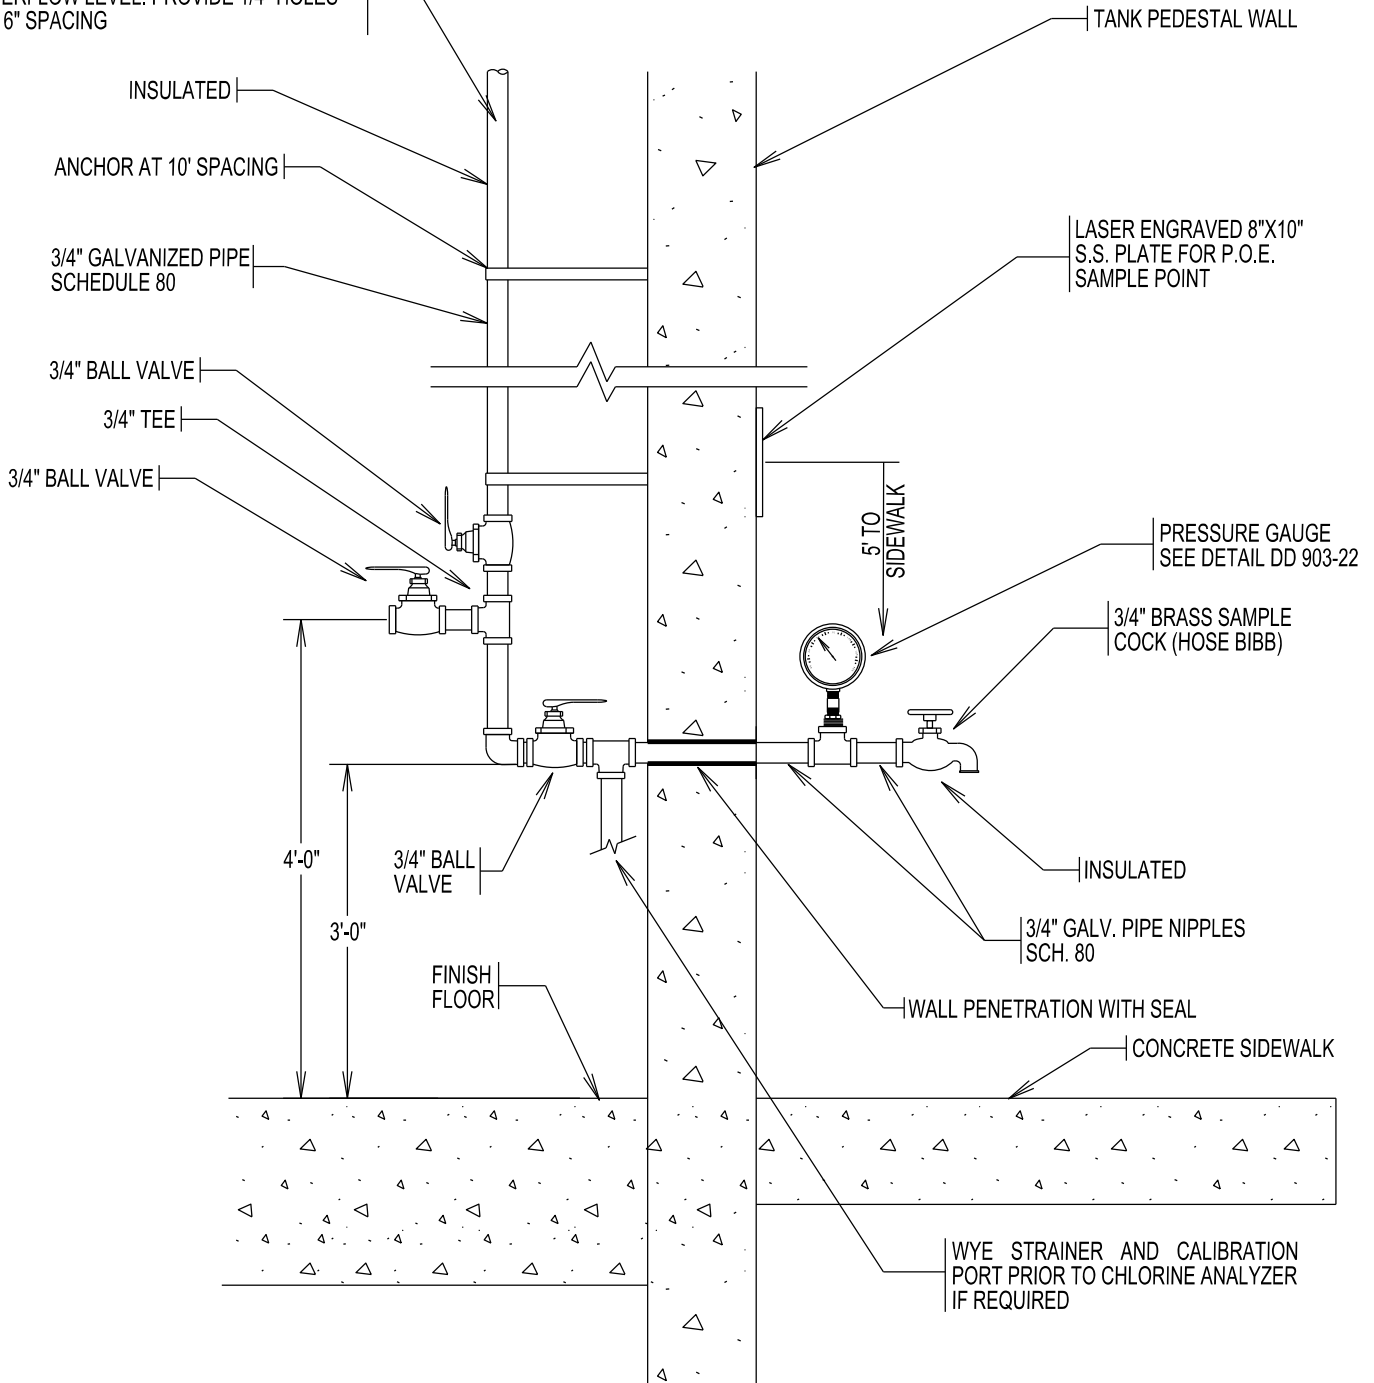

DD-903-11

SAN ANTONIO WATER SYSTEM
SAN ANTONIO, TEXAS



APPROVED:
MARCH 2011

SHEET
1 OF 1

SAMPLE TAP DETAIL

REVISED: