PROPERTY OF
SAN ANTONIO WATER SYSTEM
SAN ANTONIO, TEXAS

LEVEL PRESSURE TRANSMITTER

APPROVED 7-14-00

REVISED

DD-901-08

SHEET 1 OF 3

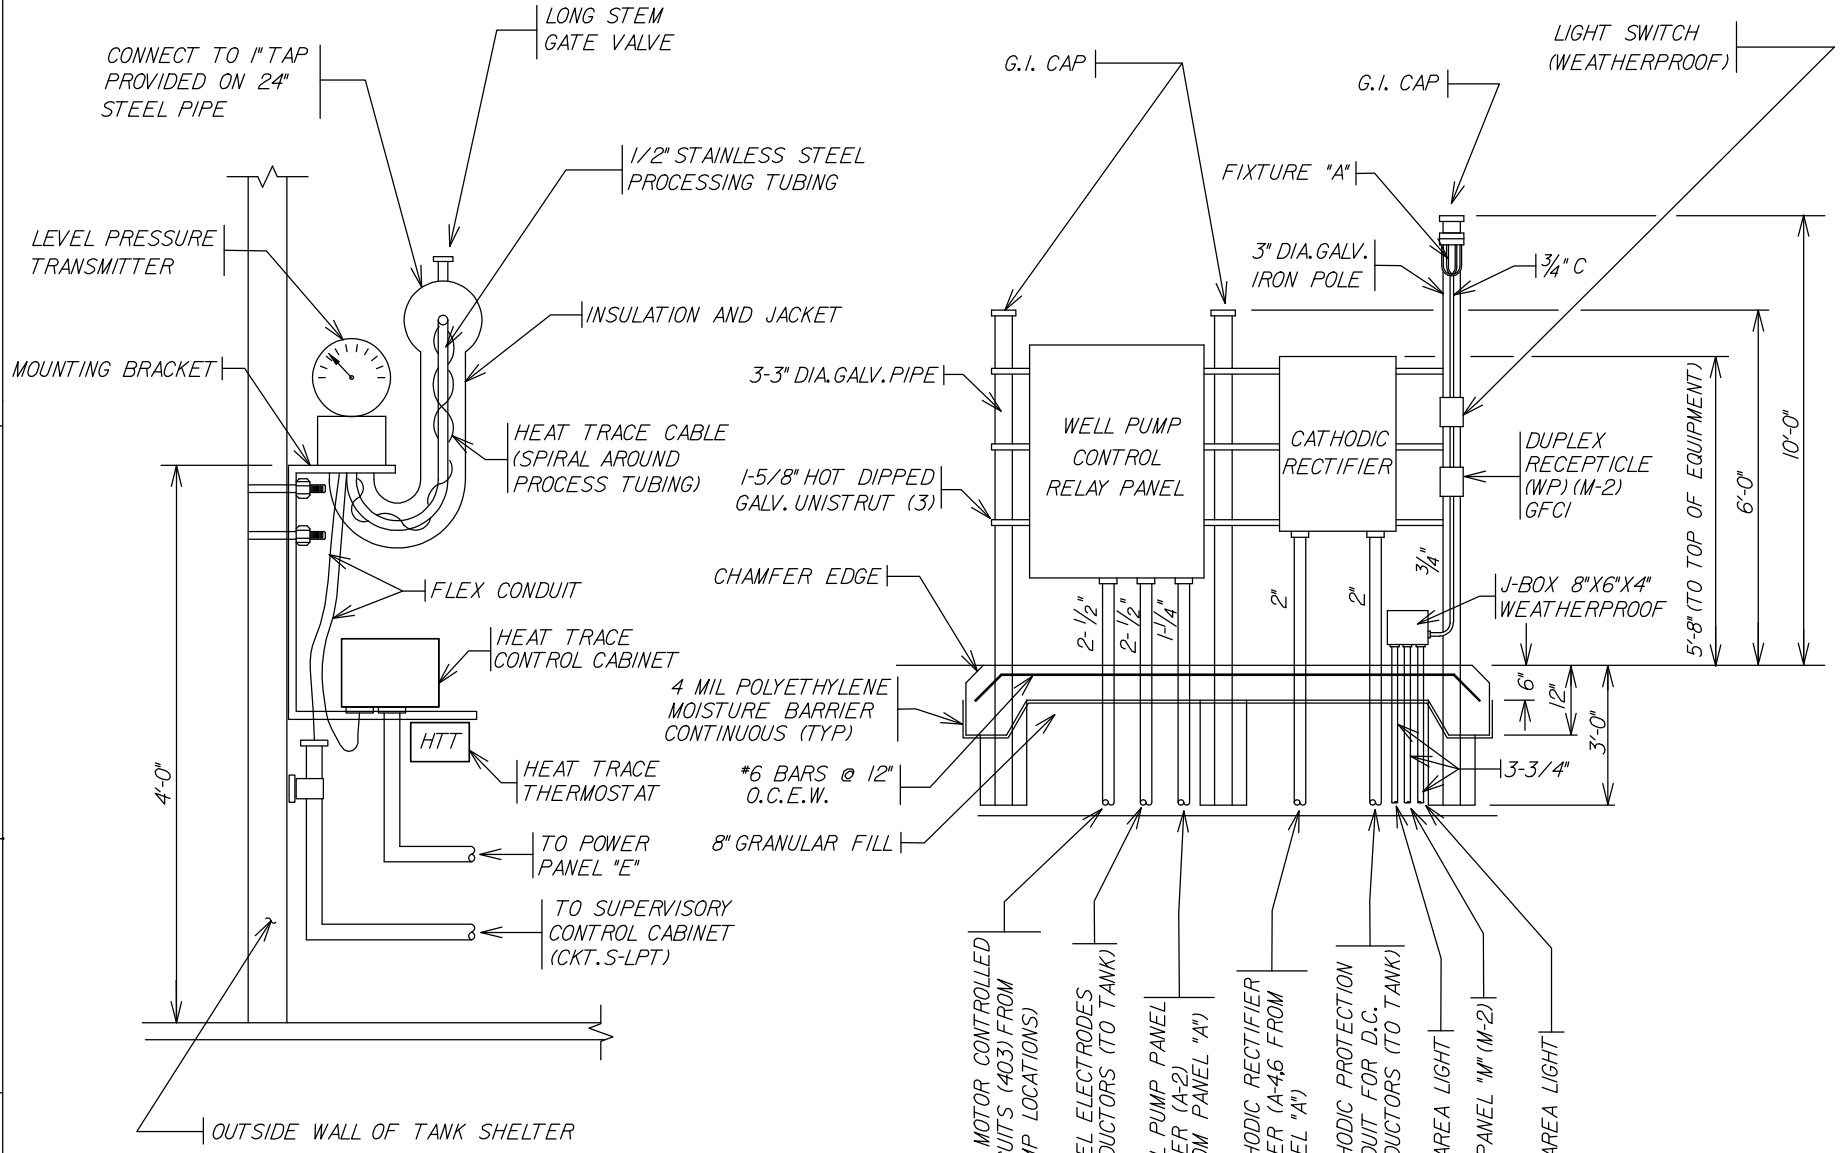

NOTE:
CONCRETE SLAB TO BE 3000 P.S.I. STRENGTH @ 28 DAYS).
WELL PUMP AND CATHODIC RECTIFIER PANELS TO BE INSTALLED 10' MIN. FROM TANK.