



WP INTERCONNECT WIRING - CONTROL  
 NOTES: 1. GROUND WIRES NOT SHOWN  
 2. ANALOG METERING FROM MCC TO SCP NOT SHOWN  
 3. ANALOG METERING FOR FLOWMETER NOT SHOWN

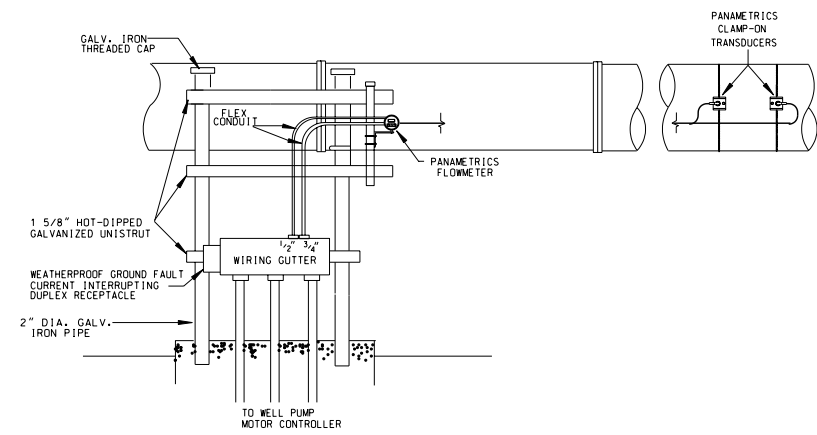


WP FLOW METERING  
 N.T.S.

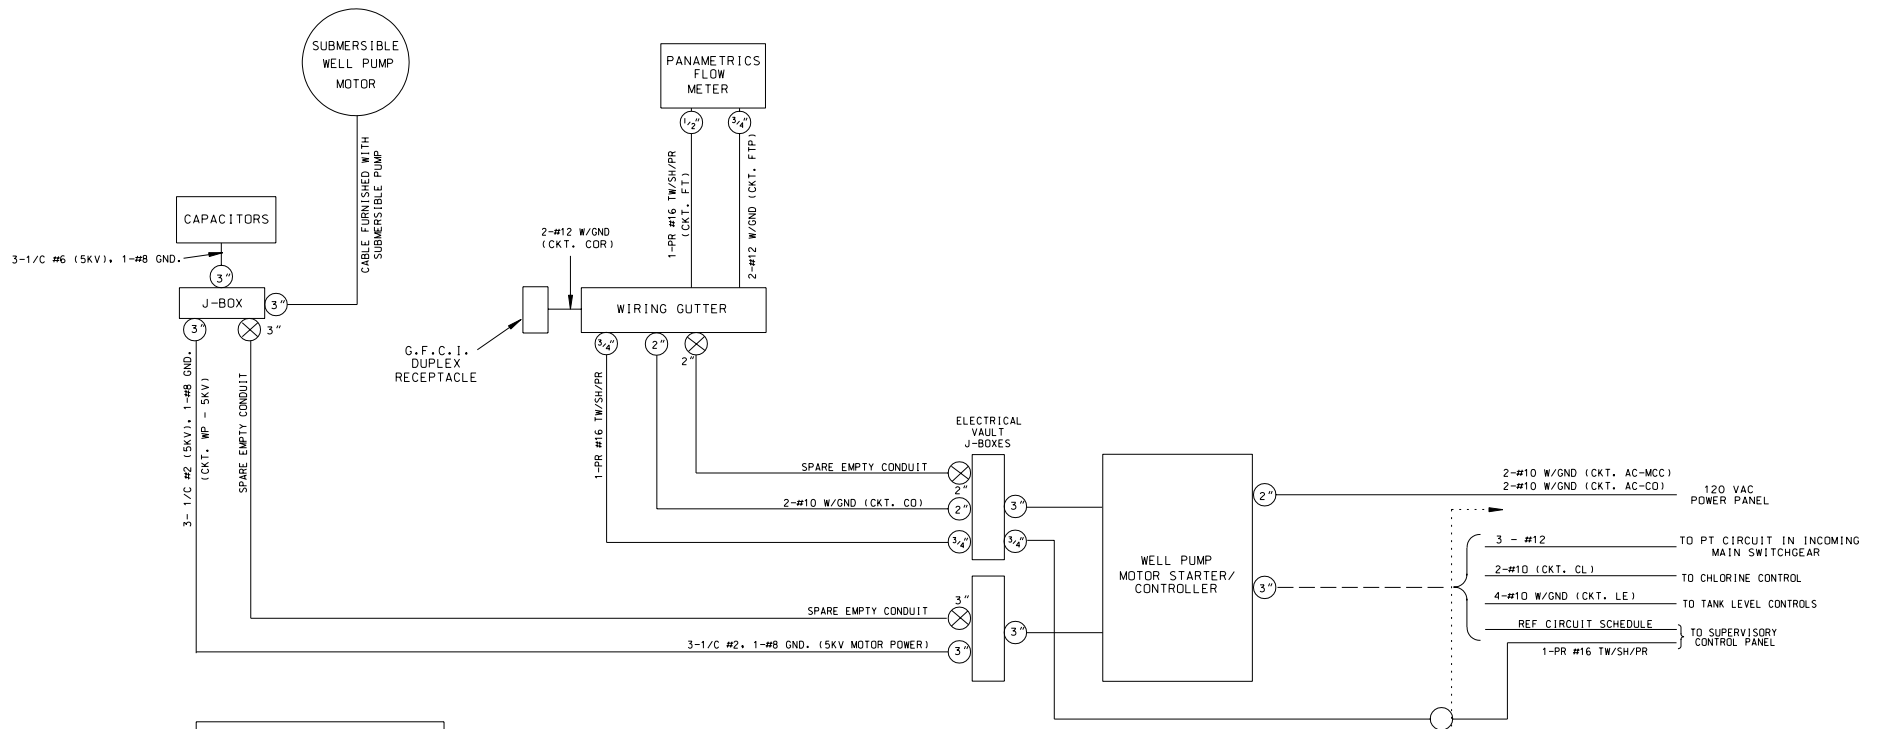


NOTE  
 (2) DIMENSIONS INSIDE CIRCLES INDICATE CONDUIT SIZES  
 (X) INDICATES SPARE EMPTY CONDUIT PROVIDE FULL WIRE IN ALL SPARE CONDUIT

WP CABLE & CONDUIT LAYOUT

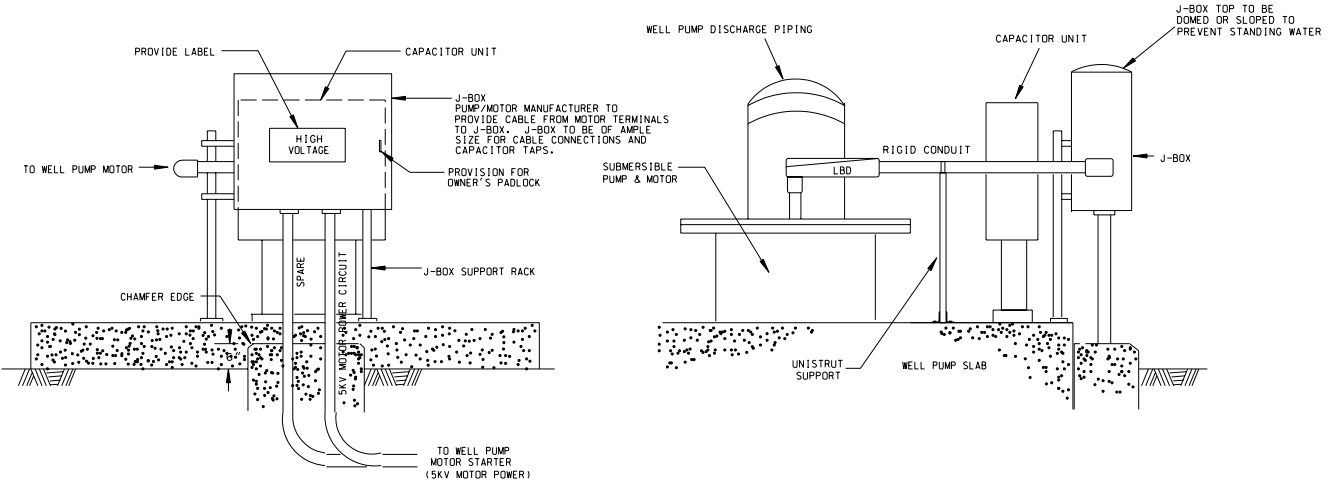

WP MOTOR POWER CONNECTION & CAPACITORS  
 N.T.S.

No.	Revision	Drawn	Approved	Date
Revisions				
 <b>DESIGN STANDARDS PUMP STATION</b> WELL PUMP INTERCONNECT WIRING CABLE AND CONDUIT LAYOUT AND DETAILS				
Developer		SAN ANTONIO WATER SYSTEM		
Cont.		Budget Proj.		
SUBMITTED GRUBB ENGINEERING, INC.				
APPROVED _____				
Map No.				Sheet
Section No.		Job No.		E 15
Dr. rdgj/ch				